


TABLE OF CONTENTS

CITY OF SPOKANE STANDARD PLANS – SECTION F

B-101B = Revised Standard Plan
 ***W-108A = New Standard Plan
 #A-1 = Renumbered Standard Plan

[Back to Main TOC](#)


<u>Plan No.</u>	<u>Plan Title</u>	<u>Current Plan Date</u>
F-101	Reinforced Doweled Curb	4/12
F-102	Concrete Sidewalk	4/13
F-102A	Integral Concrete Curb & Sidewalk	4/13
F-102B	Concrete Sidewalk Sections	4/13
F-102C	Concrete Sidewalk Repairs – Ramping Over Tree Roots	4/13
F-102D	Concrete Sidewalk Repairs – Diverting Around Tree Roots	4/13
F-103	Concrete Driveway – Adjacent Sidewalk / Type 1	4/13
F-103A	Concrete Driveway – Adjacent Sidewalk / Type 2	4/13
F-103B	Concrete Driveway – Adjacent Sidewalk / Type 3	4/13
F-104	Concrete Driveway – PED Buffer Strip Width > 5 Ft	4/13
F-104A	Concrete Driveway – PED Buffer Strip Width < 5 Ft	4/13
F-104B	Concrete Driveway w/ Integrated Swale Inlet	10/20
F-105	Curb Ramp Type-1 (2 Sheets)	4/13
F-105A	Curb Ramp Type-2, Preferred (2 Sheets)	4/13
F-105B	Curb Ramp Type-2, Restricted ROW (2 Sheets)	4/13
F-105C	Curb Ramp Type-3, Adjacent Sidewalk (2 Sheets)	4/13
F-105D	Curb Ramp Type-3, Separated Sidewalk (2 Sheets)	4/13
F-106	Concrete Curb and Curb / Gutter	4/12
F-106A	Concrete “V” Gutters	4/12
F-106B	Curb and Curb/Gutter @ Curb Ramps and Driveways	4/12
F-106C	Cement Concrete PED Curb	4/13
F-106D	Curb/Gutter	3/18
F-107	Tree Well Blockout for 4’ x 8’ Metal Grate	4/18
F-107A	Existing Sidewalk Retrofit; Options for Street Tree Installation	9/10
F-107B	Marking Irrigation Sleeves	7/14
F-108	Traffic Island	4/12
F-108A	Traffic Island Pocket and Nosing Parameters	3/94
F-109	Curb Drop Inlet	8/19
F-110	Swale Drain Pad	8/19
F-111	Vaulted Sidewalk Elimination w/ CDF Backfill	9/10

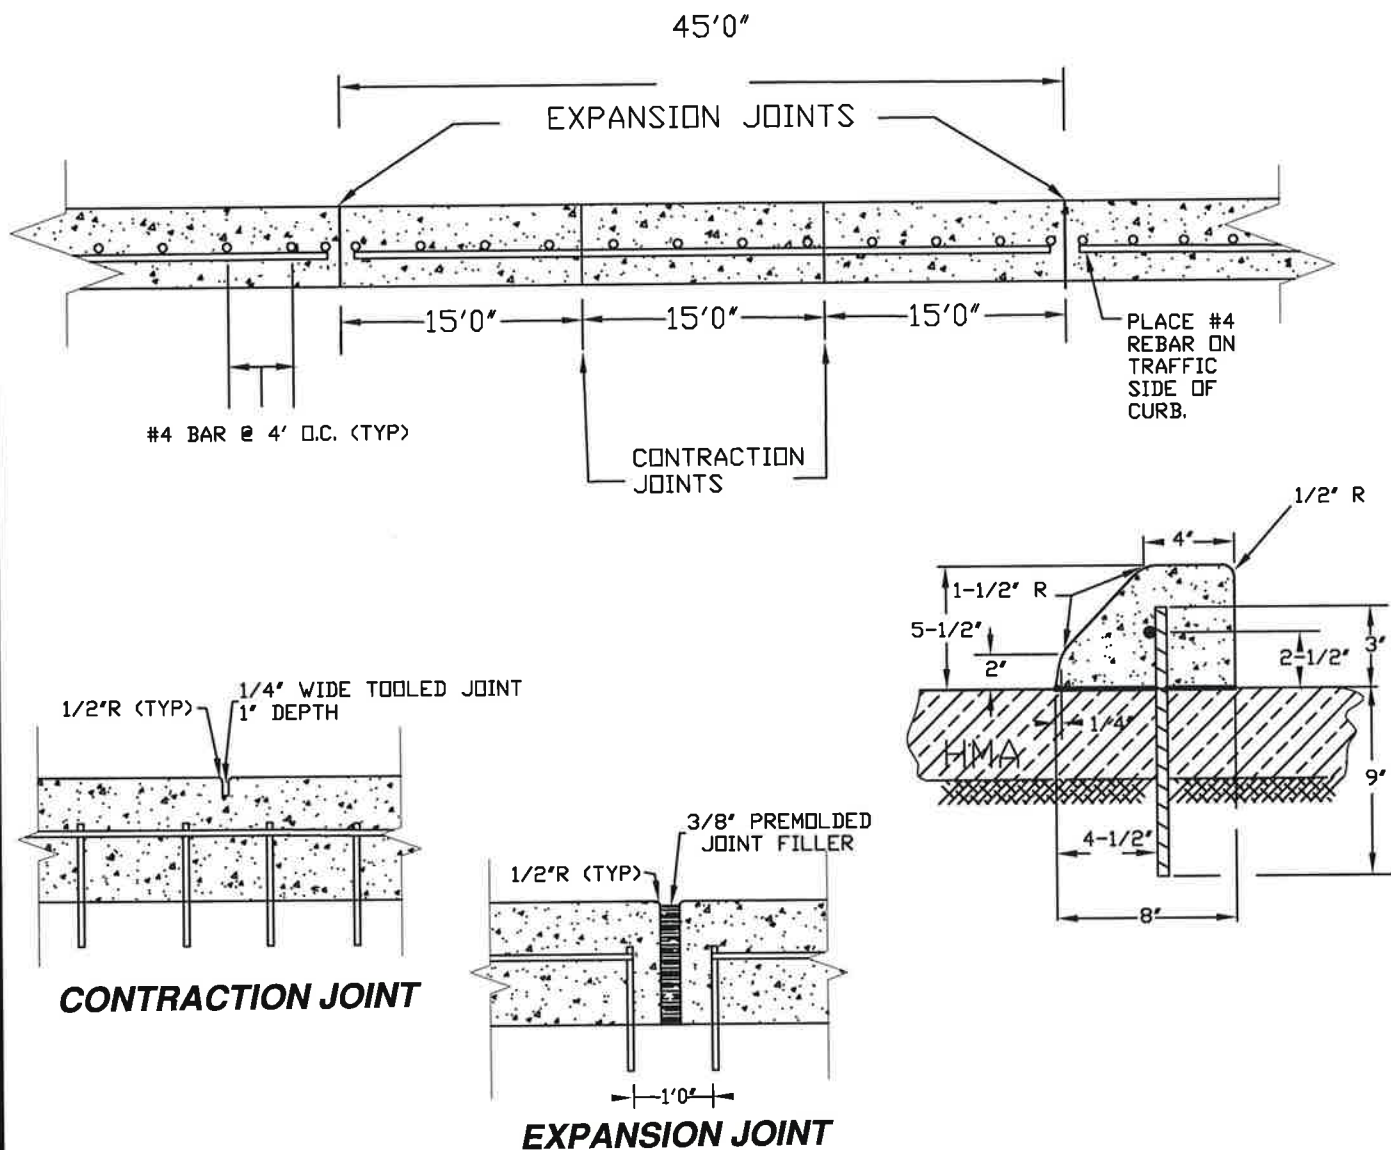



NOTES:

1. REINFORCED DOWELED CURB SHALL BE CONSTRUCTED USING AIR-ENTRAINED CLASS 4000 CONCRETE
2. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE REINFORCED DOWELED CURB. A 1-FOOT SECTION OF THE #4 REBAR SHALL BE REMOVED AT EACH EXPANSION JOINT. EXPANSION JOINT SPACING SHALL NOT EXCEED 45' O.C.
3. CONTRACTION JOINT SPACING SHALL NOT EXCEED 15' O.C.


APPROVED BY DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 2/1990 REVISED: 04/2012 SUPERSEDES: 01/2008		REINFORCED DOWELED CURB	
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		CHECKED BY: SJS SCALE: NTS REVISED BY: DSH		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON	
				STANDARD PLAN No. F-101	

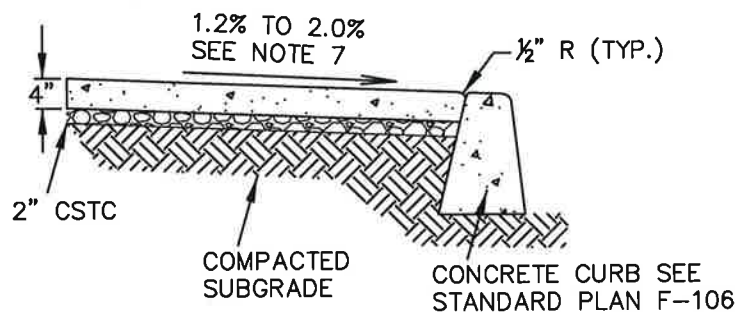

BROOMED FINISH TRANSVERSE TO PEDESTRIAN DIRECTION OF TRAVEL (TYP.)

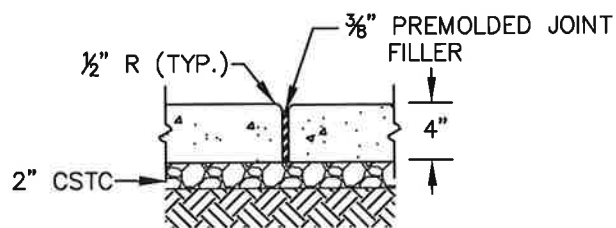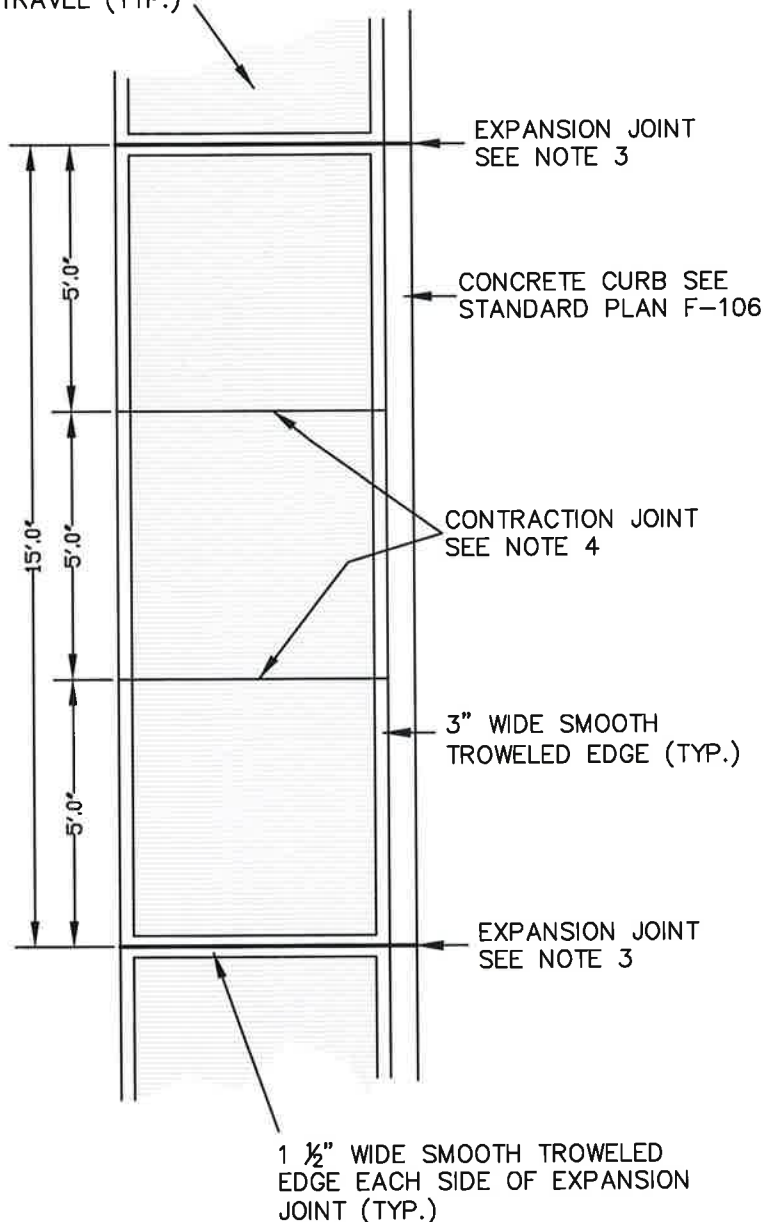

EXPANSION JOINT DETAIL

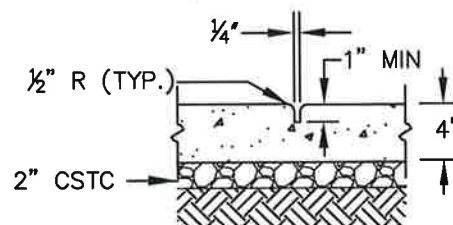

CONTRACTION JOINT DETAIL

NOTES:

1. CONCRETE SIDEWALKS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. 2-INCHES OF CONCRETE MAY BE SUBSTITUTED FOR THE 2-INCHES OF CSTC, YIELDING A TOTAL SIDEWALK THICKNESS OF 6-INCHES.
3. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE SIDEWALK & CURB OR CURB/GUTTER. EXPANSION JOINTS ARE REQ'D BETWEEN EXISTING SIDEWALKS AND CURB OR CURB/GUTTER AND NEW SIDEWALKS & CURB OR CURB/GUTTER. EXPANSION JOINT SPACING SHALL NOT EXCEED 15-FT O.C.
4. CONTRACTION JOINT SPACING SHALL NOT EXCEED 5-FT O.C.
5. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS BEHIND SIDEWALK.
6. A 5-FT WIDE TRANSITION PANEL IS REQUIRED WHEN CONNECTING NEW SIDEWALKS TO EXISTING SIDEWALKS W/ CROSS SLOPES EXCEEDING 2.0%.
7. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

 DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 2/86
 REVISED: 04/2013
 SUPERSEDES: 04/2012
 CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK

CONCRETE SIDEWALK



ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

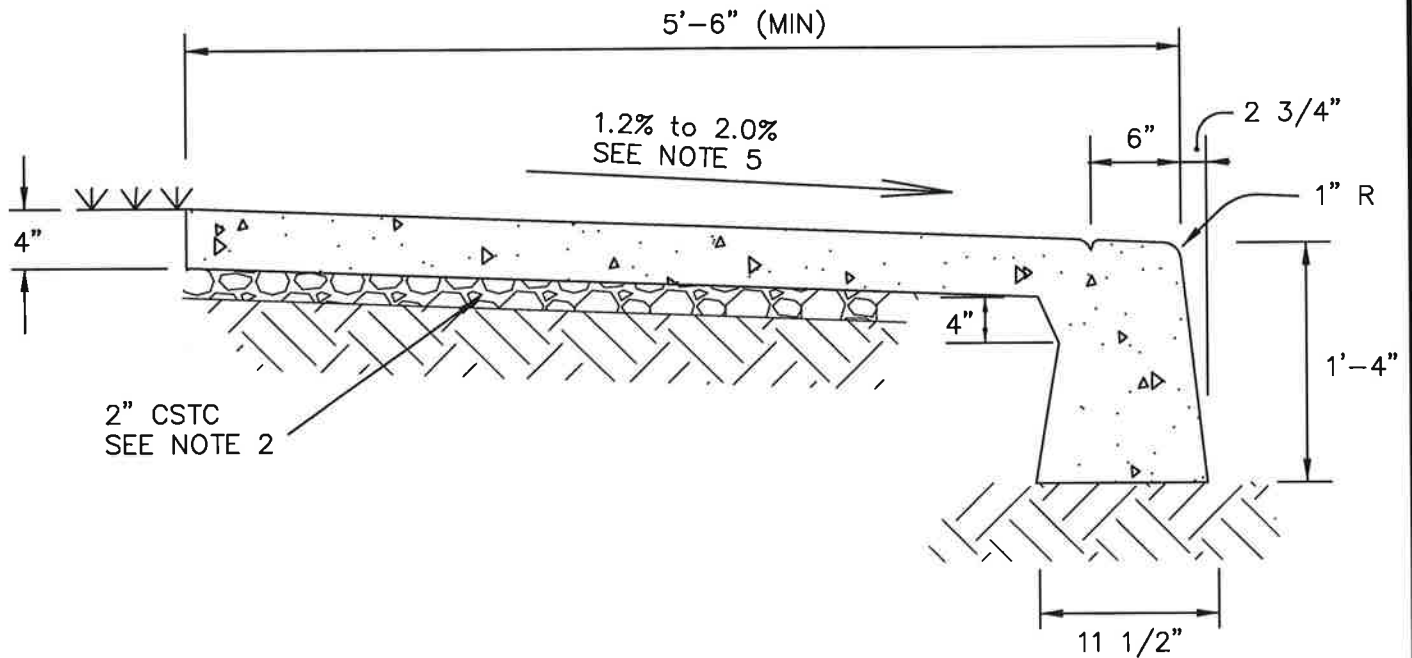


STANDARD
 PLAN No.
 F-102




SECTION

NOTES:

1. INTEGRAL CONCRETE CURB & SIDEWALK SHALL BE CONSTRUCTED USING AIR ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. 2-INCHES OF CONCRETE MAY BE SUBSTITUTED FOR THE 2-INCHES OF CSTC, YIELDING A TOTAL SIDEWALK THICKNESS OF 6-INCHES.
3. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
4. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS BEHIND SIDEWALK.
5. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 2/1990 REVISED: 04/2013 SUPERSEDES: 04/2012 CHECKED BY: JTG SCALE: NTS REVISED BY: LWK		INTEGRAL CONCRETE CURB & SIDEWALK	
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON		STANDARD PLAN No. F-102A	

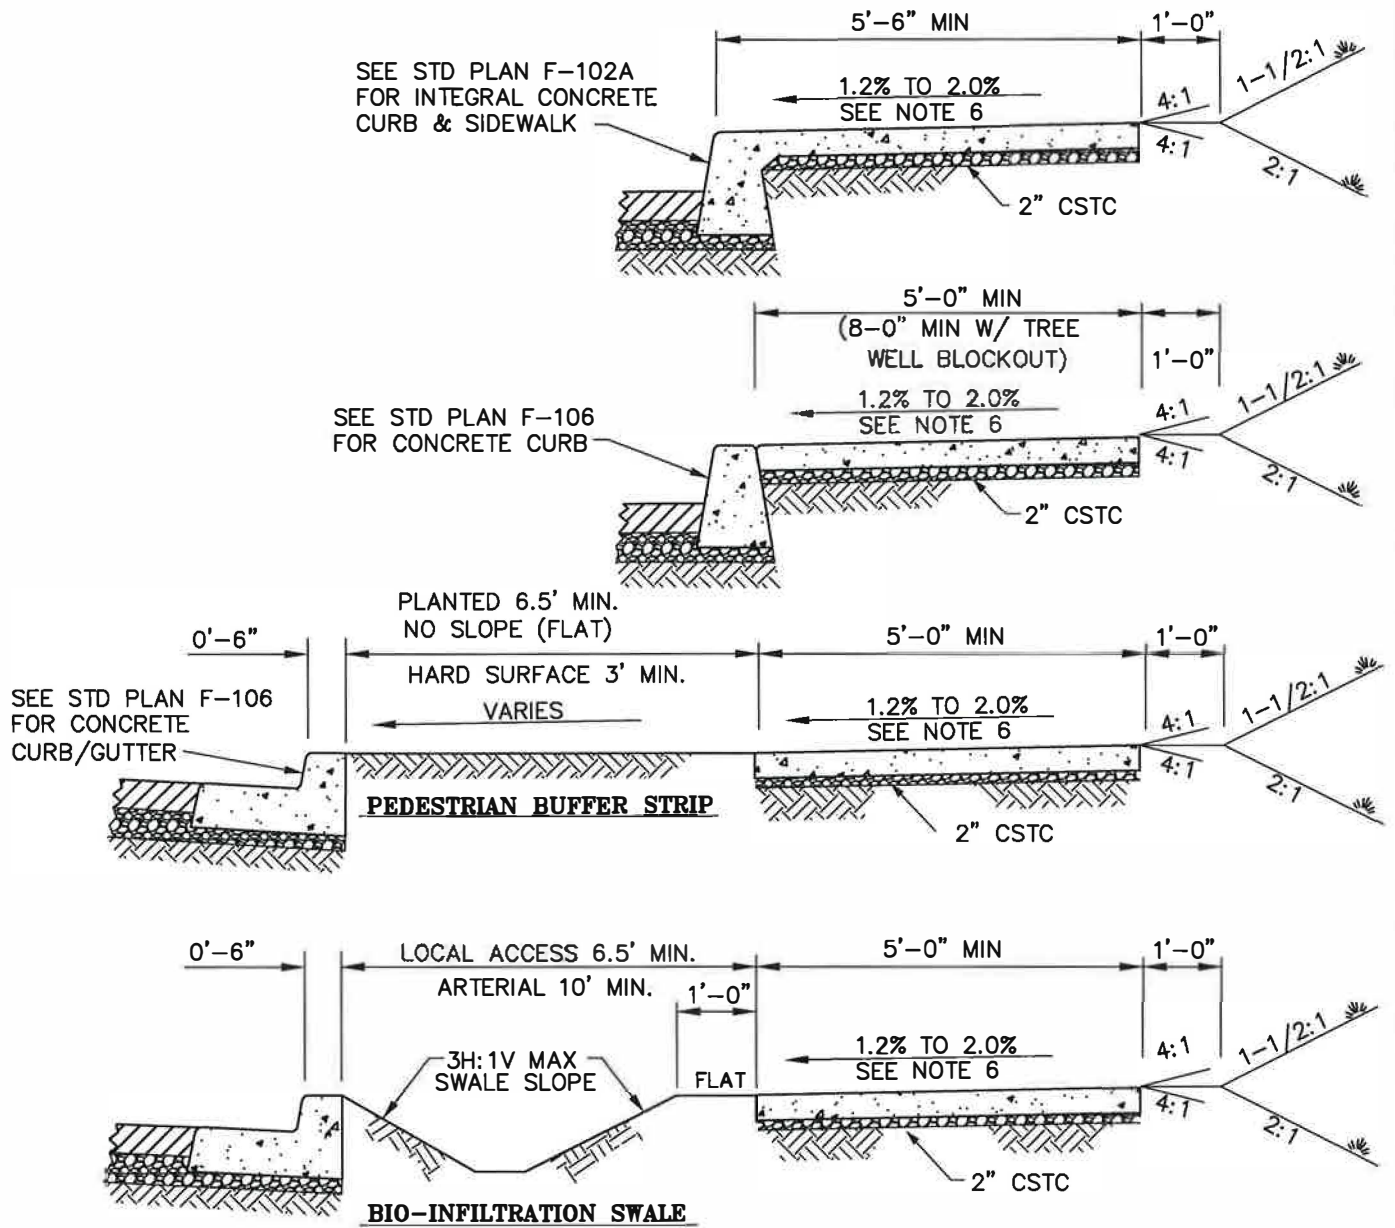

NOTES:

1. TYPICAL SIDEWALK THICKNESS SHALL BE 4 INCHES. EXCEPTION: SEE STD PLANS F-103 THROUGH F-104B FOR SIDEWALK THICKNESS REQUIREMENTS AT DRIVEWAYS.
2. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
3. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR SIDEWALK WIDTH REQUIREMENTS.
4. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR PEDESTRIAN BUFFER STRIP WIDTH REQUIREMENTS
5. SEE STD PLAN B-102F FOR BIO-INFILTRATION SWALE REQUIREMENTS.
6. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

 DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 6/1993
 REVISED: 04/2013
 SUPERSEDES: 04/2012
 CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK

CONCRETE SIDEWALK SECTIONS




ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

STANDARD
 PLAN No.
F-102B

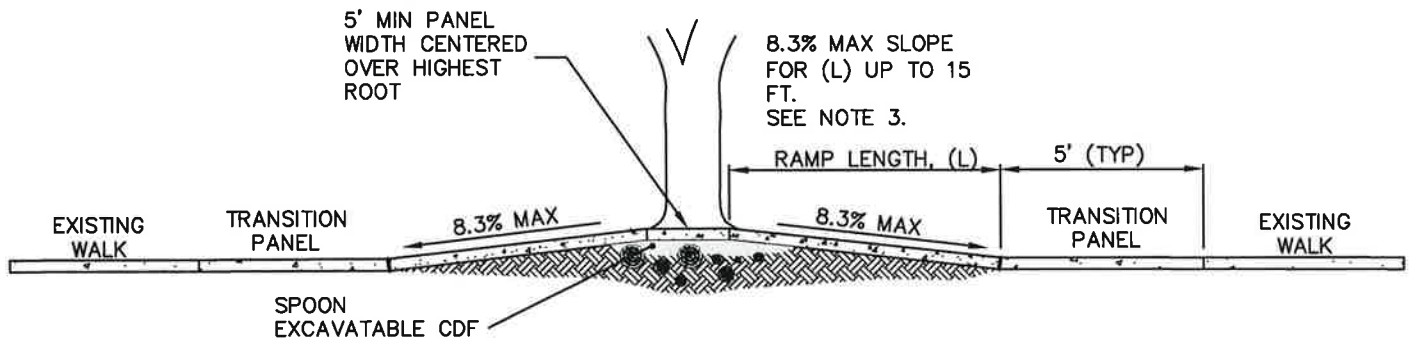

SECTION A-A

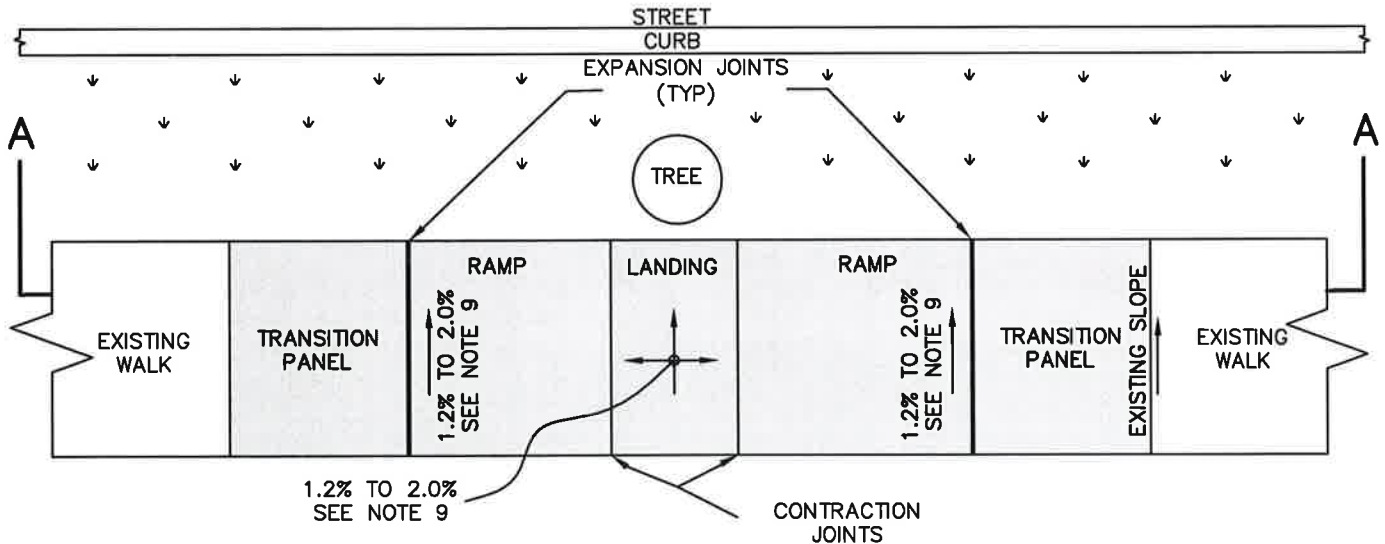

PLAN VIEW

NOTES:

1. THIS PLAN DOES NOT APPLY FOR NEW SIDEWALK CONSTRUCTION IN UNDEVELOPED AREAS.
2. 5-FT TRANSITION PANEL IS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2.0%
3. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY; INCREASE MAXIMUM RUNNING SLOPE AS DIRECTED BY THE ENGINEER. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
4. ROOT AREAS SHALL BE UNDISTURBED AS MUCH AS PRACTICAL. LOOSE SOIL SHALL BE LIGHTLY HAND TAMPED. IF ROOT TRIMMING IS NECESSARY CONTACT CITY OF SPOKANE URBAN FORESTRY.
5. FILL VOIDS AROUND ROOTS TO PROVIDE SIDEWALK SUPPORT W/ LAYER OF SPOON EXCAVATABLE CDF FILL PER SECTION 2-09.3(1)E. 1-INCH MINIMUM COVER OVER THE HIGHEST ROOT IS REQUIRED.
6. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
7. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS ON EACH SIDE OF ELEVATED SIDEWALK. PLACE TOPSOIL TYPE A AND HYDROSEED OR SOD AS DIRECTED BY THE ENGINEER TO MATCH EXISTING CONDITIONS.
8. RAISE, RELOCATE, OR REPLACE EXISTING SPRINKLER SYSTEM AS NEEDED.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES

PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST

KENNETH M. BROWN, P.E.

ADOPTED: 09/2010

REVISED: 04/2013

SUPERSEDES: 04/2012

CHECKED BY: JTG

SCALE: NTS


REVISED BY: LWK

CONCRETE SIDEWALK REPAIRS
RAMPING OVER TREE ROOTS



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-102C

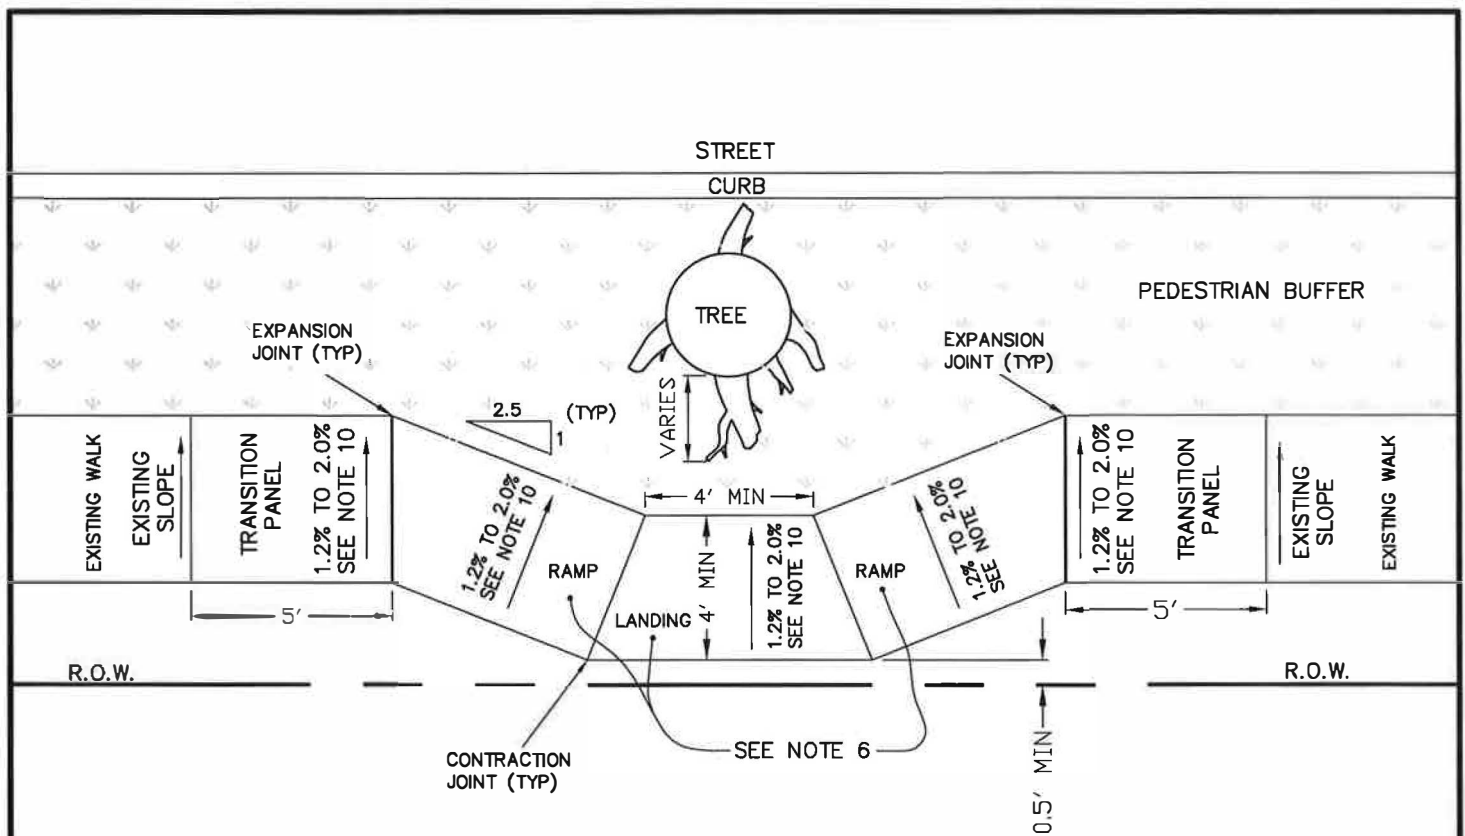

NOTES:


1. THIS PLAN DOES NOT APPLY FOR NEW SIDEWALK CONSTRUCTION IN UNDEVELOPED AREAS.
2. 5-FT TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2.0%.
3. ROOT AREAS SHALL BE UNDISTURBED AS MUCH AS PRACTICAL. LOOSE SOIL SHALL BE LIGHTLY HAND TAMPED. IF ROOT TRIMMING IS NECESSARY CONTACT CITY OF SPOKANE URBAN FORESTRY.
4. TYPICAL SIDEWALK DIVERSION ANGLE SHALL BE 2.5 TO 1. DIVERSION ANGLE MAY BE INCREASED TO 1 TO 1 AS DIRECTED BY THE ENGINEER.
5. BACK OF SIDEWALK SHALL BE A MINIMUM OF 0.5 FT INSIDE OF THE R.O.W. SIDEWALK WIDTH MAY BE DECREASED TO 3 FT AS DIRECTED BY THE ENGINEER TO ENSURE SIDEWALK IS WITHIN THE R.O.W.
6. USE IN CONJUNCTION W/ STD PLAN F-102C WHEN RAMPING OVER AND DIVERTING AROUND TREE ROOTS IS REQUIRED.
7. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS. PROVIDE ADDITIONAL EXPANSION JOINTS AS SHOWN.
8. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS ON EACH SIDE OF SIDEWALK. PLACE TOPSOIL TYPE A AND HYDROSEED OR SOD AS DIRECTED BY THE ENGINEER.
9. RELOCATE OR REPLACE EXISTING SPRINKLER SYSTEMS AS NEEDED.
10. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.



APPROVED BY

 DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 09/2010
 REVISED: 04/2013
 SUPERSEDES: 04/2012
 CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK


CONCRETE SIDEWALK REPAIR
 DIVERTING AROUND TREE ROOTS
 ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON
 STANDARD
 PLAN No.
 F-102D

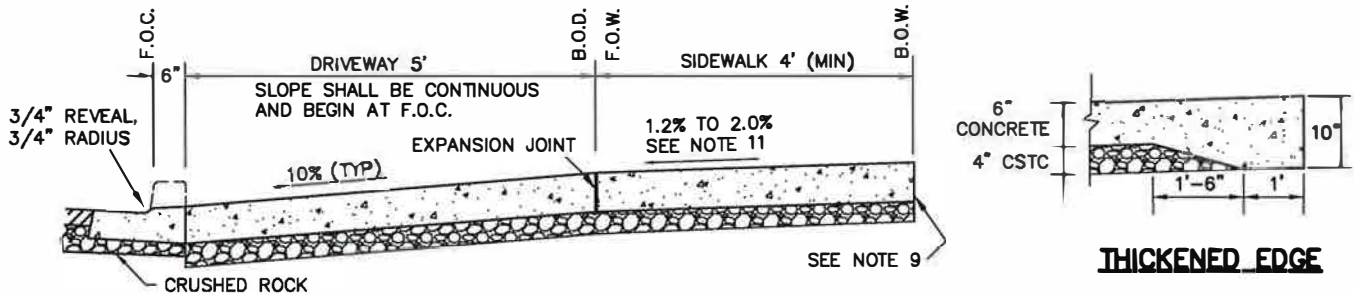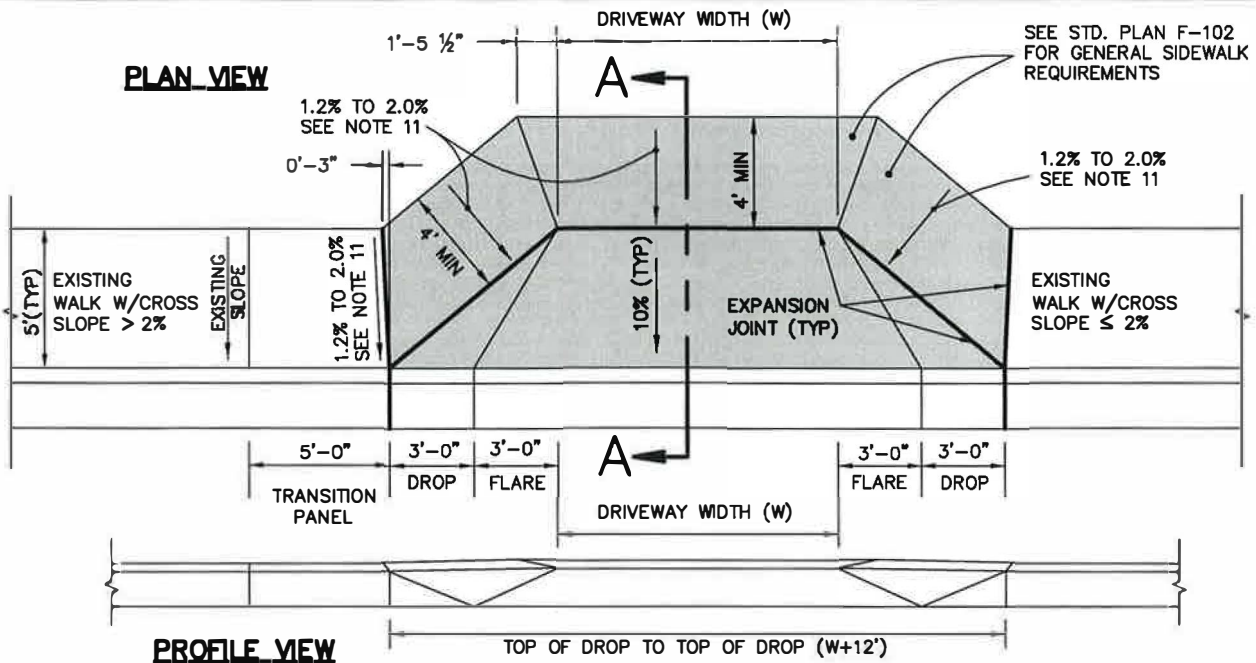

SECTION A-A

NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
7. THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO 3" TO MATCH EXISTING CONDITIONS AT BACK OF SIDEWALK (B.O.W.).
8. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

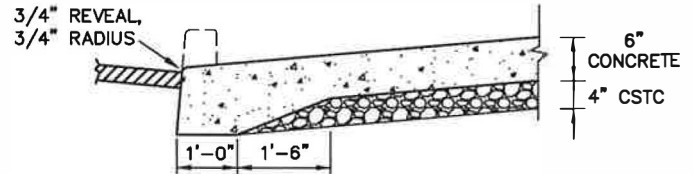

SECTION A-A

INTEGRAL CURB & DRIVEWAY

APPROVED BY

[Signature]

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

[Signature]

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 09/2010

REVISED: 04/2013

SUPERSEDES: 04/2012

CHECKED BY: JTG

SCALE: NTS


REVISED BY: LWK





CONCRETE DRIVEWAY
ADJACENT SIDEWALK / TYPE 1

ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-103

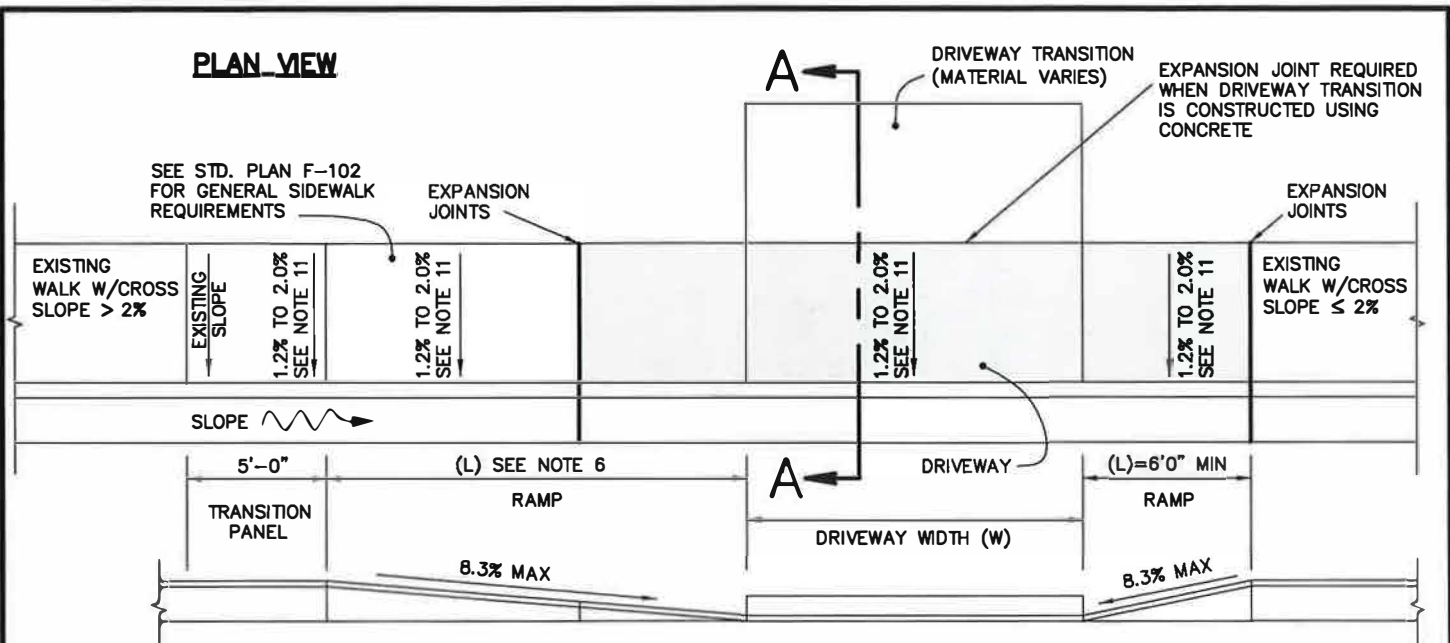

PROFILE VIEW

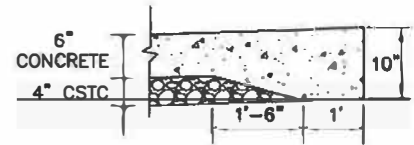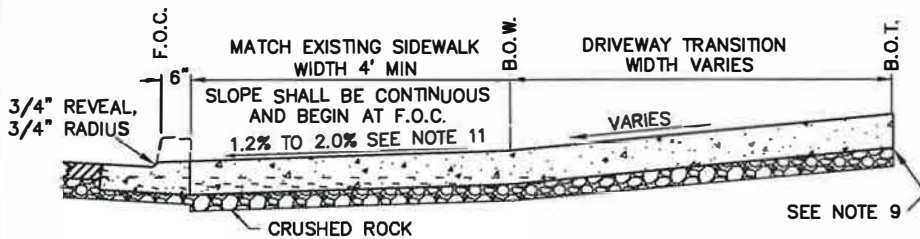


THICKENED EDGE

SECTION A-A

NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY RAMP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE TOP OF A DRIVEWAY RAMP SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC. SHADED AREA SHALL BE EXPANDED TO INCLUDE DRIVEWAY TRANSITION WHEN CONSTRUCTED USING CONCRETE.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HANO TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY TRANSITION SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. OR B.O.T. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

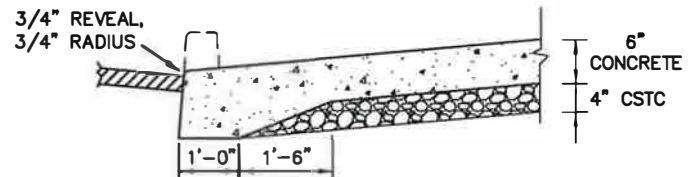


SECTION A-A



INTEGRAL CURB & DRIVEWAY

<p>APPROVED BY</p> <p><i>[Signature]</i></p> <p>DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.</p>		<p>ADOPTED: 04/2004</p> <p>REVISED: 04/2013</p> <p>SUPERSEDES: 04/2012</p> <p>CHECKED BY: JTG</p> <p>SCALE: NTS</p> <p>REVISED BY: LWK</p>		<p>CONCRETE DRIVEWAY ADJACENT SIDEWALK / TYPE 2</p>	
<p><i>[Signature]</i></p> <p>PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.</p>		<p>SPokane</p>		<p>ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON</p>	
				<p>STANDARD PLAN No. F-103A</p>	

PLAN VIEW

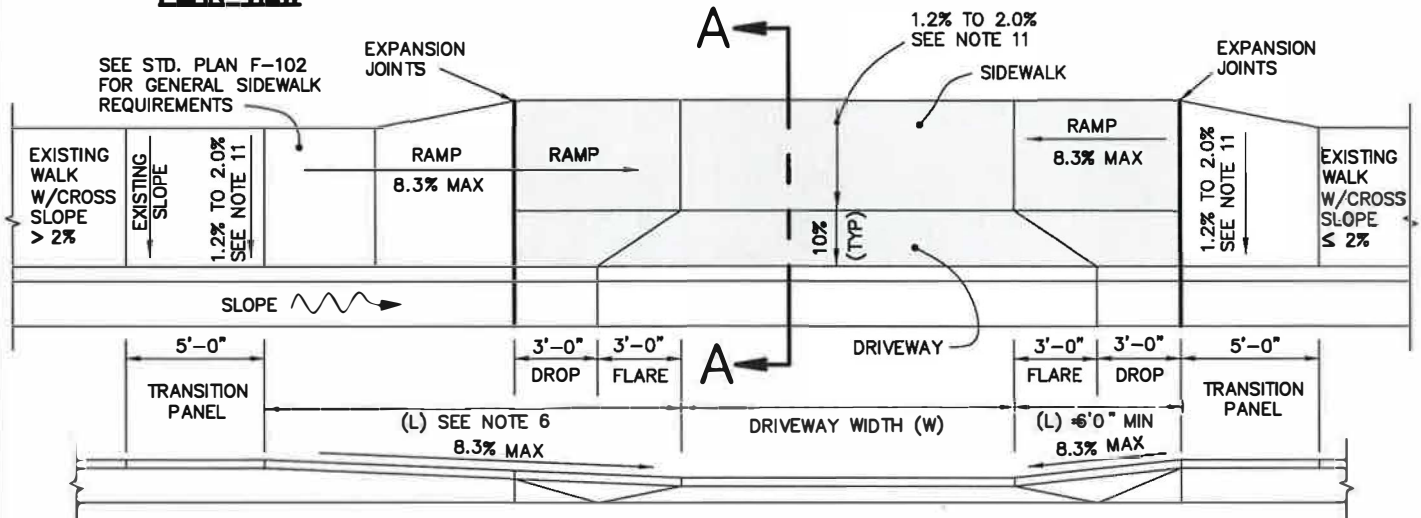

PROFILE VIEW

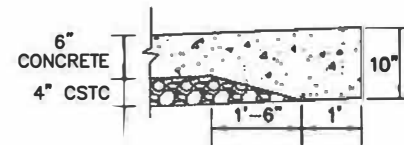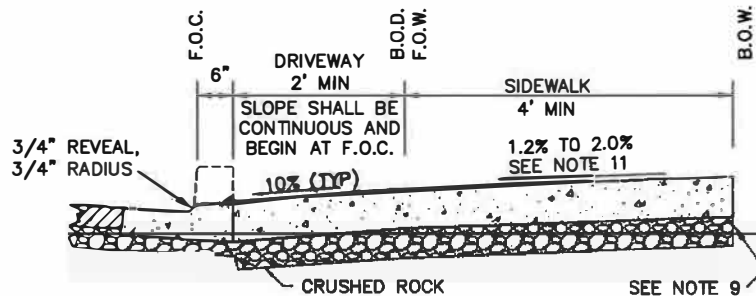


THICKENED EDGE

SECTION A-A

NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY RAMP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE TOP OF A DRIVEWAY RAMP SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2% AND WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE THE WIDTH OF THE IMPROVEMENTS.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

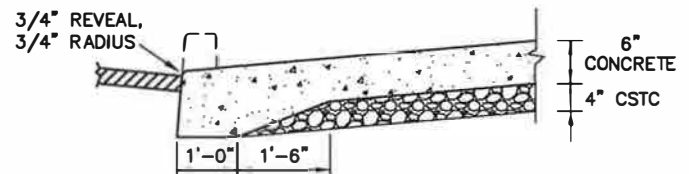

SECTION A-A

INTEGRAL CURB & DRIVEWAY

APPROVED BY

[Signature]
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.
[Signature]
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 04/2004
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK


CONCRETE DRIVEWAY
ADJACENT SIDEWALK / TYPE 3




ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-103B


PLAN VIEW

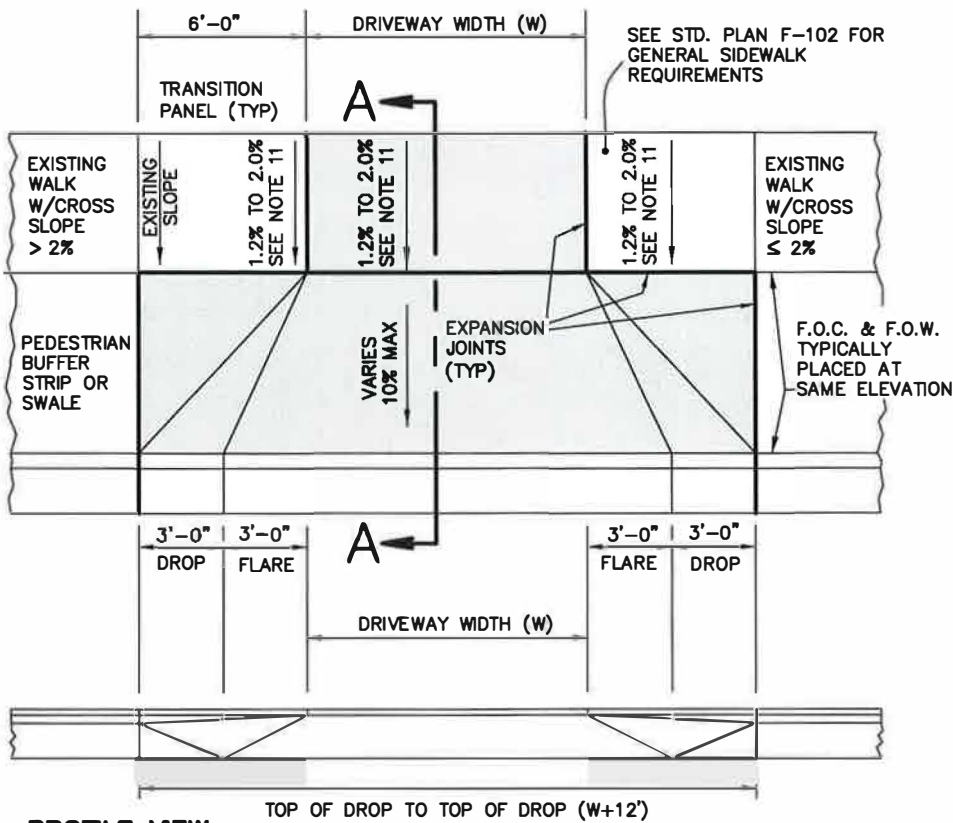

PROFILE VIEW

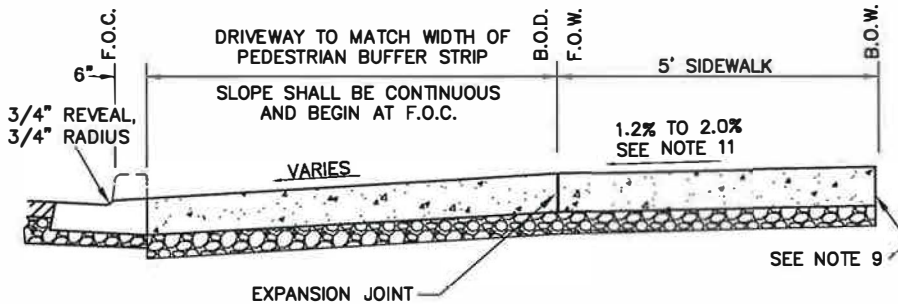


SECTION A-A

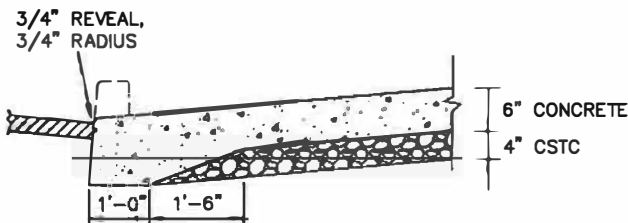

SECTION A-A

INTEGRAL CURB & DRIVEWAY

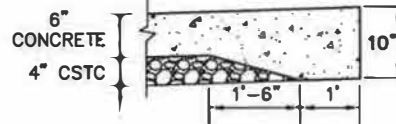

THICKENED EDGE

NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
7. THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO .25 FT TO MATCH EXISTING CONDITIONS AT BACK OF SIDEWALK (B.O.W.).
8. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

[Signature]
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.
[Signature]
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 04/2004
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK




CONCRETE DRIVEWAY
PED BUFFER STRIP WIDTH ≥ 5 FT



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-104

PLAN VIEW

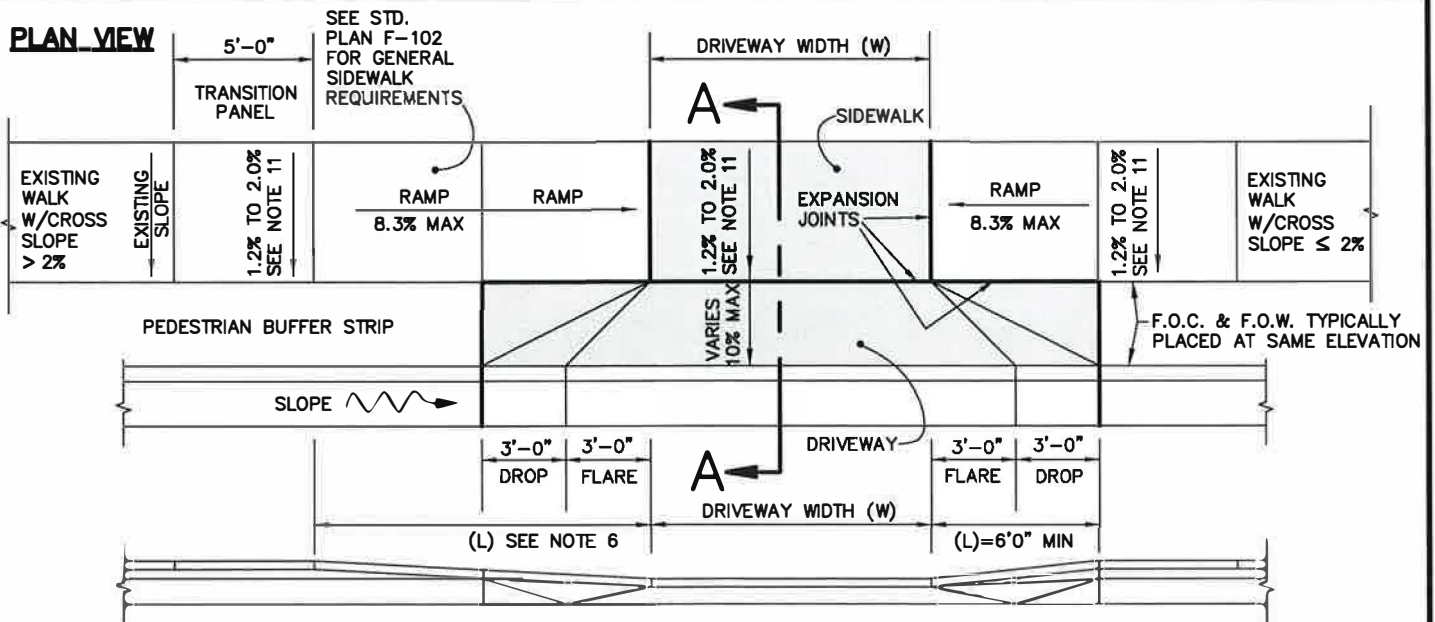

PROFILE VIEW

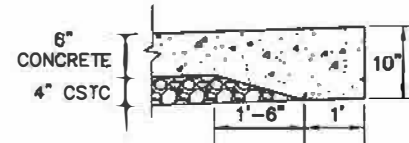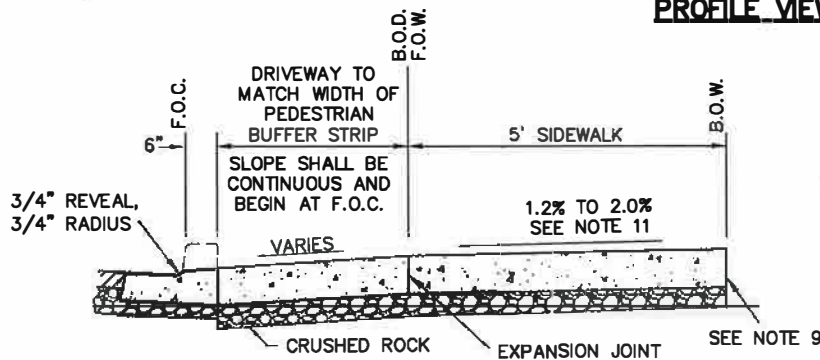


THICKENED EDGE

NOTES:

SECTION A-A

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

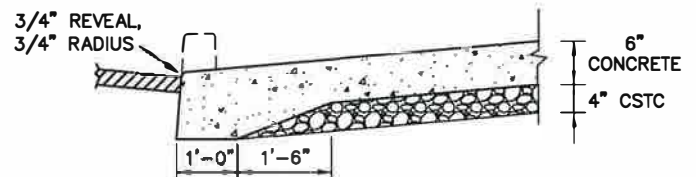

SECTION A-A

INTEGRAL CURB & DRIVEWAY

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.



ADOPTED: 04/2004
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK

CONCRETE DRIVEWAY
PED BUFFER STRIP WIDTH < 5 FT



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-104A

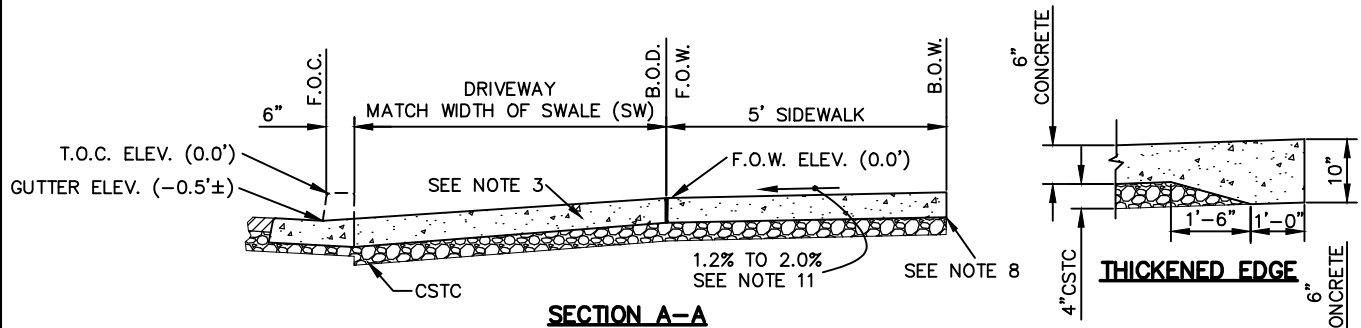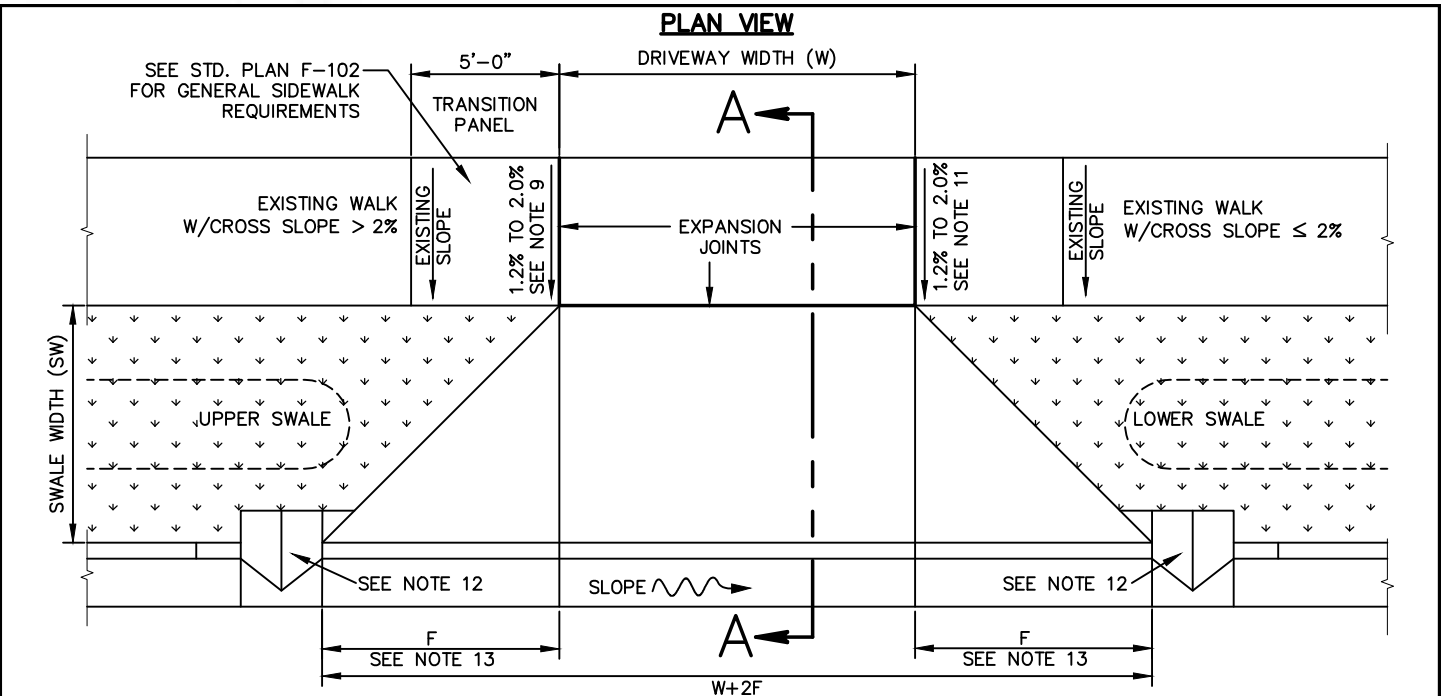

NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENGINEERING SERVICES DEPT.
2. THE TOP OF DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5 FEET OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. THE SHADED AREA REQUIRES 6 INCH MIN. DEPTH OF AIR ENTRAINED, 6 SACK COMMERCIAL CONCRETE OVER 4 INCHES OF COMPACTED CSTC.
4. EXPANSION JOINTS SHALL BE 3/8 INCH PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
5. THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO 0.25 FEET TO MATCH EXISTING CONDITIONS AT THE BACK OF SIDEWALK.
6. IN THE SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4 INCH WIDE BY 2 INCH MIN. DEPTH.
7. BROOM FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOM FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
8. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
9. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
10. SEE STD. PLAN B-102F FOR SWALE REQUIREMENTS.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
12. CURB DROP INLET, SEE STD. PLAN F-109.
13. FLARE WIDTH (F)=3'. EXCEPTION: WHEN TRAVEL IS ADJACENT TO CURB (I.E., NO PARKING LANE OR BIKE LANE), FLARE WIDTH SHALL EQUAL SWALE WIDTH (SW) BUT NOT TO EXCEED 6'.

APPROVED BY



ENGINEERING SERVICES DIRECTOR KYLE TWOHIG

CITY ENGINEER DAN BULLER, P.E.

ADOPTED: _____

REVISED: 10/2020

SUPERSEDES: 09/2019

CHECKED BY: JTG

SCALE: NTS



REVISED BY: LWK/MLD

**CONCRETE DRIVEWAY
WITH INTEGRATED SWALE INLET**

 **ENGINEERING SERVICES**
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-104B

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MAXIMUM RAMP RUNNING SLOPE SHALL BE 8.3%.
3. MAXIMUM CROSS SLOPE AND RUNNING SLOPE ON LANDING SHALL BE 2%.
4. MAXIMUM FLARE SLOPE SHALL BE 10% MEASURED PARALLEL TO THE CURB, HOWEVER FLARE LENGTH (F) IS NOT REQUIRED TO EXCEED RAMP LENGTH (L).
5. BOTH FLARES SHALL BE THE SAME LENGTH FOR RAMP SYMMETRY.
6. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
7. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
8. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
9. SEE STANDARD PLANS F-102, F-102A, F-106, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
10. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
11. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK




F-105 NOTES

ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON


STANDARD
PLAN No.
F-105

PLAN VIEW

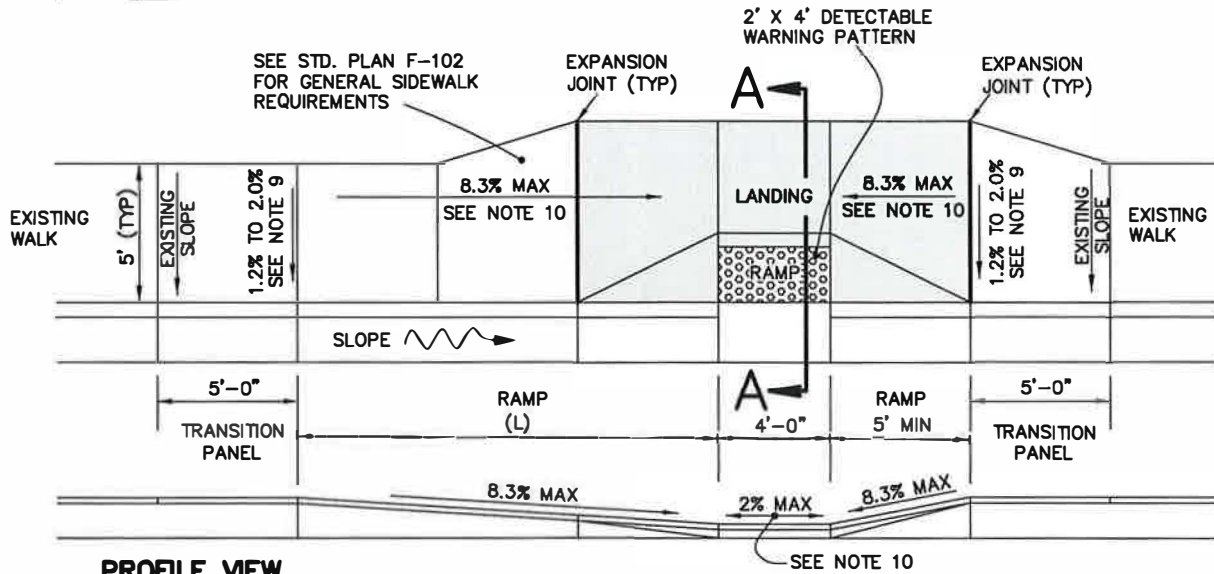


PROFILE VIEW

NO LIP, SEE F-106B FOR TOP OF CURB SLOPES AT RAMPS

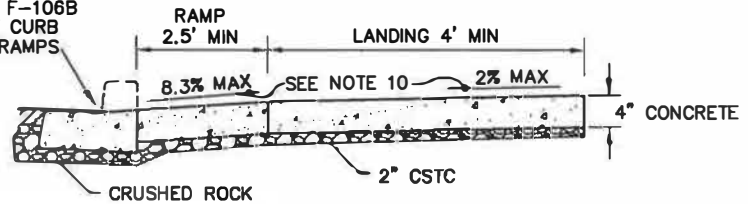

SECTION A-A

PLAN VIEW

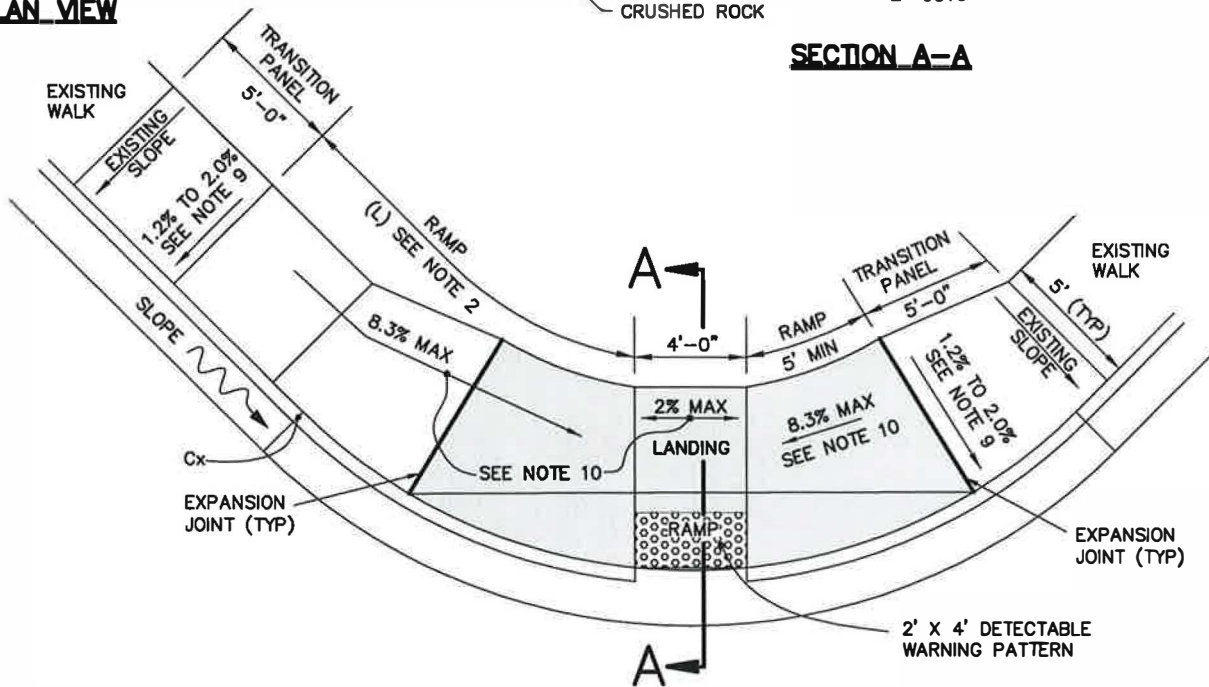

$$L = \frac{Cx - 0.2}{.083 - S}$$

L = RAMP LENGTH (FT)
Cx = CURB EXPOSURE (FT)
S = GUTTER SLOPE

W/ .5' EXISTING CURB EXPOSURE

L = 5' UP TO .023 SLOPE
L = 10' UP TO .053 SLOPE
L = 15' ABOVE .053 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

[Signature]
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.
[Signature]
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK

CURB RAMP TYPE-2 PREFERRED



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-105A

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 5 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 5 FT. TO 10 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM CROSS SLOPE AND RUNNING SLOPE ON LANDING SHALL BE 2%.
4. JOINTS FOR RAMPS AND LANDINGS SHALL FORM RECTANGLES. ALL OTHER JOINTS LOCATED BETWEEN CURB RETURNS SHALL BE ORIENTED RADIALLY.
5. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
6. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
7. TRANSITION PANELS REQUIRED WHEN EXISTING CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2% OR WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE WIDTH OF THE IMPROVEMENTS.
8. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
10. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK




F-105A NOTES

ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON


STANDARD
PLAN No.
F-105A

PLAN VIEW

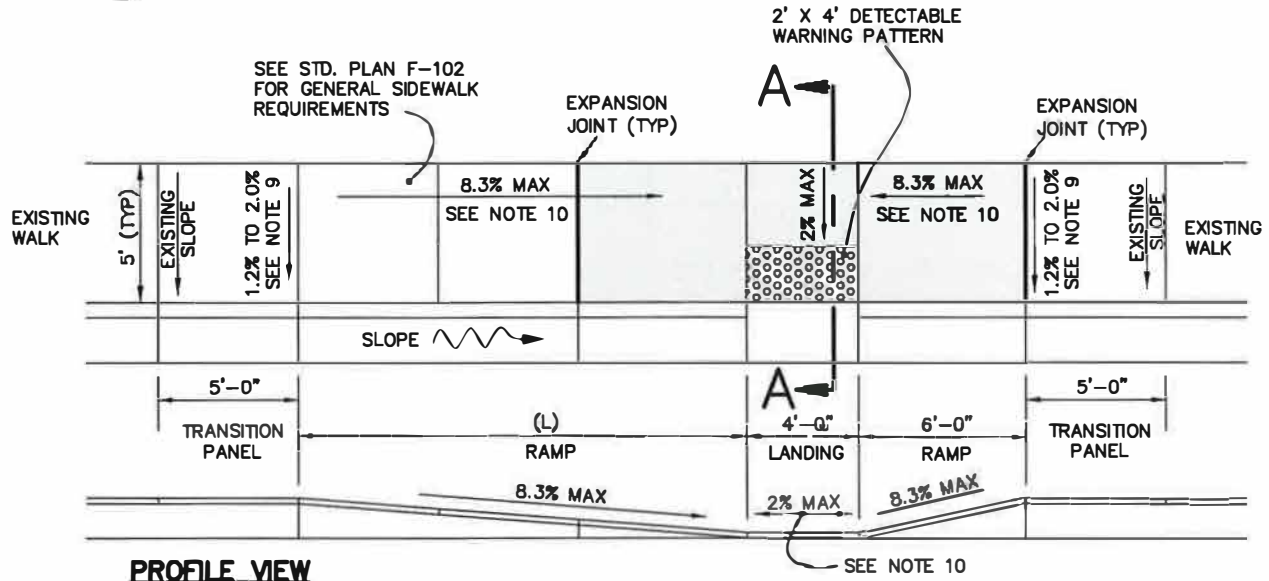


PROFILE VIEW

NO LIP, SEE F-106B FOR TOP OF CURB SLOPES AT RAMPS

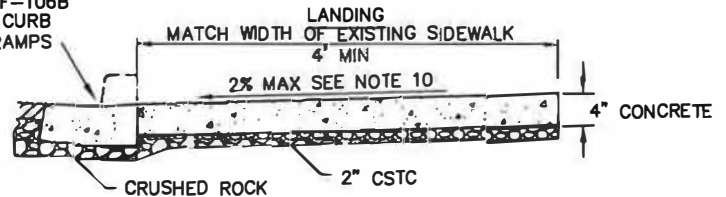

SECTION A-A

PLAN VIEW

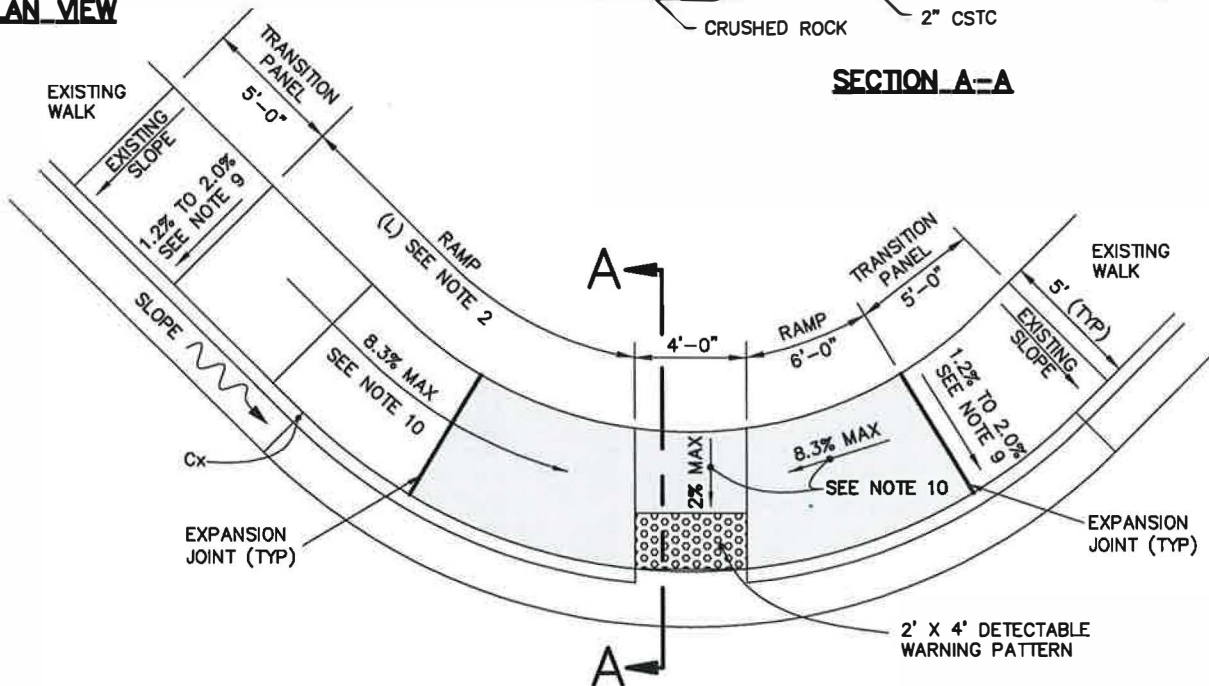

$$L = \frac{Cx}{.083 - S}$$

L = RAMP LENGTH (FT)
Cx = CURB EXPOSURE (FT)
S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE
L = 11' UP TO .037 SLOPE
L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.




ADOPTED: 08/1991
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK

CURB RAMP TYPE-2
RESTRICTED R.O.W.


ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-105B

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE ON LANDING SHALL BE 2% IN ANY DIRECTION.
4. JOINTS FOR RAMPS AND LANDINGS SHALL FORM RECTANGLES. ALL OTHER JOINTS LOCATED BETWEEN CURB RETURNS SHALL BE ORIENTED RADially.
5. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
6. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
7. TRANSITION PANELS REQUIRED WHEN EXISTING CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2% OR WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE WIDTH OF THE IMPROVEMENTS.
8. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
10. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 08/1991 REVISED: 04/2013 SUPERSEDES: 04/2012		F-105B NOTES	
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		CHECKED BY: JTG SCALE: NTS REVISED BY: LWK			
				ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON	STANDARD PLAN No. F-105B

PLAN VIEW

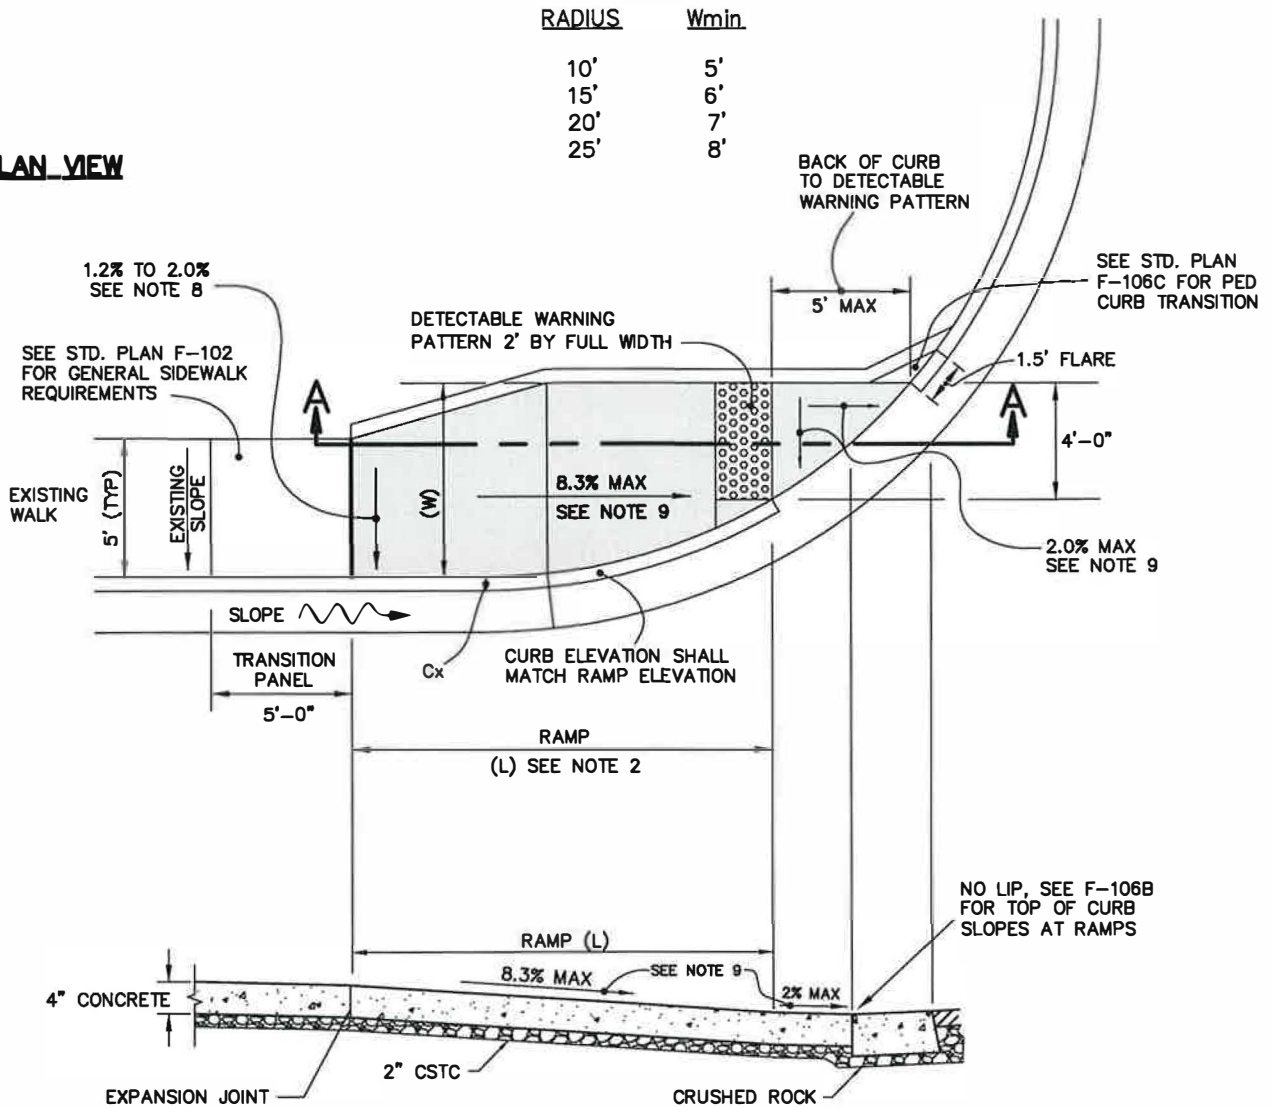

SECTION A-A

$$L = \frac{C_x}{.083 - S}$$

L = RAMP LENGTH (FT)
 Cx = CURB EXPOSURE (FT)
 S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE
 L = 11' UP TO .037 SLOPE
 L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
 REVISED: 04/2013
 SUPERSEDES: 04/2012
 CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK




**CURB RAMP TYPE-3
 ADJACENT SIDEWALK**




ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

STANDARD
 PLAN No.
F-105C

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE AT BASE OF RAMP SHALL BE 2% IN ANY DIRECTION.
4. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
5. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
6. TRANSITION PANELS ARE REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
7. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
8. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
9. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

 APPROVED BY DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 08/1991 REVISED: 04/2013 SUPERSEDES: 04/2012		F-105C NOTES		
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		CHECKED BY: JTG SCALE: NTS REVISED BY: LWK		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON		STANDARD PLAN No. F-105C

PLAN VIEW

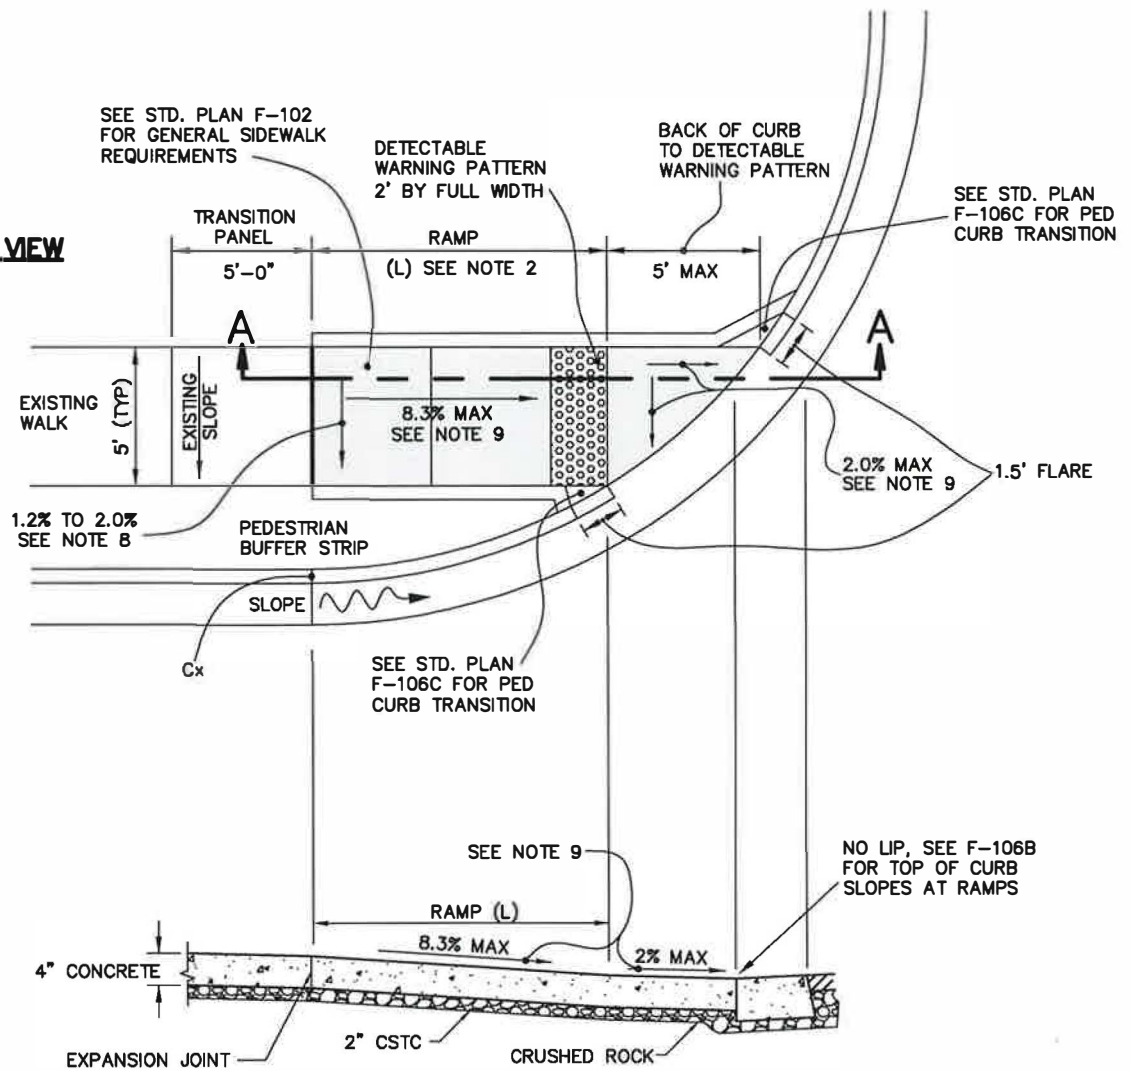

SECTION A-A

L = Cx
 $\frac{.083 - S}{.003 - S}$

L = RAMP LENGTH (FT)
 Cx = CURB EXPOSURE (FT)
 S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE
 L = 11' UP TO .037 SLOPE
 L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
 REVISED: 04/2013
 SUPERSEDES: 04/2012

CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK

**CURB RAMP TYPE-3
 SEPARATED SIDEWALK**



ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

STANDARD
 PLAN No.
F-105D

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE AT BASE OF RAMP SHALL BE 2% IN ANY DIRECTION.
4. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
5. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
6. TRANSITION PANELS ARE REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
7. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
8. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
9. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 08/1991
REVISED: 04/2013
SUPERSEDES: 04/2012
CHECKED BY: JTG
SCALE: NTS
REVISED BY: LWK

F-105D NOTES




ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-105D

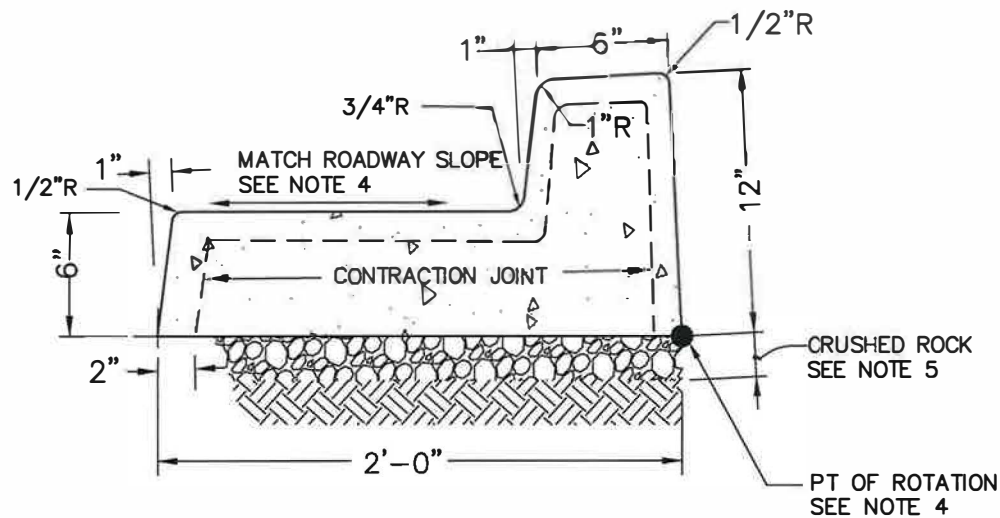

CONCRETE CURB/GUTTER

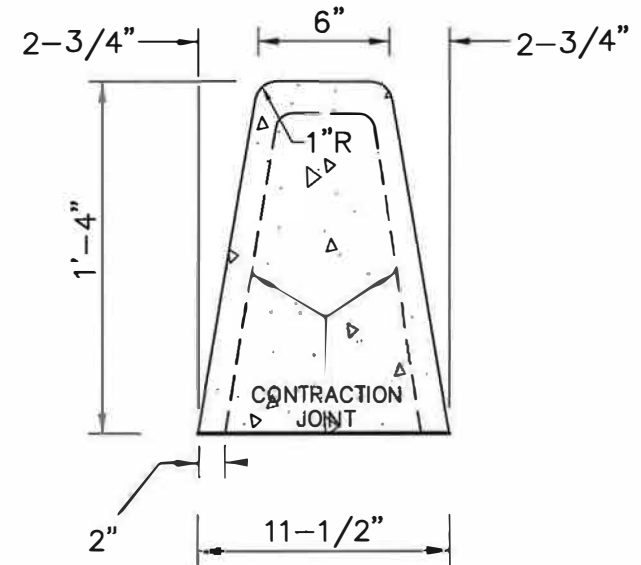


CONCRETE CURB

NOTES:

1. CONCRETE CURB & CURB/GUTTER SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. EXPANSION JOINTS SHALL USE A 3/8" PREMOLDED JOINT FILLER. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE CURB OR CURB/GUTTER & PLACED BETWEEN EXISTING & NEW CONCRETE WHERE SIDEWALKS, DRIVEWAYS, CURB, & CURB/GUTTER ARE REMOVED FOR NEW CONSTRUCTION.
3. CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH SPACED AT MAX. 15'-0" O.C.
4. THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ROADWAY. THEREFORE, THE CURB/GUTTER SHALL BE ROTATED ACCORDINGLY.
5. PROVIDE COMPACTED CRUSHED ROCK UNDERNEATH CURB/GUTTER TO THE LIMITS SHOWN ON STD PLAN W-102.
6. SEE STD PLAN F-106B FOR CURB AND CURB/GUTTER DETAILS AT CURB RAMPS AND DRIVEWAYS.

APPROVED BY	
	
DIRECTOR, ENGINEERING SERVICES	PERRY M. TAYLOR, P.E.
	
PRINCIPAL ENGINEER, CONST.	KENNETH M. BROWN, P.E.

ADOPTED: 2/1990
REVISED: 04/2012
SUPERSEDES: 01/2009
CHECKED BY: SJS
SCALE: NTS
REVISED BY: DSH

CONCRETE CURB AND CURB / GUTTER	
	ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON
STANDARD PLAN No. F-106	

#4 @ 18" O.C.
#5 W/ 18" MIN LAP (TYP)

HMA

1" COVER

3'-0"

1'-6"

2"

6" MIN




3" MIN


10" (TYP)

3"


HMA-THICKNESS VARIES

CRUSHED ROCK THICKNESS VARIES. SEE NOTE 5


APPROVED BY  DIRECTOR, ENGINEERING SERVICES P. MIKE TAYLOR, P.E.		ADOPTED: 09/2010 REVISED: 04/2012 SUPERSEDES: _____ CHECKED BY: JAG SCALE: NTS DWG./REV. BY: MBM/SRM		CONCRETE "V" GUTTERS	
 PRINCIPAL ENGINEER, DESIGN GARY S. NELSON, P.E.				ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON	
				STANDARD PLAN No. F-106A	

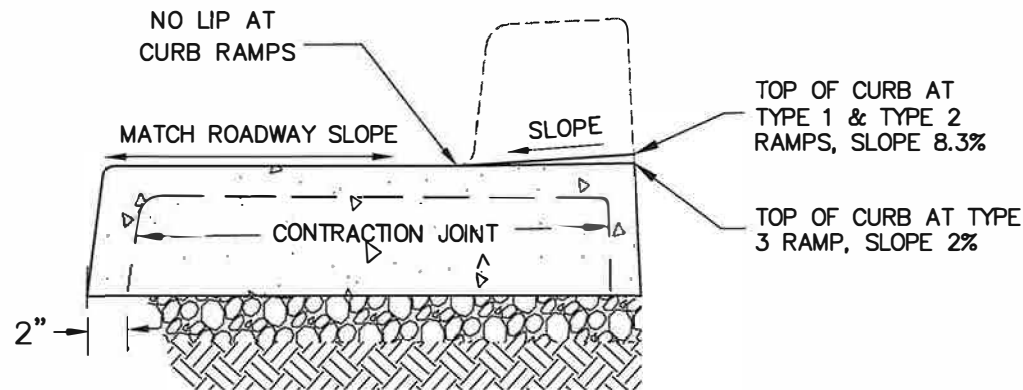


CONCRETE CURB/GUTTER @ CURB RAMP

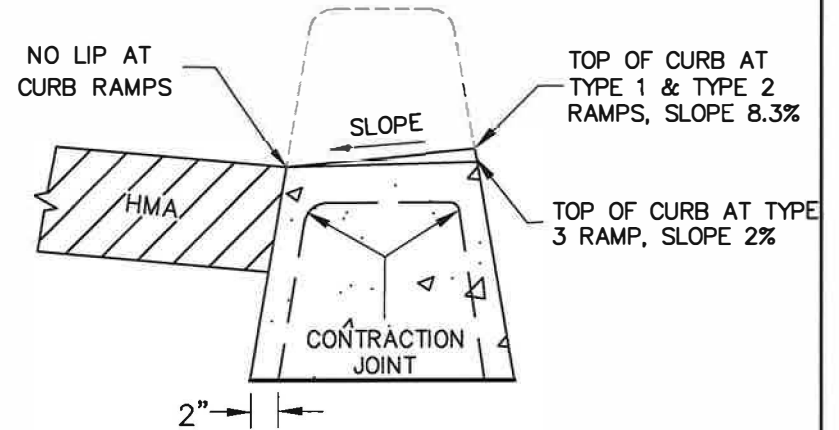

CONCRETE CURB @ CURB RAMP

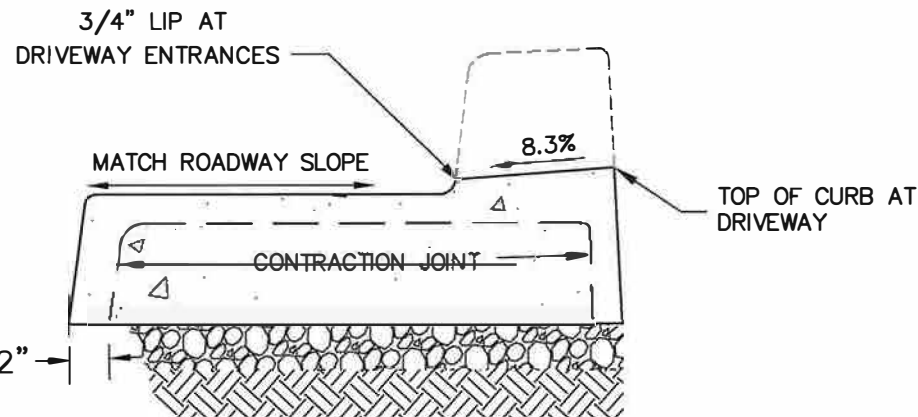

CONCRETE CURB/GUTTER @ DRIVEWAY

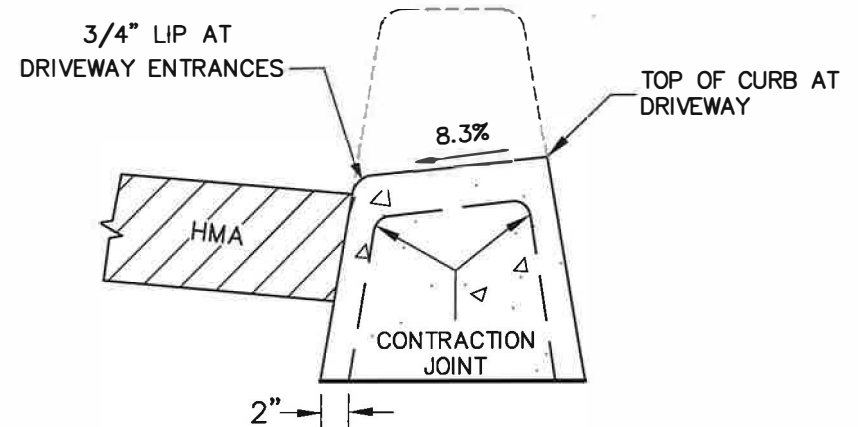

CONCRETE CURB @ DRIVEWAY

NOTES:

1. CONCRETE CURB & CURB/GUTTER SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.


APPROVED BY	
	PERRY M. TAYLOR, P.E.
DIRECTOR, ENGINEERING SERVICES	
	KENNETH M. BROWN, P.E.
PRINCIPAL ENGINEER, CONST.	

ADOPTED: 04/2012
REVISED:
SUPERSEDES:
CHECKED BY: SJS
SCALE: NTS
REVISED BY: DSH


**CURB AND CURB/GUTTER @
CURB RAMPS AND DRIVEWAYS**

**ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON**

**STANDARD
PLAN No.
F-106B**

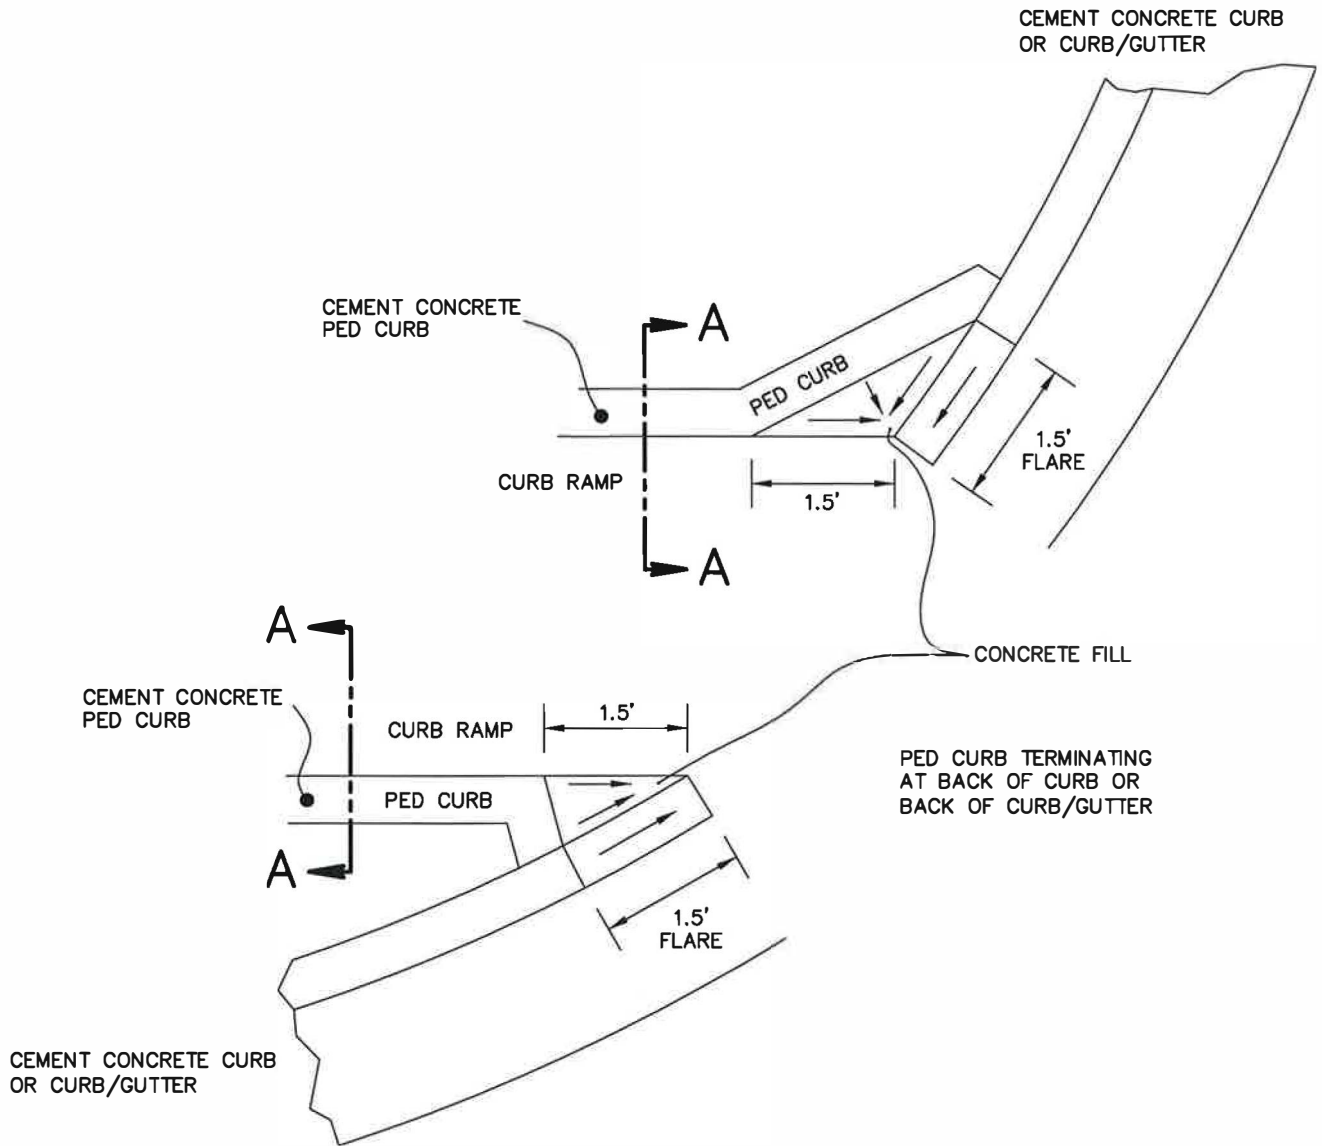

SECTION VIEW

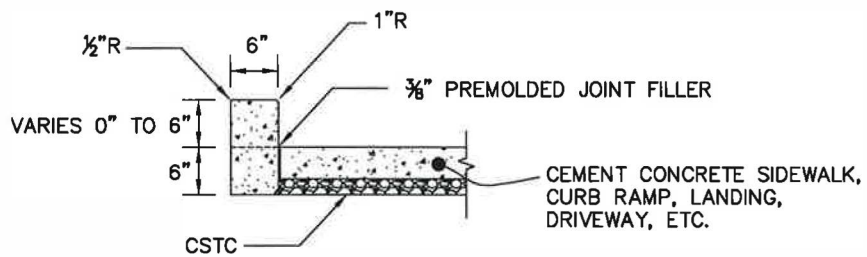

SECTION A-A

APPROVED BY

 DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.


 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991
 REVISED: 04/2013
 SUPERSEDES: 04/2012
 CHECKED BY: JTG
 SCALE: NTS
 REVISED BY: LWK

CEMENT CONCRETE PED CURB

ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON


STANDARD
 PLAN No.
 F-106C

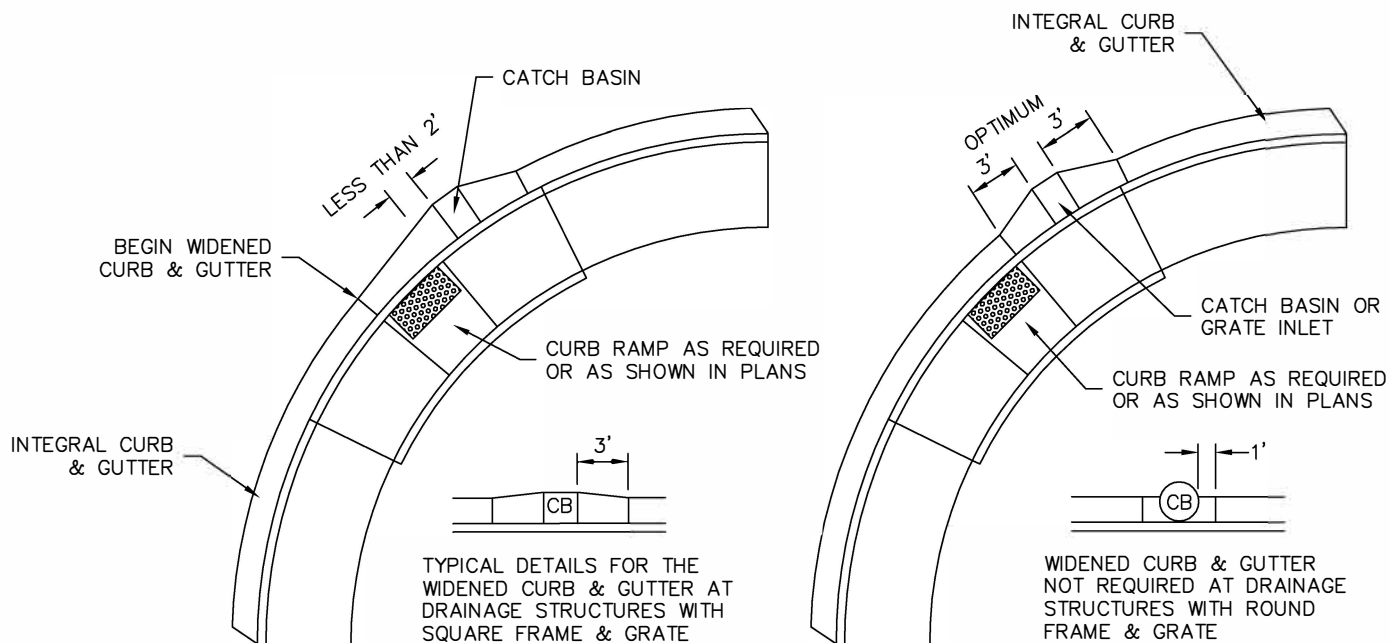

NOTES


1. DRAINAGE STRUCTURES SHALL NOT BE INSTALLED WITHIN THE LANDING AREA OF CURB RAMPS. ROTATION OF RAMP MAY BE REQUIRED.
2. WIDENED CURB & GUTTER SHALL TERMINATE AT CONTROL JOINTS.
3. WHERE CURB REMOVED FOR RAMP INSTALLATION, REPLACEMENT CURB SHALL BE CURB/GUTTER, MATCHING ADJACENT CURB EXPOSURE MAY REQUIRE MANUAL FORMING OF CURB/GUTTER.

APPROVED BY ENGINEERING OPERATIONS MANAGER KYLE TWOHIG		ADOPTED: 03/2018 REVISED: _____ SUPERSEDES: _____ CHECKED BY: JAG SCALE: NTS REVISED BY: INT		CURB/GUTTER AT DRAINAGE STRUCTURE	
 CITY ENGINEER DANIEL ALBERT BULLER, P.E.				ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON	
				STANDARD PLAN NO. F-106D	

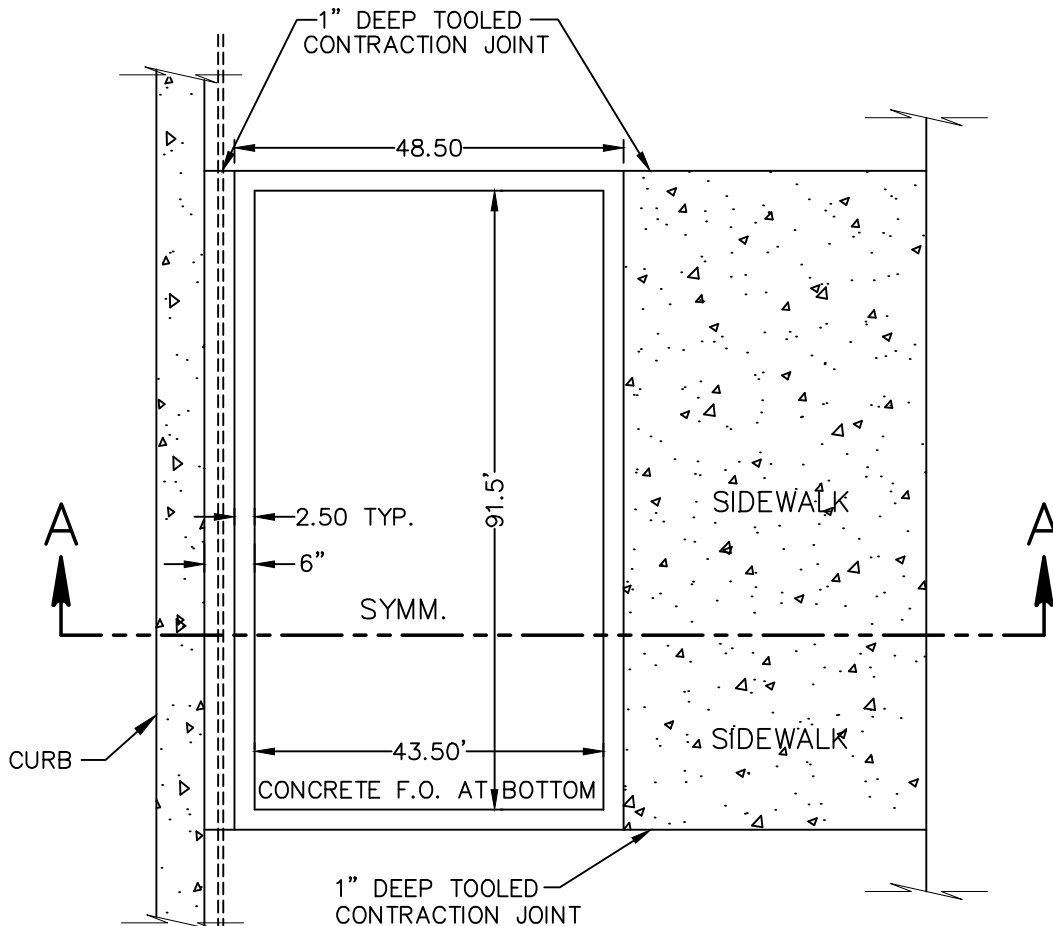


PLAN

2 - #4 REBAR
LENGTH= TREE WELL + 4
FEET, PLACE IN SIDEWALK
STRIP CENTERED ON TREE
WELL

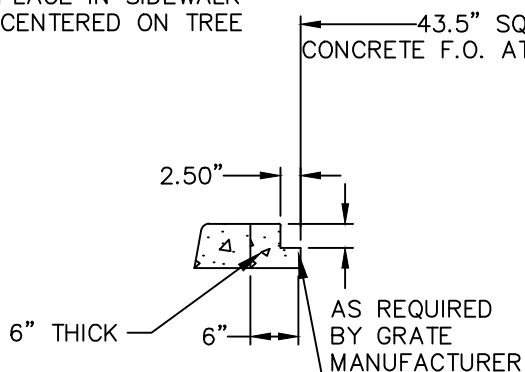

SECTION A-A

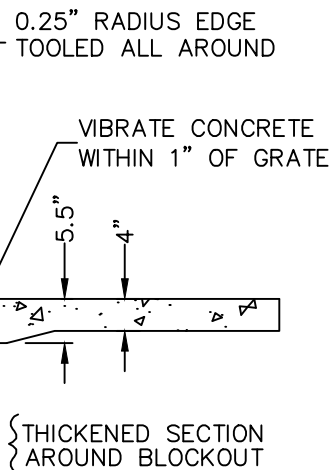


IMPORTANT !
APPLY PARTING
COMPOUND TO ALL
SURFACES OF OPENING
PRIOR TO POURING THE
CONCRETE FILL.

NOTE:

THE GRATE UNIT FOR THE TREE WELL SHALL CONSIST OF 4-GRATE SECTIONS. EACH GRATE SECTION SHALL MEASURE 24"X48"X1-1/4" AND BE CONSTRUCTED OF GRAY CAST IRON, CLASS 30 W/ A MINIMUM WEIGHT OF 150 LBS/SECTION OR 300 LBS/UNIT. EQUAL OR BETTER CORROSION RESISTANCE MATERIAL MAY BE SUBSTITUTED UPON PRIOR APPROVAL OF THE ENGINEER.

APPROVED BY

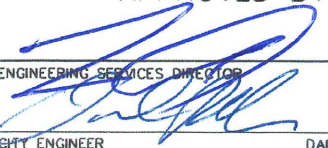
ENGINEERING SERVICES DIRECTOR
KYLE TWOHIG
CITY ENGINEER
DAN BULLER, P.E.


ADOPTED: _____
REVISED: 10/2019
SUPERSEDES: 04/2018
CHECKED BY: JAG
SCALE: NTS
REVISED BY: DCB/MLD

**TREE WELL BLOCKOUT
FOR 4' X 8' METAL GRATE**



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-107

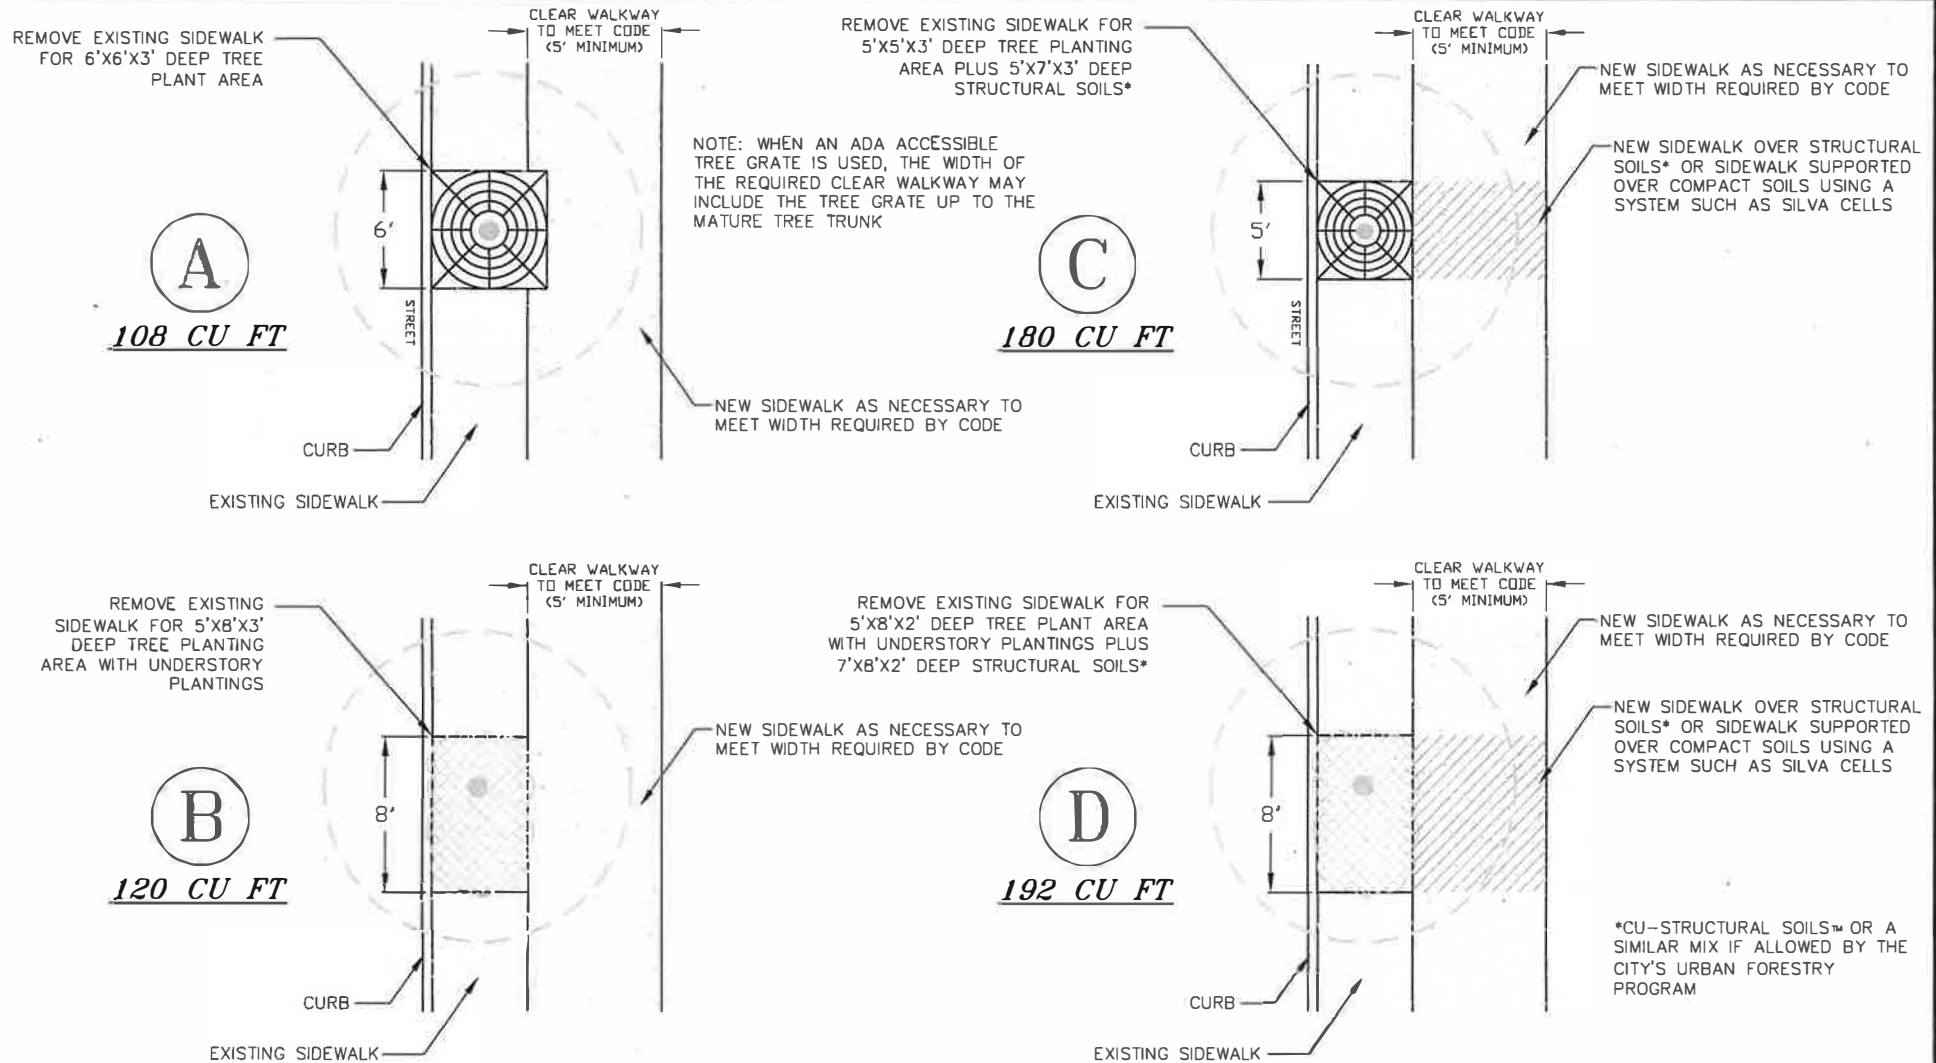

EXISTING SIDEWALK RETROFIT - POSSIBLE OPTIONS TO PROVIDE 100 CU FT OF UNCOMPACTED SOIL FOR STREET TREES.

SOIL IS THE KEY FACTOR FOR TREE HEALTH, BUT IN AN URBAN SETTING IT'S ALMOST IMPOSSIBLE TO PROVIDE IDEAL SOIL VOLUMES. THE CITY OF SPOKANE HIGHLY ENCOURAGES BUILDING PERMIT APPLICANTS TO CONSIDER PROVIDING AS MUCH UNCOMPACTED SOIL AS POSSIBLE FOR TREES, AND REQUIRES AT LEAST 100 CU FT (MAX 3' DEPTH MAY BE FACTORED INTO VOLUME). A PERMIT IS NECESSARY TO PLANT A TREE IN PUBLIC RIGHT OF WAY; PLEASE CONTACT THE URBAN FORESTRY PROGRAM AT (509) 363-5470. COURTESY OF THE URBAN DESIGN SECTION OF THE PLANNING SERVICES DEPARTMENT.

APPROVED BY

[Signature]

DIRECTOR, ENGINEERING SERVICES P. MIKE TAYLOR, P.E.

[Signature]

PRINCIPAL ENGINEER, DESIGN GARY S. NELSON, P.E.

ADOPTED: 09/2010

REVISED: _____

SUPERSEDES: _____

CHECKED BY: JAG

SCALE: NTS

DWG/REV. BY: MBM

**EXISTING SIDEWALK RETROFIT
OPTIONS FOR STREET TREE INSTALLATION**




ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-107A

2" TRIANGLE, 1/4" DEPTH
STAMPED INTO TROWELED
EDGE OF WALK, BOTH
SIDES OF SIDEWALK

2" MIN PVC SLEEVE EXTENDED
6" OUTSIDE SIDEWALK
NOTE: SLEEVES CAN BE
LOCATED AS REQUIRED

PLACE PVC CAP
OVER EACH END
OF SLEEVE (TYP)

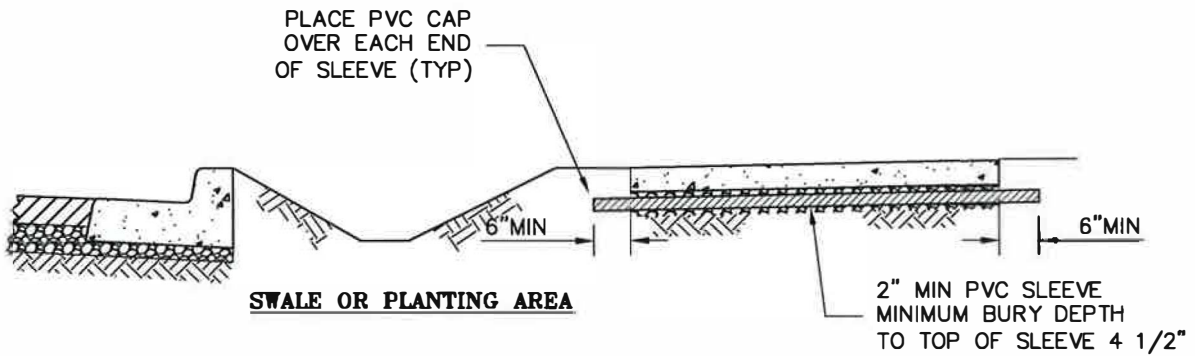

NOTES:

1. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
2. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR SIDEWALK WIDTH REQUIREMENTS.
3. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR PEDESTRIAN BUFFER STRIP WIDTH REQUIREMENTS
4. SEE STD PLAN B-102F FOR BIO-INFILTRATION SWALE REQUIREMENTS.

APPROVED BY


KYLE TWOHIG
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 07/2014

REVISED:

SUPERSEDES:

CHECKED BY: DAB

SCALE: NTS





REVISED BY: RJS/LWK

MARKING IRRIGATION SLEEVES



ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-107B

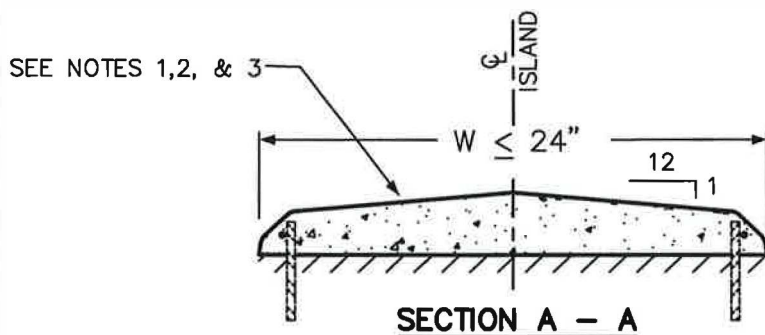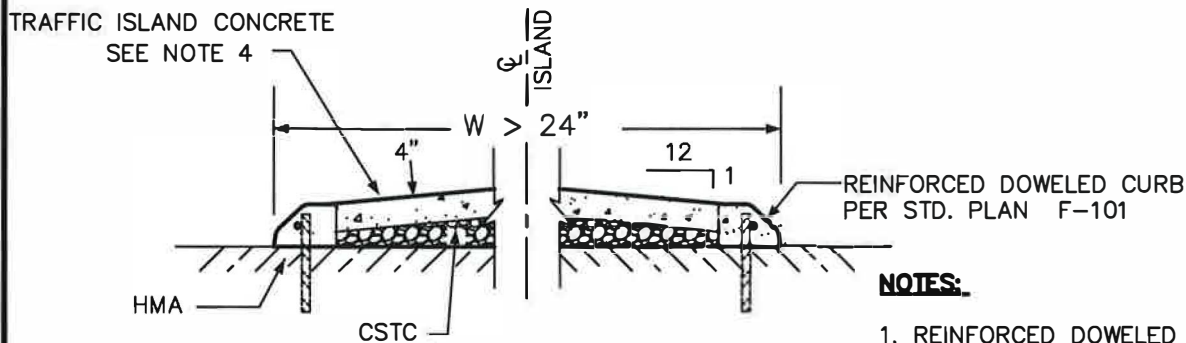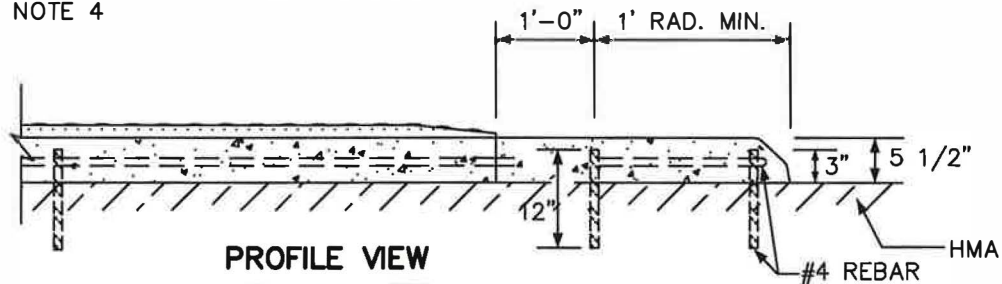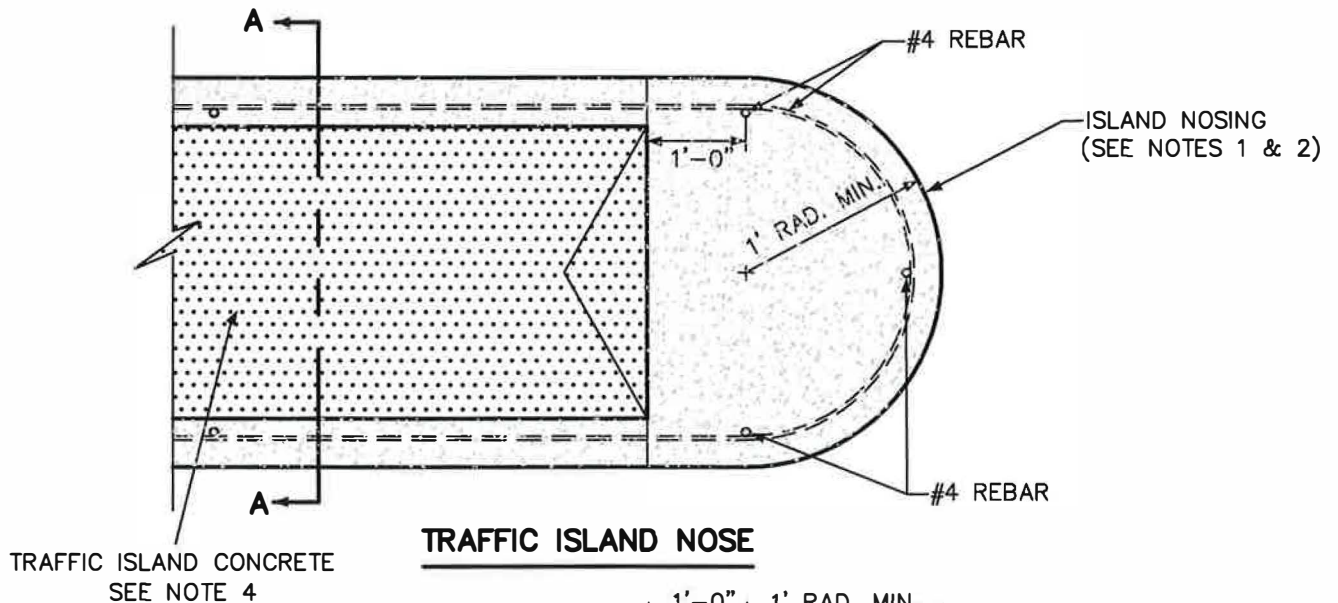

NOTES:

1. REINFORCED DOWELED CURB & ISLAND NOSINGS SHALL BE CONSTRUCTED W/ AIR ENTRAINED CONCRETE, CLASS 4000 W/ A BROOM FINISH.
2. TRAFFIC ISLANDS WITH WIDTHS < 24" REQUIRE APPROVAL BY THE CITY ENGINEER
3. TRAFFIC ISLANDS WITH WIDTHS ≤ 24" SHALL BE CONSTRUCTED AS A SOLID UNIT USING AIR-ENTRAINED CLASS 4000 CONCRETE W/ A BROOM FINISH.
4. TRAFFIC ISLAND CONCRETE SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE W/ A BROOM FINISH

APPROVED BY

[Signature]

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

[Signature]

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 6/1992

REVISED: 04/2012

SUPERSEDES: 05/2007

CHECKED BY: SJS

SCALE: NTS


REVISED BY: DSH

TRAFFIC ISLAND




ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON

STANDARD
PLAN No.
F-108

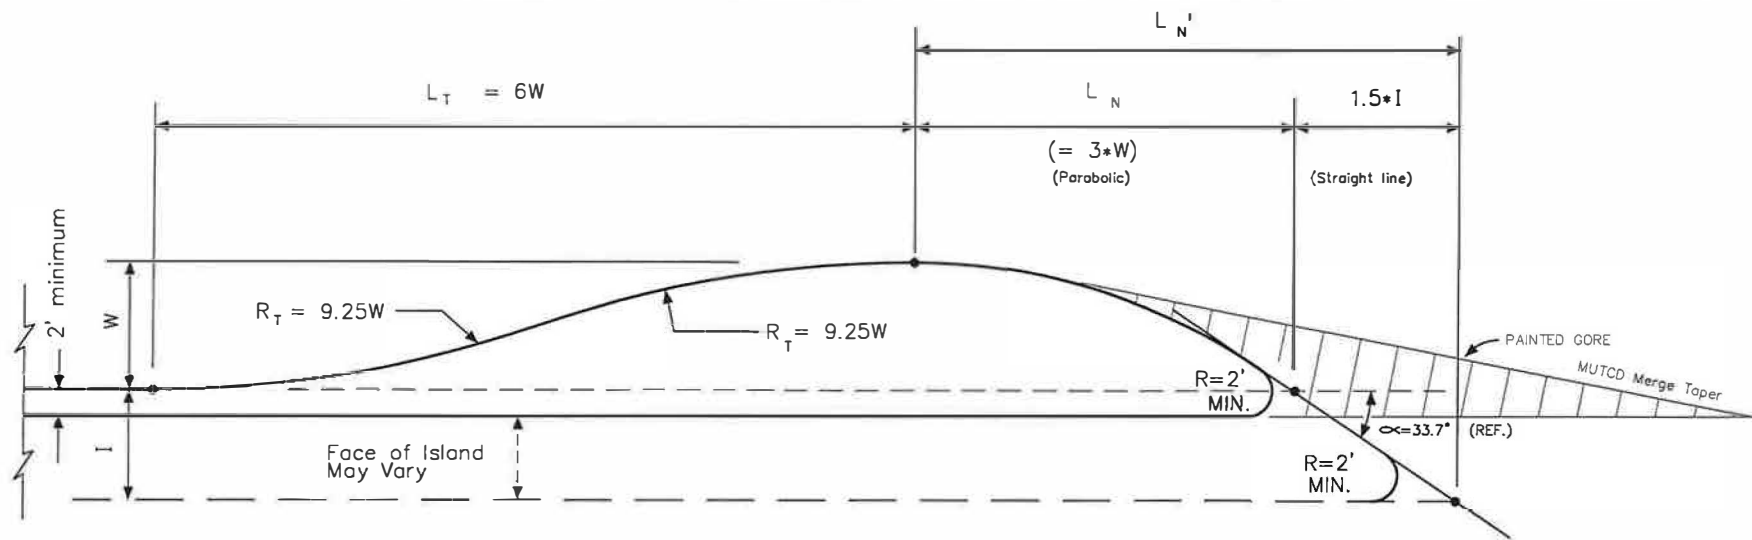


Type "A" (Shape is NOT a function of speed)

Type "B" (Shape is a function of speed, < 40 MPH)

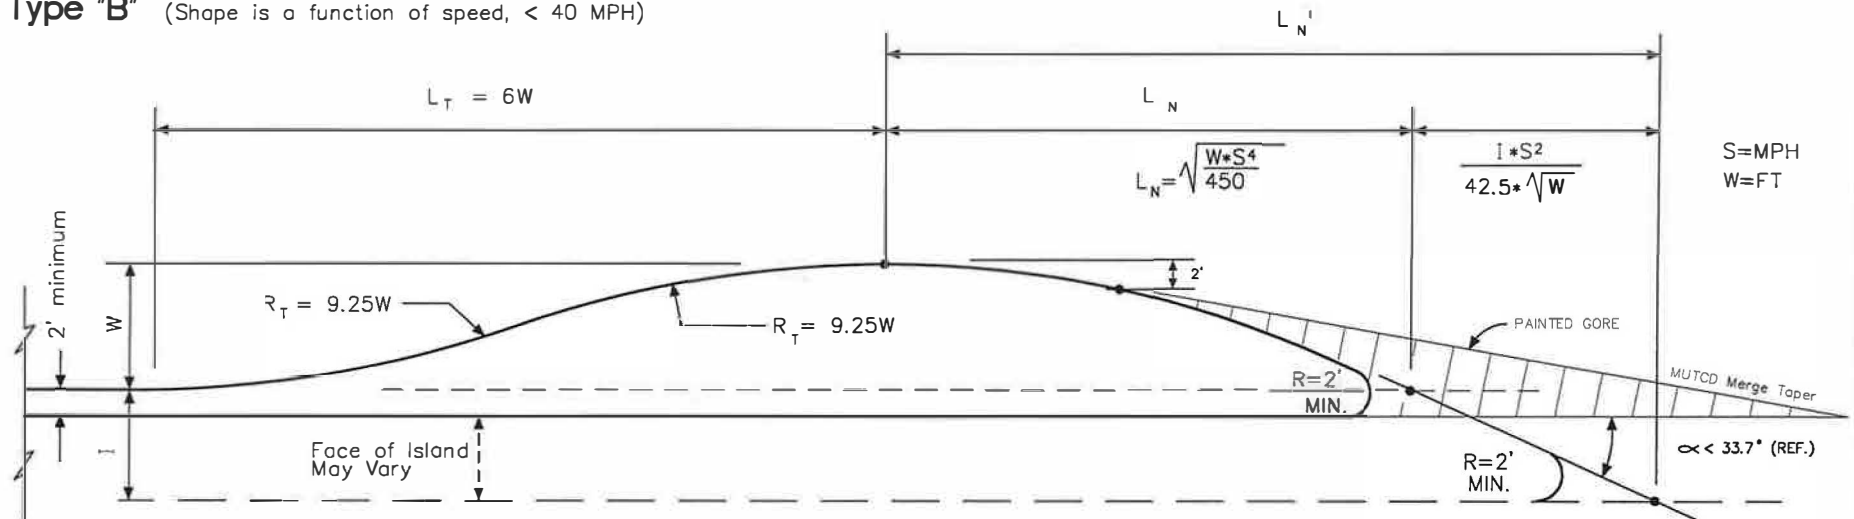

APPROVED BY


 CITY ENGINEER _____ BRAD BLEGEN, P.E.


 SUPERVISORY ENGINEER, DESIGN _____ LARRY NEEL, P.E.

SCALE NONE

ADOPTED 3/94


REVISÉD _____

SUPERSEDES _____

TRAFFIC ISLAND POCKET AND NOSING PARAMETERS




DEPT. OF PUBLIC WORKS
ENGR. DIVISION SPOKANE, WA

STANDARD
PLAN No.
F-108A

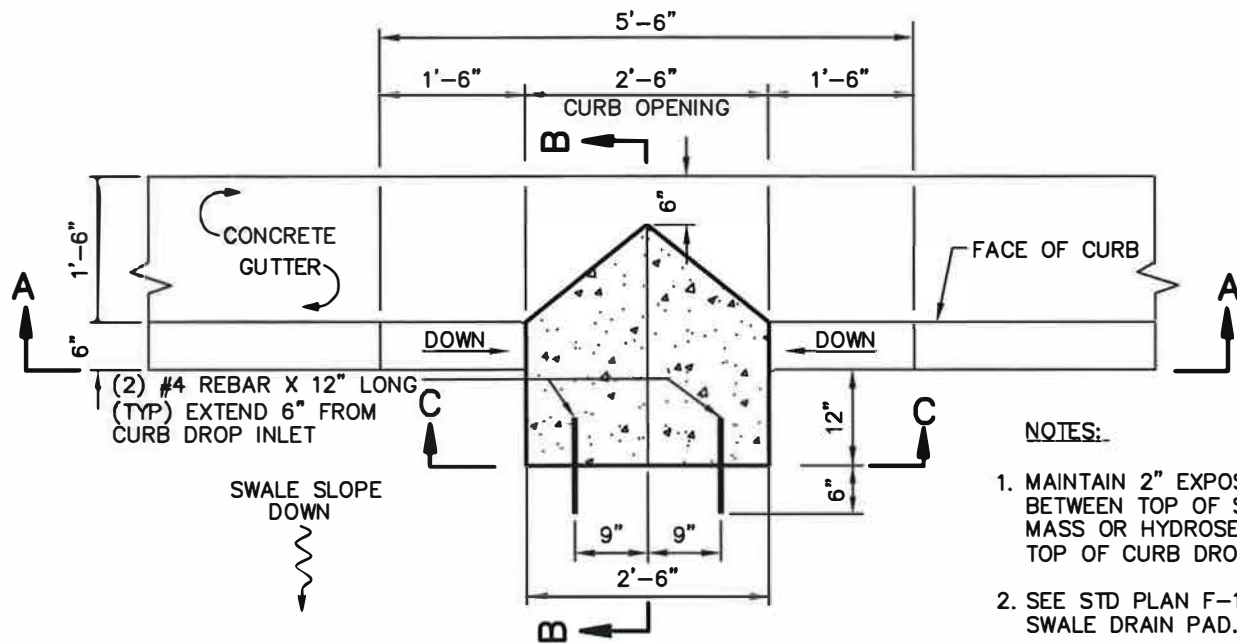

NOTES:

1. MAINTAIN 2" EXPOSURE BETWEEN TOP OF SOD ROOT MASS OR HYDROSEED & TOP OF CURB DROP INLET.
2. SEE STD PLAN F-110 FOR SWALE DRAIN PAD.
3. SEE STD PLAN B-102F FOR DRYWELL IN SWALE REQ'MTS.
4. CURB DROP INLETS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE IN ACCORDANCE W/ SEC 6-02.3(2)B

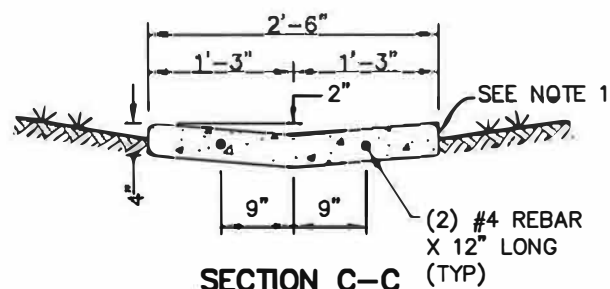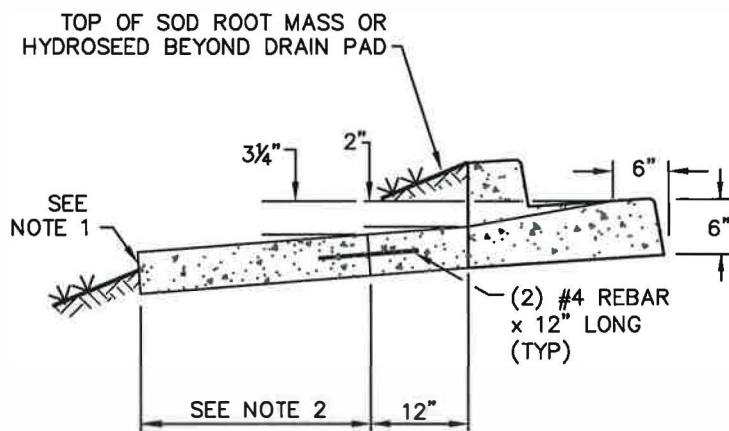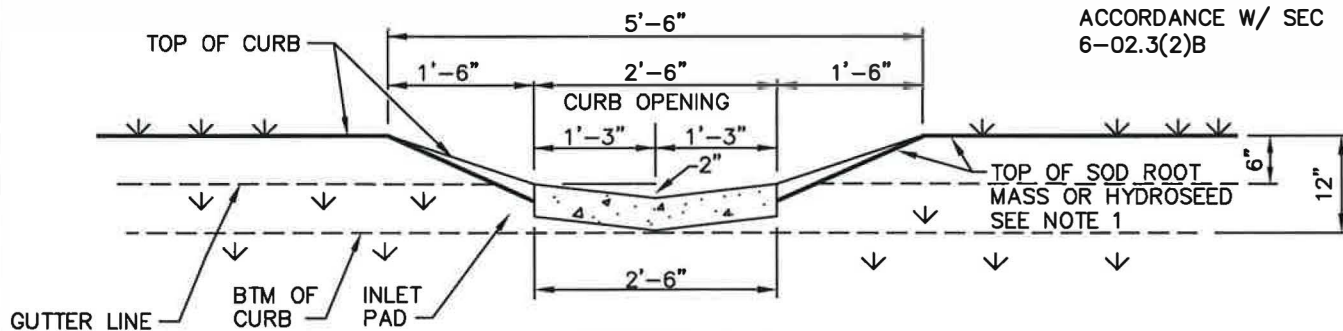

APPROVED BY


DIRECTOR, ENGINEERING SERVICES
PERRY M. TAYLOR, P.E.
PRINCIPAL ENGINEER, CONST.
KENNETH M. BROWN, P.E.

ADOPTED: 06/1993
REVISED: 04/2012
SUPERSEDES: 09/2010
CHECKED BY: SJS
SCALE: NTS
REVISED BY: DSH

CURB DROP INLET

ENGINEERING SERVICES
CITY OF SPOKANE, WASHINGTON


STANDARD
PLAN NO.
F-109

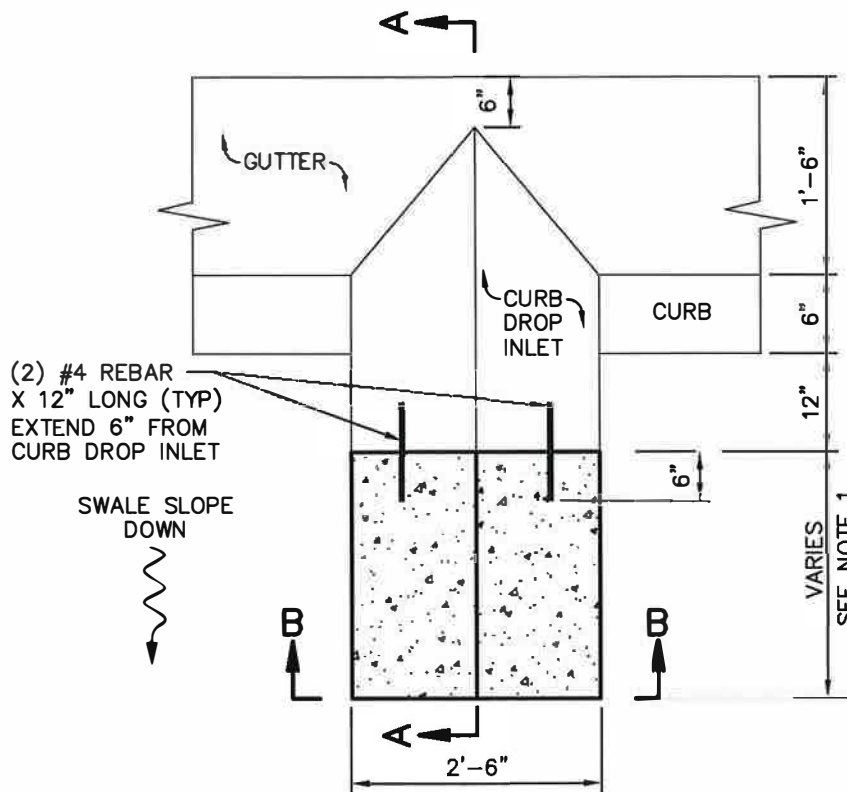


PLAN VIEW

NOTES:

1. IF NECESSARY, ADD A SWALE DRAIN PAD TO EXTEND TO 12" FROM BTM OF SWALE.
2. MAINTAIN 2" EXPOSURE BETWEEN TOP OF SOD ROOT MASS OR HYDROSEED & TOP OF SWALE DRAIN PAD.
3. SEE STD PLAN F-109 FOR CURB DROP INLET.
4. SEE STD PLAN B-102F FOR SWALE REQ'MTS.
5. SWALE DRAIN PADS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE IN ACCORDANCE W/ SEC 6-02.3(2)B

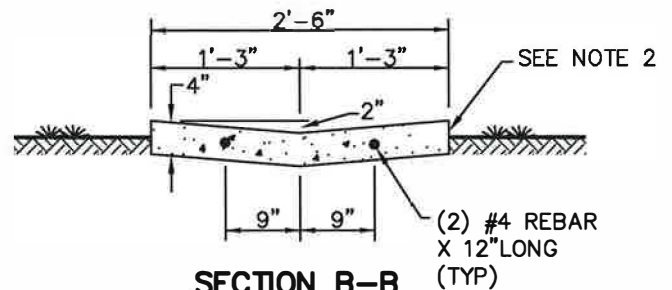

SECTION B-B

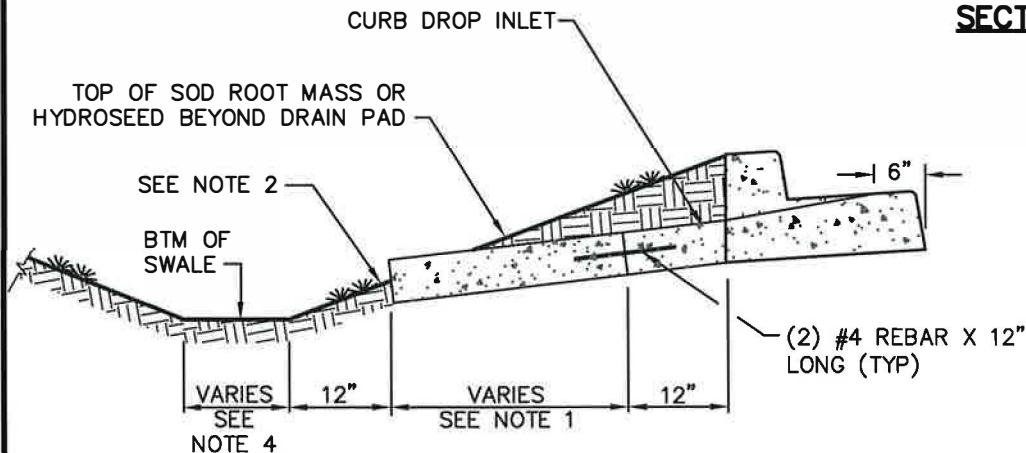

SECTION A-A

APPROVED BY

 DIRECTOR, ENGINEERING SERVICES PERRY, M. TAYLOR, P.E.
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 07/2002
 REVISED: 04/2012
 SUPERSEDES: 09/2010
 CHECKED BY: SJS
 SCALE: NTS
 REVISED BY: DSH

SWALE DRAIN PAD



ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

STANDARD
 PLAN No.
 F-110

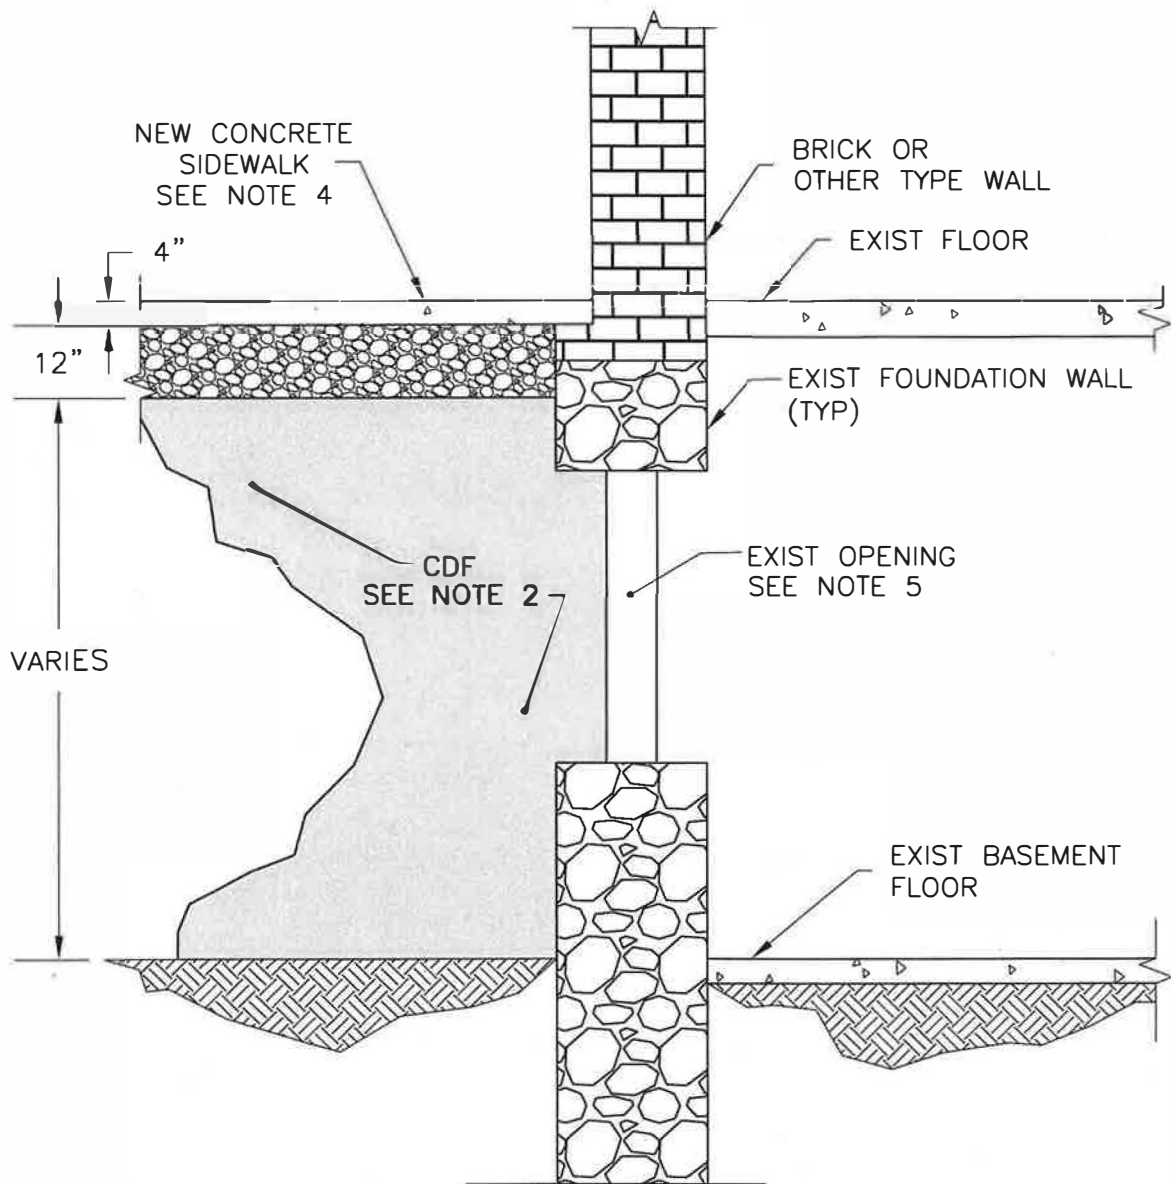

NOTES:

1. ALL UNDERGROUND UTILITIES SHALL BE LOCATED, VERIFIED FOR BEING ACTIVE OR INACTIVE, & DETERMINED FOR EITHER REMOVAL, RELOCATION, OR REROUTING PRIOR TO VAULT RECONSTRUCTION.
2. FILL VOID BENEATH VAULTED SIDEWALK TO UNDERSIDE OF CSTC W/ MACHINE EXCAVATABLE CDF PER SECTION 2-09.3(1)E, 150-200 PSI. ALTERNATIVE FILLS IN LIEU OF CDF SHALL BE PRE-APPROVED BY THE ENGINEER PRIOR TO PLACEMENT. STANDARD PLAN DEPICTS THE ENTIRE SIDEWALK VOID TO BE FILLED.
3. PLACE 12-INCHES OF CSTC IN TWO 6-INCH LIFTS, COMPACTED TO 95% MAX DENSITY. CSTC PER SECTION 4-04.2 & 9-03.9(3).
4. CONSTRUCT NEW CONCRETE SIDEWALK PER COS STD PLANS F102A & F-102B. USE 6-SACK, AIR-ENTRAINED COMMERCIAL CONCRETE PER SECTION 6-02.3(2)B.
5. ANY STRUCTURAL RE-INFORCEMENT OR MODIFICATIONS TO EXISTING FOUNDATION WALLS OR OPENINGS SHALL BE DESIGNED BY OTHERS AND APPROVED BY THE CITY OF SPOKANE

APPROVED BY

DIRECTOR, ENGINEERING SERVICES P. MIKE TAYLOR, P.E.
 GARY S. NELSON, P.E.

ADOPTED: 09/2010
 REVISED:
 SUPERSEDES:
 CHECKED BY: JAG
 SCALE: NTS
 DWG/REV. BY: RLB/SRM

VAULTED SIDEWALK ELIMINATION
 W/ CDF BACKFIL L

ENGINEERING SERVICES
 CITY OF SPOKANE, WASHINGTON

STANDARD
 PLAN No.
 F-111