


# TABLE OF CONTENTS

## CITY OF SPOKANE STANDARD PLANS – SECTION F

X-### = Revised Standard Plan  
 \*\*\*X-### = New Standard Plan

[Back to Main TOC](#)

<b><u>Plan No.</u></b>	<b><u>Plan Title</u></b>	<b><u>Current Plan Date</u></b>
F-101	<a href="#">Reinforced Doweled Curb</a>	4/12
F-102	<a href="#">Concrete Sidewalk</a>	4/13
F-102A	<a href="#">Integral Concrete Curb &amp; Sidewalk</a>	4/13
F-102B	<a href="#">Concrete Sidewalk Sections</a>	4/13
F-102C	<a href="#">Concrete Sidewalk Repairs – Ramping Over Tree Roots</a>	4/13
F-102D	<a href="#">Concrete Sidewalk Repairs – Diverting Around Tree Roots</a>	4/13
F-103	<a href="#">Concrete Driveway – Adjacent Sidewalk / Type 1</a>	4/13
F-103A	<a href="#">Concrete Driveway – Adjacent Sidewalk / Type 2</a>	4/13
F-103B	<a href="#">Concrete Driveway – Adjacent Sidewalk / Type 3</a>	4/13
F-104	<a href="#">Concrete Driveway – PED Buffer Strip Width &gt; 5 Ft.</a>	4/13
F-104A	<a href="#">Concrete Driveway – PED Buffer Strip Width &lt; 5 Ft.</a>	4/13
F-104B	<a href="#">Concrete Driveway w/ Integrated Swale Inlet</a>	4/22
F-105	<a href="#">Curb Ramp Type-1 (2 Sheets)</a>	4/13
F-105A	<a href="#">Curb Ramp Type-2, Preferred (2 Sheets)</a>	4/13
F-105B	<a href="#">Curb Ramp Type-2, Restricted ROW (2 Sheets)</a>	4/13
F-105C	<a href="#">Curb Ramp Type-3, Adjacent Sidewalk (2 Sheets)</a>	4/13
F-105D	<a href="#">Curb Ramp Type-3, Separated Sidewalk (2 Sheets)</a>	4/13
F-106	<a href="#">Concrete Curb and Curb / Gutter</a>	4/12
F-106A	<a href="#">Concrete “V” Gutters</a>	4/12
F-106B	<a href="#">Curb and Curb/Gutter @ Curb Ramps and Driveways</a>	4/12
F-106C	<a href="#">Cement Concrete PED Curb</a>	4/13
F-106D	<a href="#">Curb/Gutter</a>	4/25
F-107	<a href="#">Tree Well Blockout for 4' x 8' Metal Grate</a>	4/18
F-107A	<a href="#">Existing Sidewalk Retrofit; Options for Street Tree Installation</a>	9/10
F-107B	<a href="#">Marking Irrigation Sleeves</a>	7/14
F-108	<a href="#">Traffic Island</a>	4/12
F-108A	<a href="#">Traffic Island Pocket and Nosing Parameters</a>	3/94
F-109	<a href="#">Curb Drop Inlet</a>	4/22
F-110	<a href="#">Swale Drain Pad</a>	4/22
F-111	<a href="#">Vaulted Sidewalk Elimination w/ CDF Backfill</a>	9/10

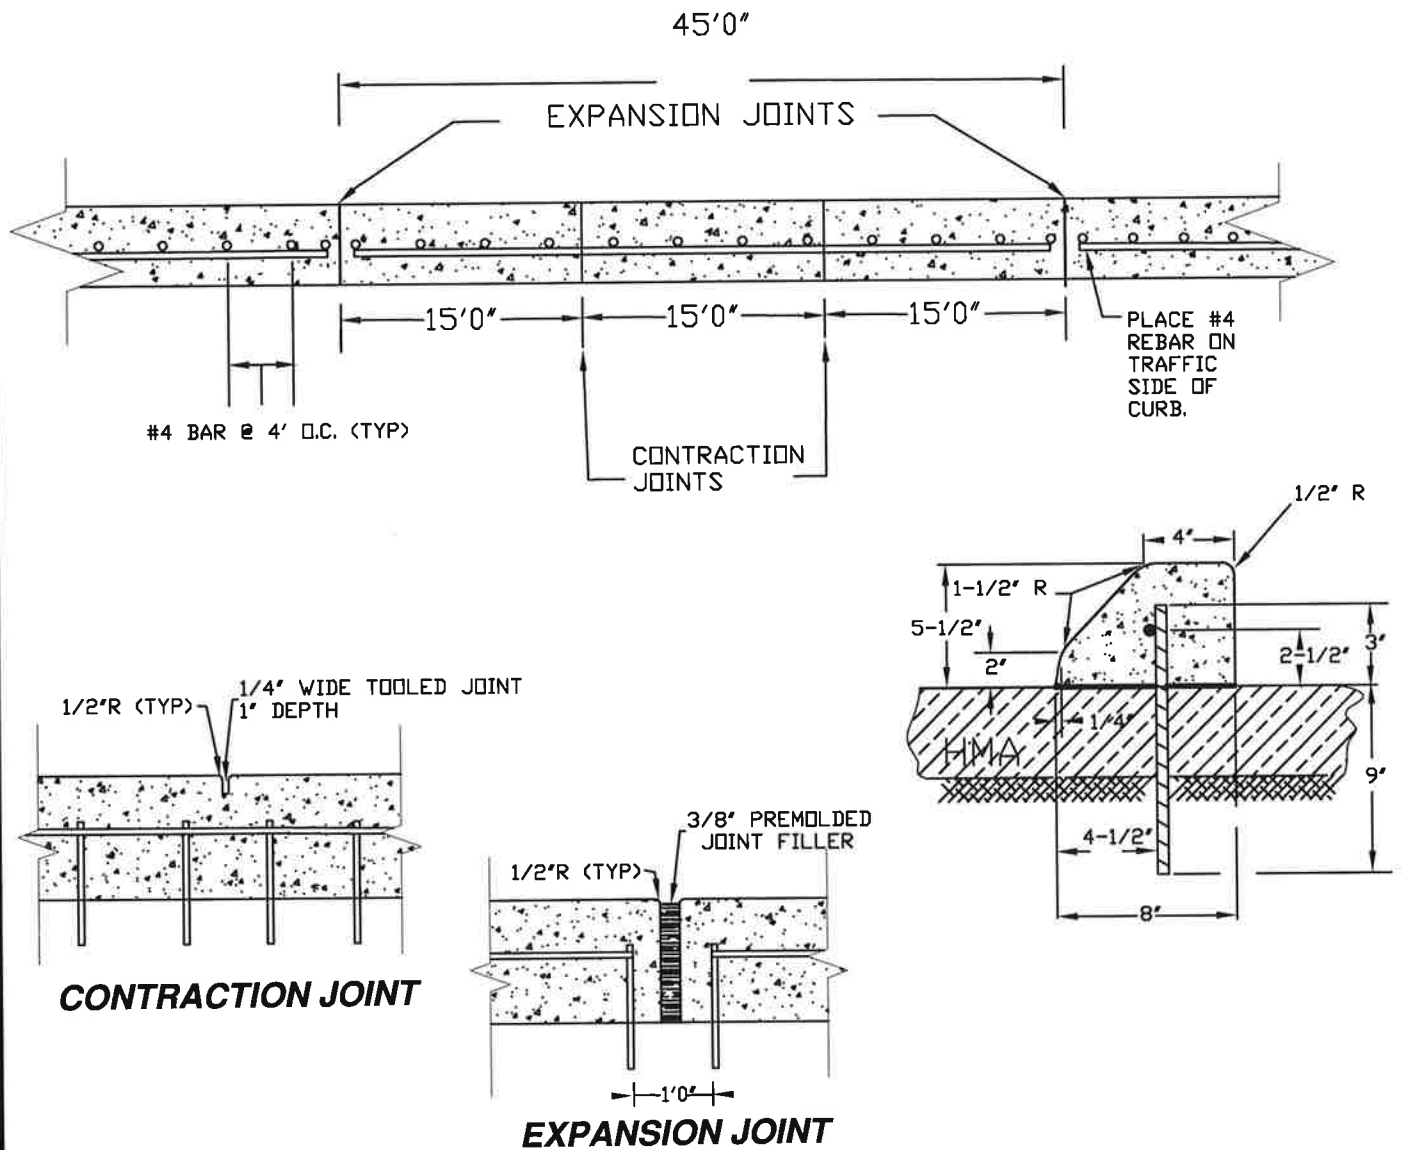

**NOTES:**

1. REINFORCED DOWELED CURB SHALL BE CONSTRUCTED USING AIR-ENTRAINED CLASS 4000 CONCRETE
2. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE REINFORCED DOWELED CURB. A 1-FOOT SECTION OF THE #4 REBAR SHALL BE REMOVED AT EACH EXPANSION JOINT. EXPANSION JOINT SPACING SHALL NOT EXCEED 45' O.C.
3. CONTRACTION JOINT SPACING SHALL NOT EXCEED 15' O.C.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 2/1990  
 REVISED: 04/2012  
 SUPERSEDES: 01/2008  
 CHECKED BY: SJS  
 SCALE: NTS  
 REVISED BY: DSH





REINFORCED DOWELED CURB

ENGINEERING SERVICES  
 CITY OF SPOKANE, WASHINGTON


STANDARD  
 PLAN No.  
 F-101

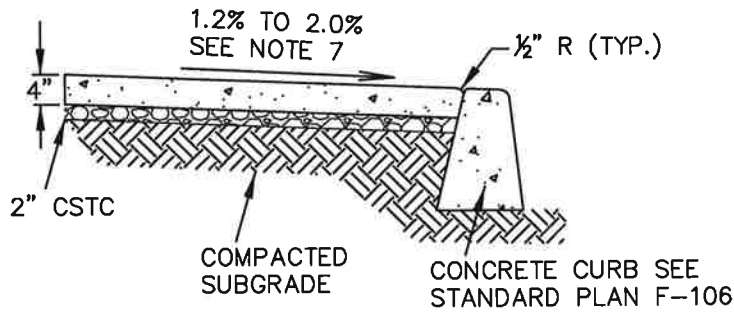

BROOMED FINISH TRANSVERSE TO PEDESTRIAN DIRECTION OF TRAVEL (TYP.)

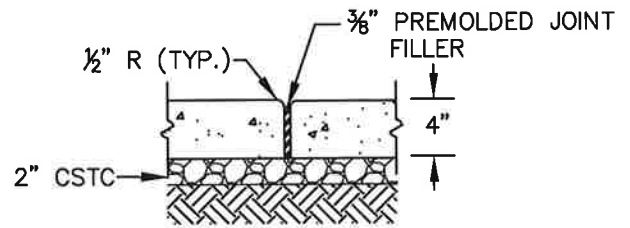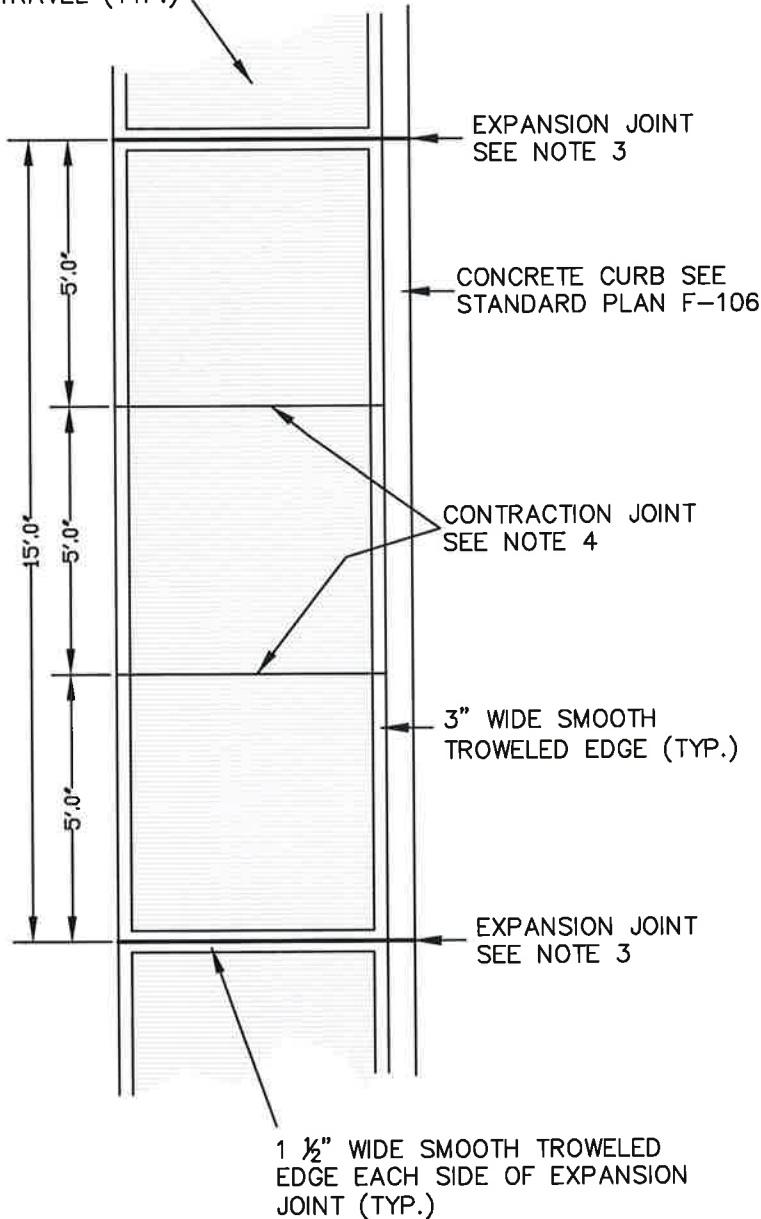

### EXPANSION JOINT DETAIL

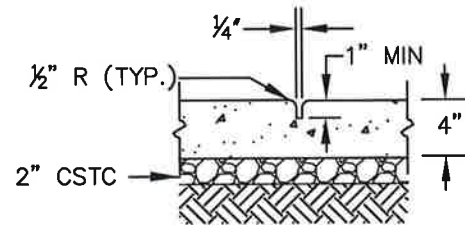

### CONTRACTION JOINT DETAIL

#### NOTES:

1. CONCRETE SIDEWALKS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. 2-INCHES OF CONCRETE MAY BE SUBSTITUTED FOR THE 2-INCHES OF CSTC, YIELDING A TOTAL SIDEWALK THICKNESS OF 6-INCHES.
3. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE SIDEWALK & CURB OR CURB/GUTTER. EXPANSION JOINTS ARE REQ'D BETWEEN EXISTING SIDEWALKS AND CURB OR CURB/GUTTER AND NEW SIDEWALKS & CURB OR CURB/GUTTER. EXPANSION JOINT SPACING SHALL NOT EXCEED 15-FT O.C.
4. CONTRACTION JOINT SPACING SHALL NOT EXCEED 5-FT O.C.
5. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS BEHIND SIDEWALK.
6. A 5-FT WIDE TRANSITION PANEL IS REQUIRED WHEN CONNECTING NEW SIDEWALKS TO EXISTING SIDEWALKS W/ CROSS SLOPES EXCEEDING 2.0%.
7. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

*[Signature]*  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
*[Signature]*  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 2/86  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK

### CONCRETE SIDEWALK



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

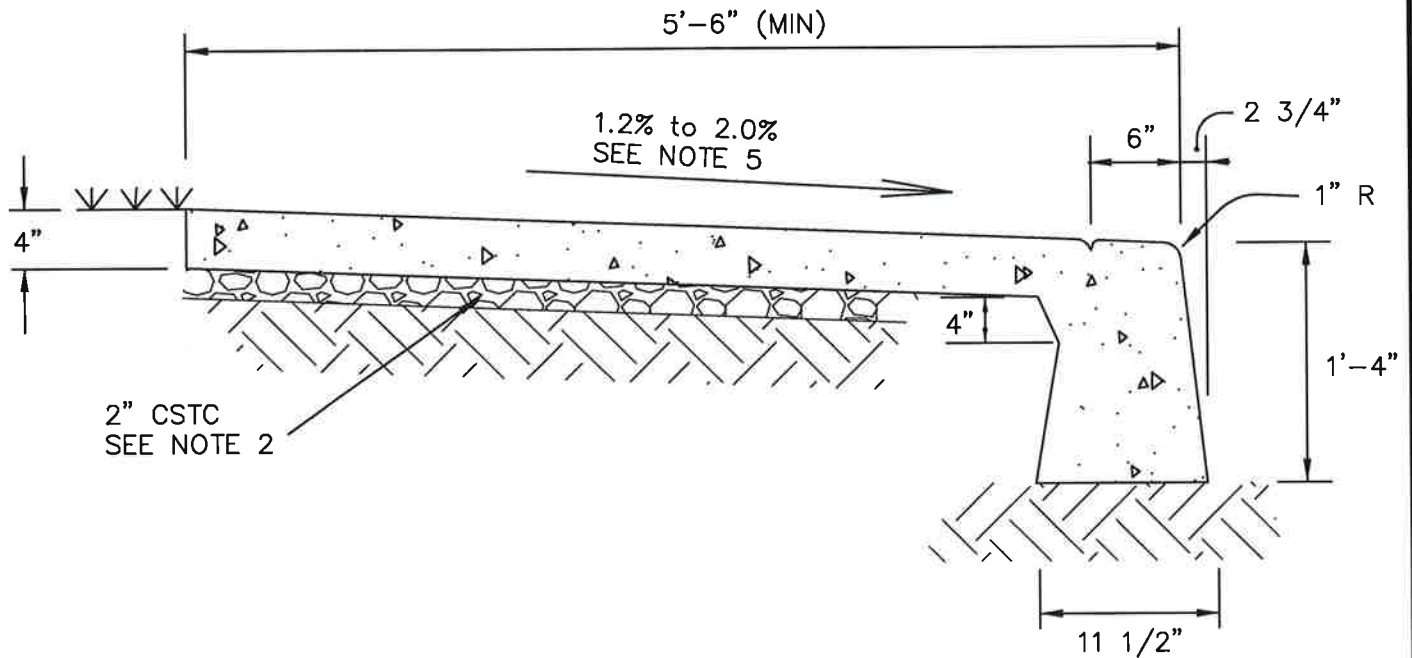


STANDARD  
PLAN No.  
F-102




## SECTION

### NOTES:

1. INTEGRAL CONCRETE CURB & SIDEWALK SHALL BE CONSTRUCTED USING AIR ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. 2-INCHES OF CONCRETE MAY BE SUBSTITUTED FOR THE 2-INCHES OF CSTC, YIELDING A TOTAL SIDEWALK THICKNESS OF 6-INCHES.
3. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
4. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS BEHIND SIDEWALK.
5. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 2/1990 REVISED: 04/2013 SUPERSEDES: 04/2012 CHECKED BY: JTG SCALE: NTS REVISED BY: LWK		INTEGRAL CONCRETE CURB & SIDEWALK	
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON		STANDARD PLAN No. F-102A	

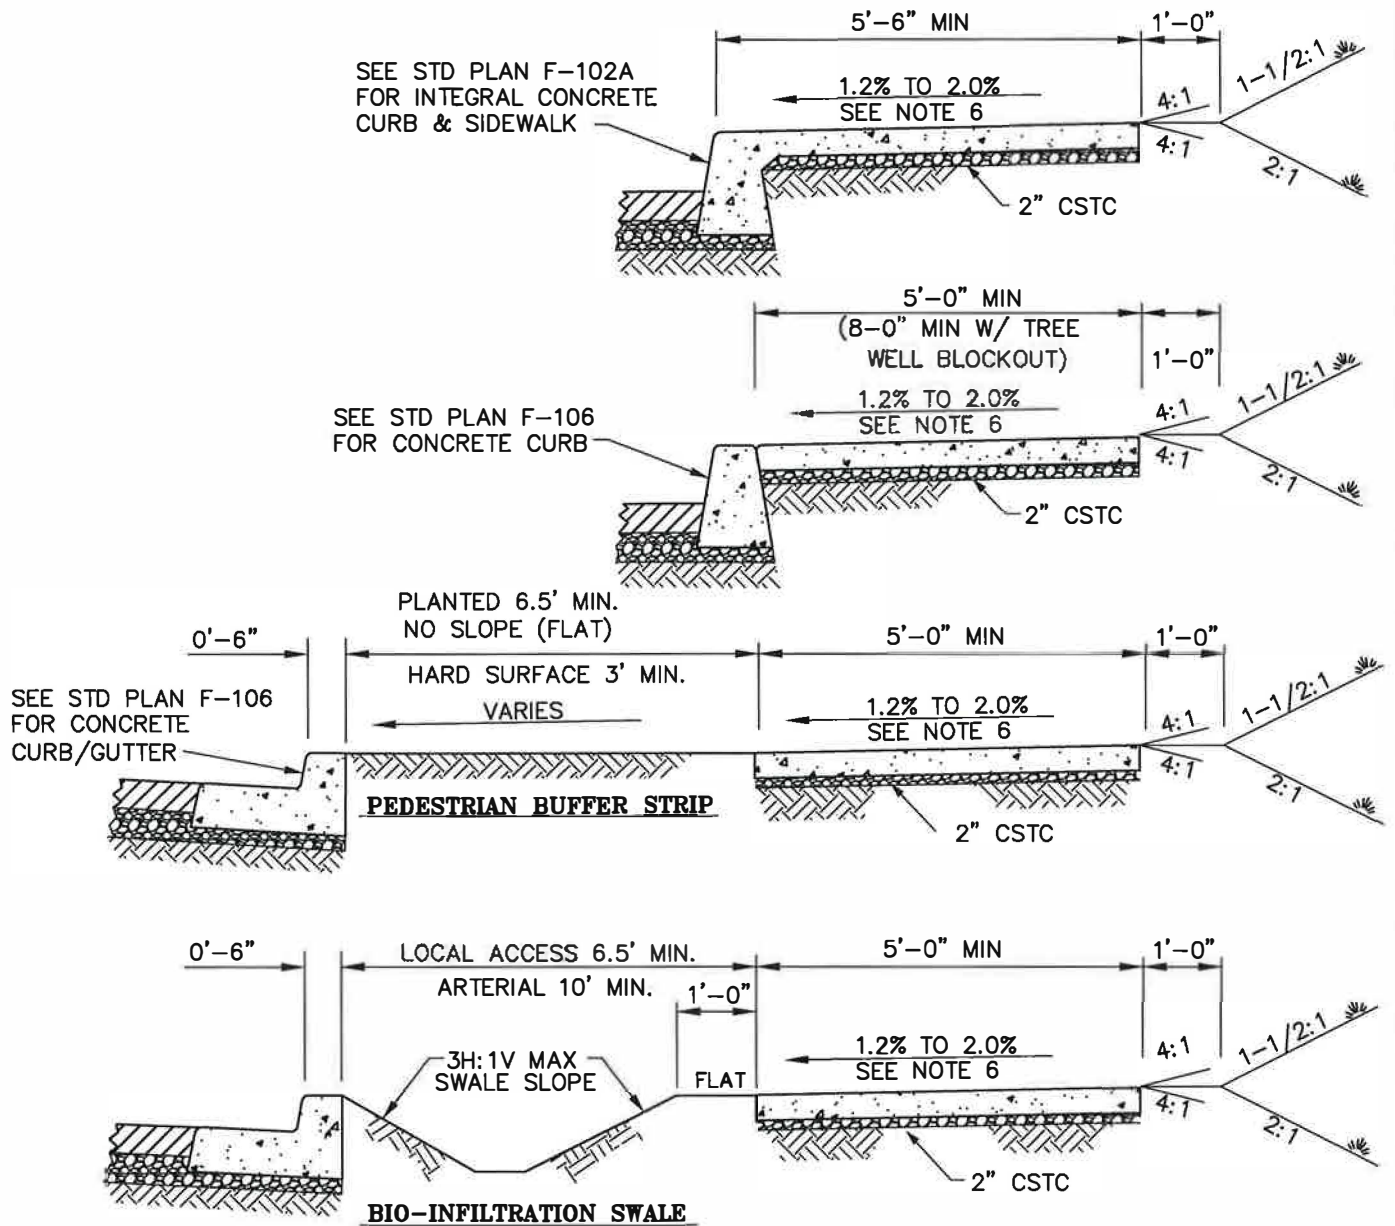

**NOTES:**

1. TYPICAL SIDEWALK THICKNESS SHALL BE 4 INCHES. EXCEPTION: SEE STD PLANS F-103 THROUGH F-104B FOR SIDEWALK THICKNESS REQUIREMENTS AT DRIVEWAYS.
2. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
3. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR SIDEWALK WIDTH REQUIREMENTS.
4. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR PEDESTRIAN BUFFER STRIP WIDTH REQUIREMENTS
5. SEE STD PLAN B-102F FOR BIO-INFILTRATION SWALE REQUIREMENTS.
6. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  
  
 DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
  
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.


ADOPTED: 6/1993  
 REVISED: 04/2013  
 SUPERSEDES: 04/2012  
 CHECKED BY: JTG  
 SCALE: NTS  
 REVISED BY: LWK

**CONCRETE SIDEWALK SECTIONS**




ENGINEERING SERVICES  
 CITY OF SPOKANE, WASHINGTON

STANDARD  
 PLAN No.  
**F-102B**

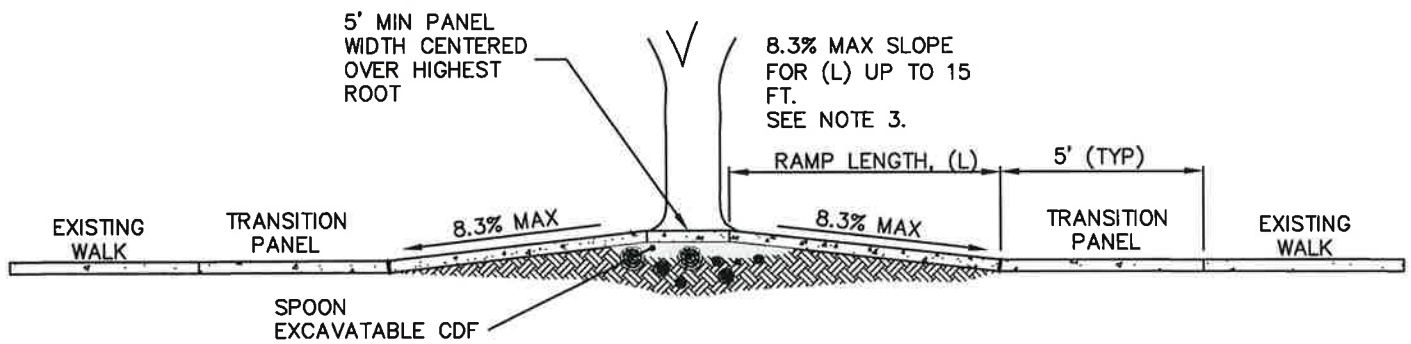

SECTION A-A

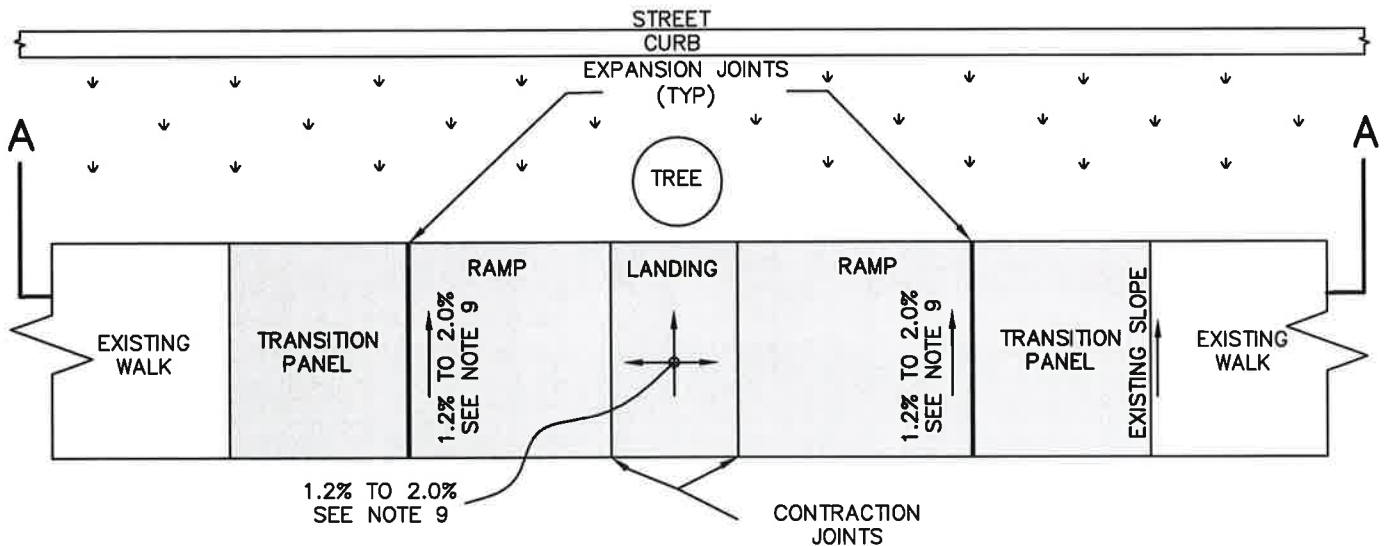

PLAN VIEW

NOTES:

1. THIS PLAN DOES NOT APPLY FOR NEW SIDEWALK CONSTRUCTION IN UNDEVELOPED AREAS.
2. 5-FT TRANSITION PANEL IS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2.0%
3. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY; INCREASE MAXIMUM RUNNING SLOPE AS DIRECTED BY THE ENGINEER. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
4. ROOT AREAS SHALL BE UNDISTURBED AS MUCH AS PRACTICAL. LOOSE SOIL SHALL BE LIGHTLY HAND TAMPED. IF ROOT TRIMMING IS NECESSARY CONTACT CITY OF SPOKANE URBAN FORESTRY.
5. FILL VOIDS AROUND ROOTS TO PROVIDE SIDEWALK SUPPORT W/ LAYER OF SPOON EXCAVATABLE CDF FILL PER SECTION 2-09.3(1)E. 1-INCH MINIMUM COVER OVER THE HIGHEST ROOT IS REQUIRED.
6. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
7. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS ON EACH SIDE OF ELEVATED SIDEWALK. PLACE TOPSOIL TYPE A AND HYDROSEED OR SOD AS DIRECTED BY THE ENGINEER TO MATCH EXISTING CONDITIONS.
8. RAISE, RELOCATE, OR REPLACE EXISTING SPRINKLER SYSTEM AS NEEDED.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES

PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST

KENNETH M. BROWN, P.E.

ADOPTED: 09/2010

REVISED: 04/2013

SUPERSEDES: 04/2012

CHECKED BY: JTG

SCALE: NTS


REVISED BY: LWK

CONCRETE SIDEWALK REPAIRS  
RAMPING OVER TREE ROOTS



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-102C

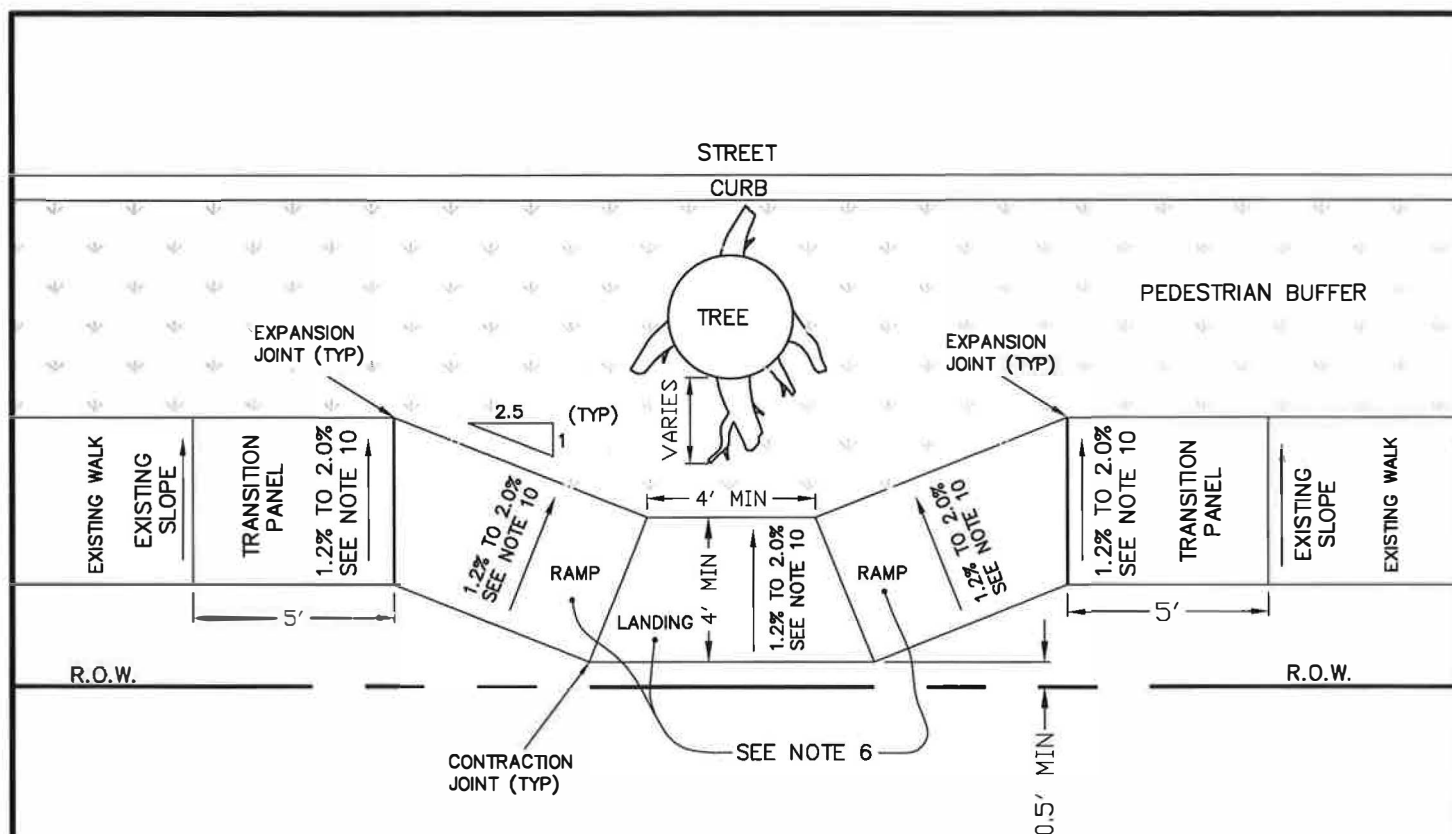

NOTES:

1. THIS PLAN DOES NOT APPLY FOR NEW SIDEWALK CONSTRUCTION IN UNDEVELOPED AREAS.
2. 5-FT TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2.0%.
3. ROOT AREAS SHALL BE UNDISTURBED AS MUCH AS PRACTICAL. LOOSE SOIL SHALL BE LIGHTLY HAND TAMPED. IF ROOT TRIMMING IS NECESSARY CONTACT CITY OF SPOKANE URBAN FORESTRY.
4. TYPICAL SIDEWALK DIVERSION ANGLE SHALL BE 2.5 TO 1. DIVERSION ANGLE MAY BE INCREASED TO 1 TO 1 AS DIRECTED BY THE ENGINEER.
5. BACK OF SIDEWALK SHALL BE A MINIMUM OF 0.5 FT INSIDE OF THE R.O.W. SIDEWALK WIDTH MAY BE DECREASED TO 3 FT AS DIRECTED BY THE ENGINEER TO ENSURE SIDEWALK IS WITHIN THE R.O.W.
6. USE IN CONJUNCTION W/ STD PLAN F-102C WHEN RAMPING OVER AND DIVERTING AROUND TREE ROOTS IS REQUIRED.
7. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS. PROVIDE ADDITIONAL EXPANSION JOINTS AS SHOWN.
8. SEE STD PLAN F-102B FOR SLOPING REQUIREMENTS ON EACH SIDE OF SIDEWALK. PLACE TOPSOIL TYPE A AND HYDROSEED OR SOD AS DIRECTED BY THE ENGINEER.
9. RELOCATE OR REPLACE EXISTING SPRINKLER SYSTEMS AS NEEDED.
10. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES      PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST.      KENNETH M. BROWN, P.E.

ADOPTED: 09/2010

REVISÉ: 04/2013

SUPERSEDES: 04/2012

CHECKED BY: JTG

SCALE: \_\_\_\_\_ NTS




REVISOR BY: LWK

## CONCRETE SIDEWALK REPAIR DIVERTING AROUND TREE ROOTS




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-102D

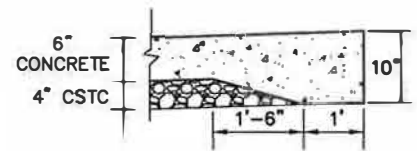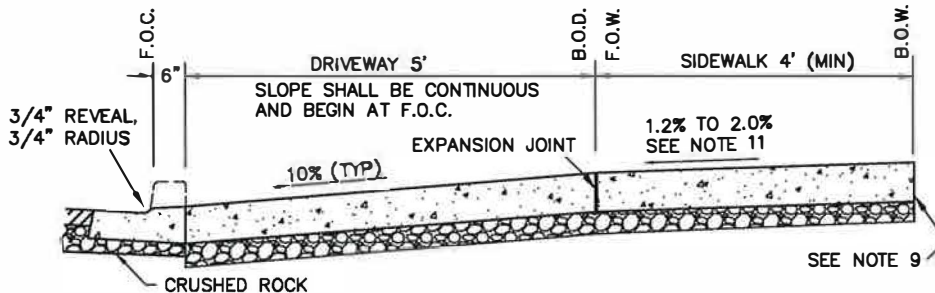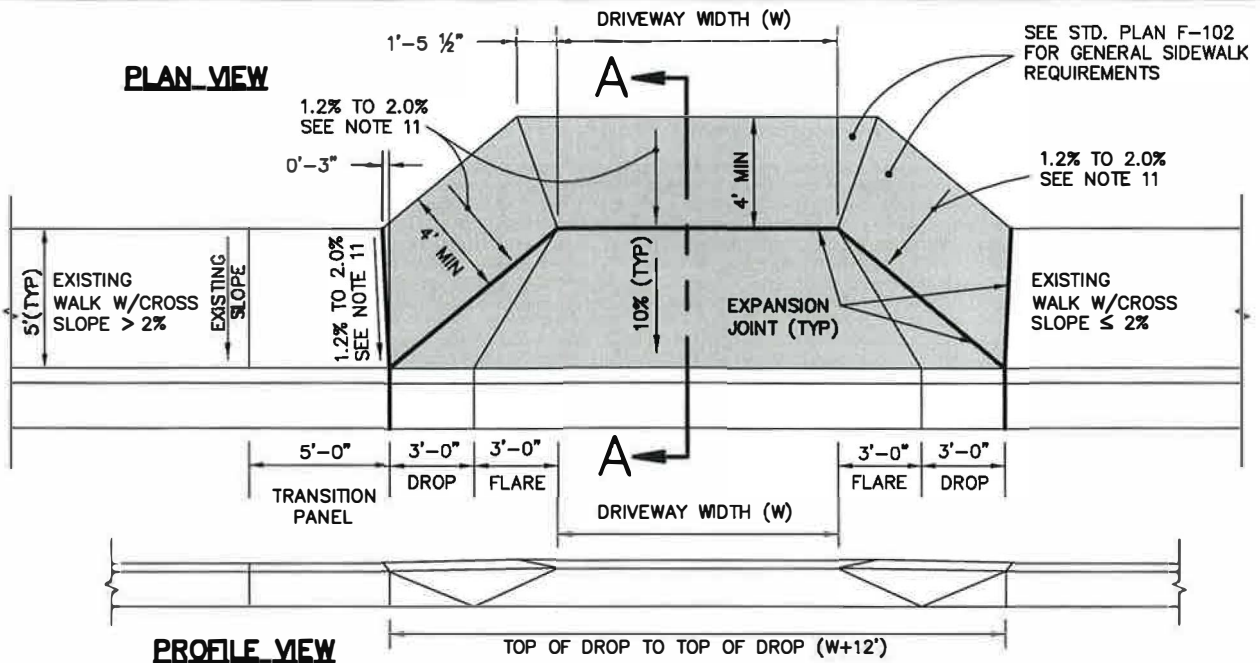


**NOTES:**



1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
7. THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO 3" TO MATCH EXISTING CONDITIONS AT BACK OF SIDEWALK (B.O.W.).
8. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

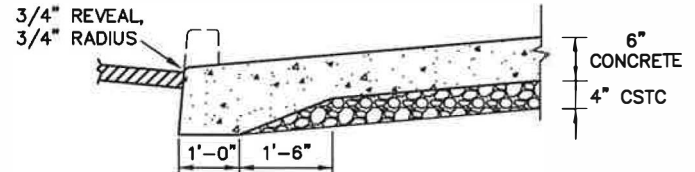

<p>APPROVED BY</p> <p><i>[Signature]</i></p> <p>DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.</p> <p><i>[Signature]</i></p> <p>PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.</p>		<p>ADOPTED: 09/2010</p> <p>REVISED: 04/2013</p> <p>SUPERSEDES: 04/2012</p> <p>CHECKED BY: JTG</p> <p>SCALE: NTS</p> <p>REVISED BY: LWK</p>	<p>CONCRETE DRIVEWAY</p> <p>ADJACENT SIDEWALK / TYPE 1</p> <p>ENGINEERING SERVICES</p> <p>CITY OF SPOKANE, WASHINGTON</p>	<p>STANDARD</p> <p>PLAN No.</p> <p>F-103</p>
---	--	--	---	--

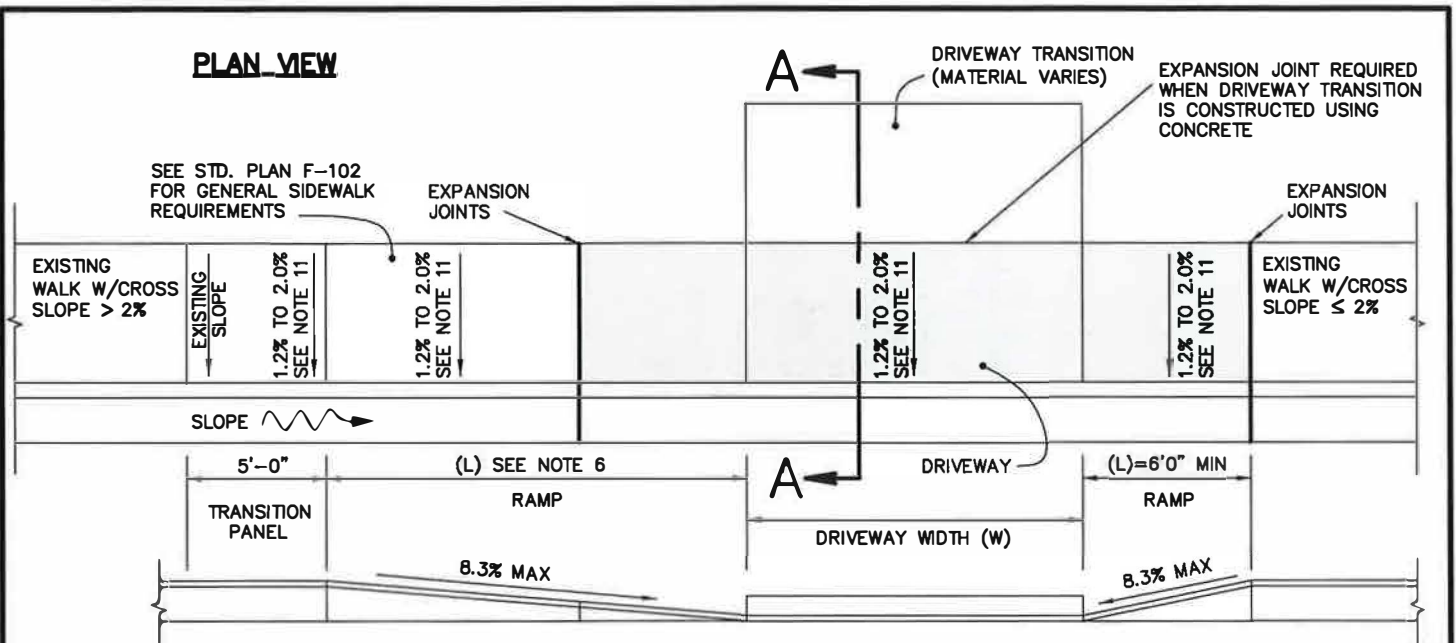

**PROFILE VIEW**

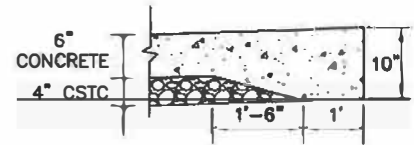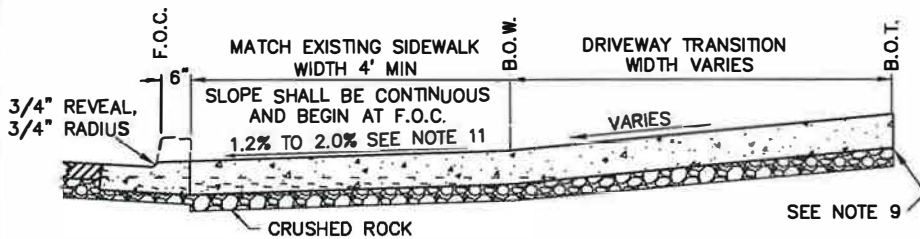


**THICKENED EDGE**

**SECTION A-A**

**NOTES:**

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY RAMP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE TOP OF A DRIVEWAY RAMP SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC. SHADED AREA SHALL BE EXPANDED TO INCLUDE DRIVEWAY TRANSITION WHEN CONSTRUCTED USING CONCRETE.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HANO TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY TRANSITION SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. OR B.O.T. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

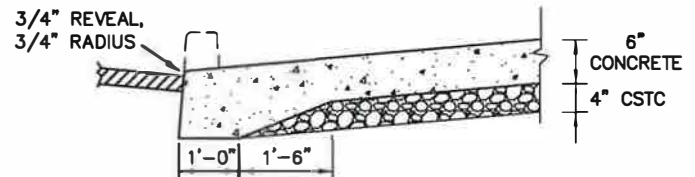


**SECTION A-A**



INTEGRAL CURB & DRIVEWAY

<p>APPROVED BY</p> <p><i>[Signature]</i></p> <p>DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.</p>		<p>ADOPTED: 04/2004</p> <p>REVISED: 04/2013</p> <p>SUPERSEDES: 04/2012</p> <p>CHECKED BY: JTG</p> <p>SCALE: NTS</p> <p>REVISED BY: LWK</p>		<p>CONCRETE DRIVEWAY</p> <p>ADJACENT SIDEWALK / TYPE 2</p>	
<p><i>[Signature]</i></p> <p>PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.</p>		<p>ENGINEERING SERVICES</p> <p>CITY OF SPOKANE, WASHINGTON</p>		<p>STANDARD</p> <p>PLAN No.</p> <p>F-103A</p>	

## PLAN VIEW

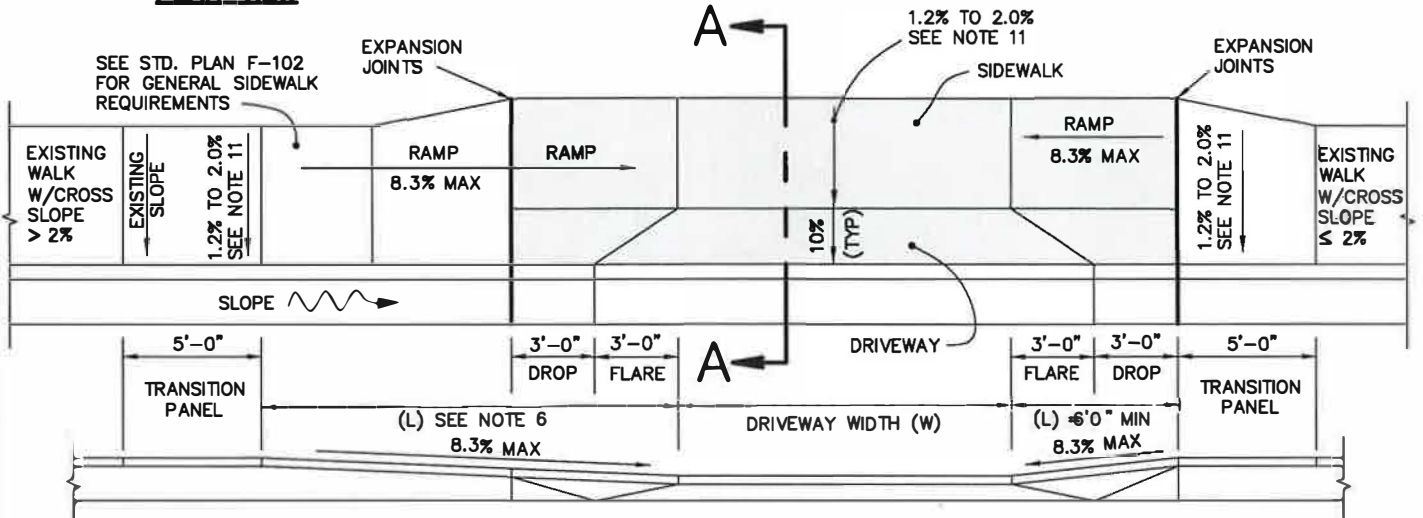

## PROFILE VIEW

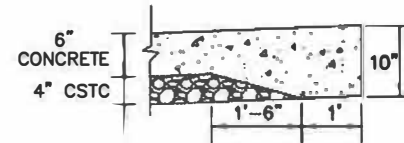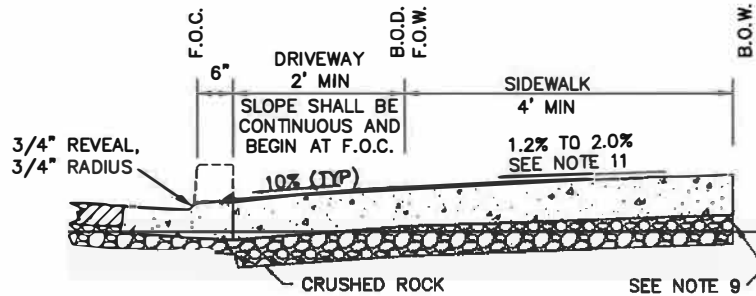


## THICKENED EDGE

## SECTION A-A

### NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY RAMP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE TOP OF A DRIVEWAY RAMP SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2% AND WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE THE WIDTH OF THE IMPROVEMENTS.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

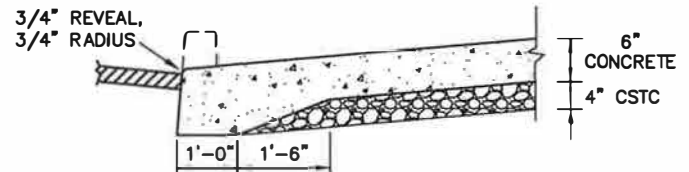

## SECTION A-A

INTEGRAL CURB & DRIVEWAY

APPROVED BY

*[Signature]*  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
*[Signature]*  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 04/2004  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK


CONCRETE DRIVEWAY  
ADJACENT SIDEWALK / TYPE 3




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-103B


# PLAN VIEW

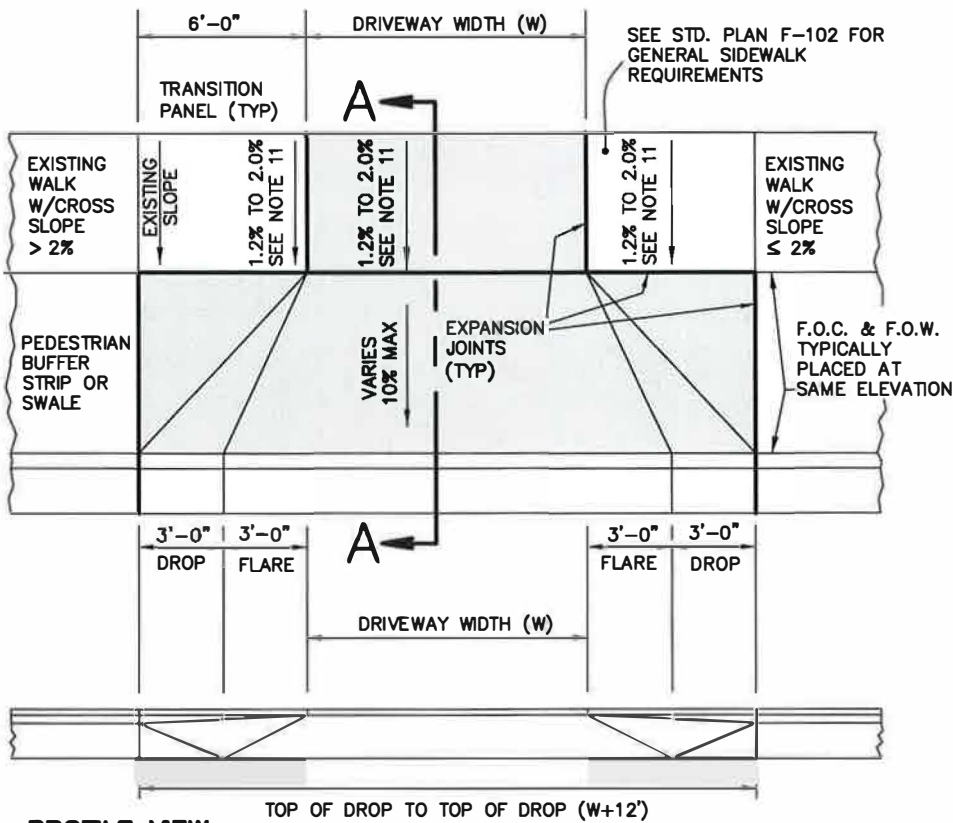

## PROFILE VIEW

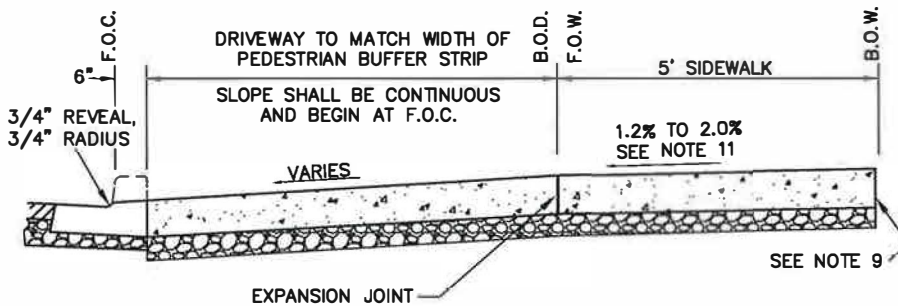


## SECTION A-A

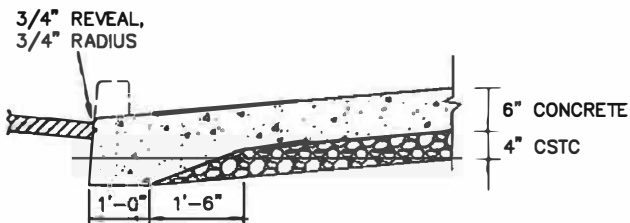

## SECTION A-A

INTEGRAL CURB & DRIVEWAY

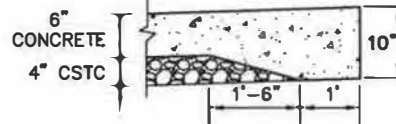

## THICKENED EDGE

## NOTES:

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
7. THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO .25 FT TO MATCH EXISTING CONDITIONS AT BACK OF SIDEWALK (B.O.W.).
8. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY

*[Signature]*  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
*[Signature]*  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 04/2004  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK




CONCRETE DRIVEWAY  
PED BUFFER STRIP WIDTH ≥ 5 FT



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-104

# PLAN VIEW

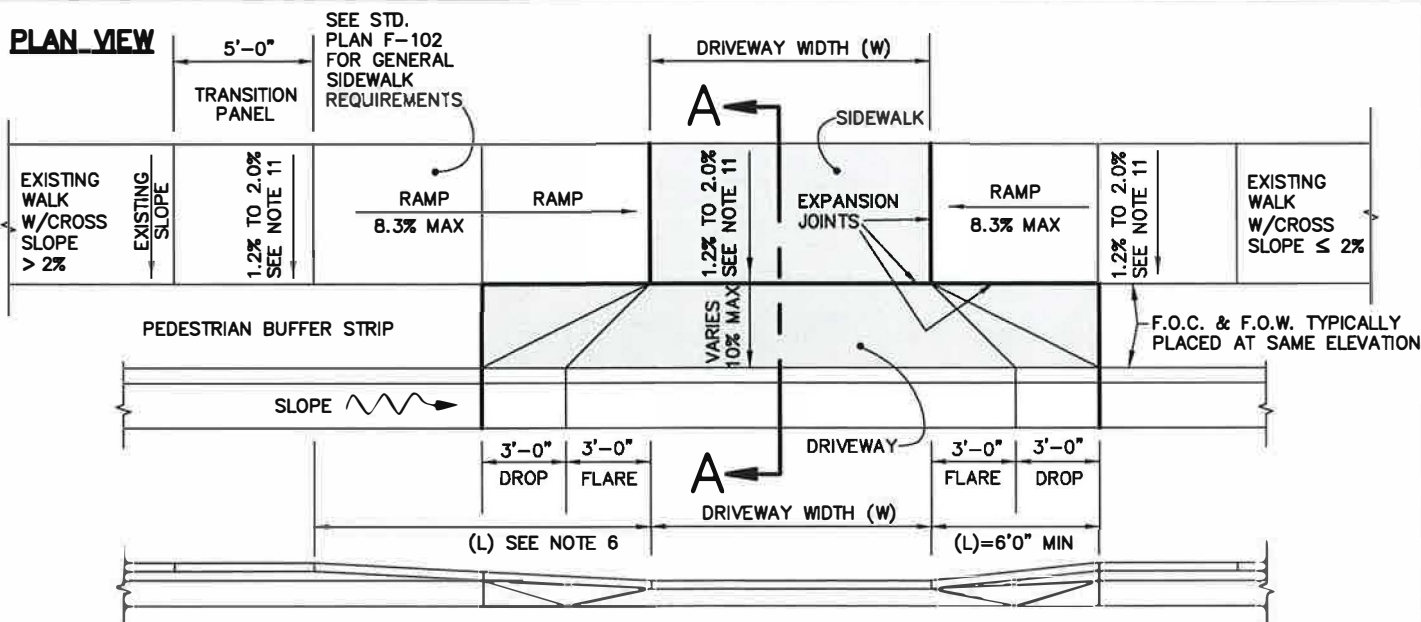

# PROFILE VIEW

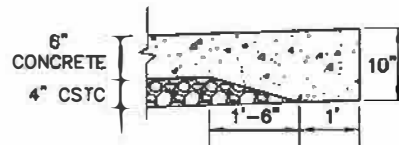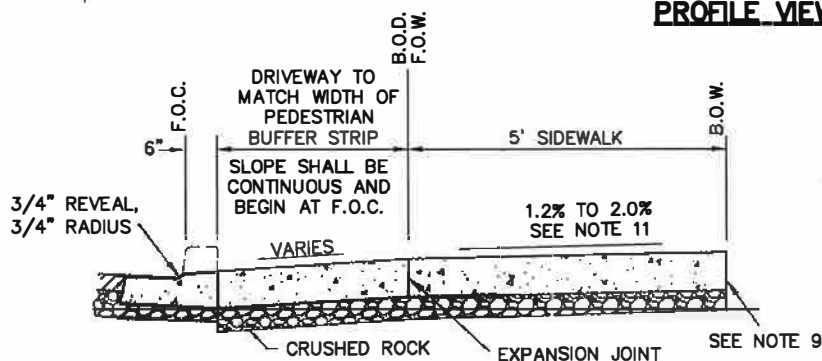


# THICKENED EDGE

## NOTES:

## SECTION A-A

1. NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENG SERVICES DEPT.
2. THE TOP OF A DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5' OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
3. WHERE POSSIBLE, THE DRIVEWAY FLARE SHALL NOT EXTEND PAST AN ADJACENT PROPERTY LINE.
4. THE SHADED AREA REQUIRES A 6-INCH MIN DEPTH OF AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE OVER 4-INCHES OF COMPACTED CSTC.
5. EXPANSION JOINTS SHALL BE 3/8" PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
6. RAMP MAXIMUM RUNNING SLOPE SHALL NOT REQUIRE THE RAMP LENGTH (L) TO EXCEED 15-FT TO AVOID CHASING THE SLOPE INDEFINITELY. RAMP LENGTH (L) SHALL BE INCREASED INCREMENTALLY FROM 6-FT TO 11-FT TO 15-FT TO COMPLY W/ MAXIMUM RAMP RUNNING SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
7. IN SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH.
8. BROOMED FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOMED FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
9. A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
10. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
11. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

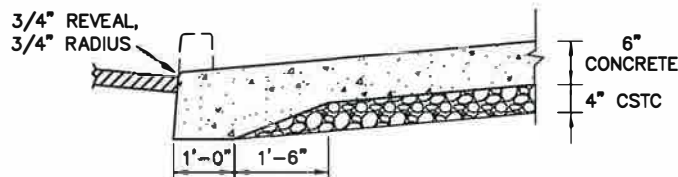

## SECTION A-A

INTEGRAL CURB & DRIVEWAY

APPROVED BY

*[Signature]*  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
*[Signature]*  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.



ADOPTED: 04/2004  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK

CONCRETE DRIVEWAY  
PED BUFFER STRIP WIDTH < 5 FT



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-104A

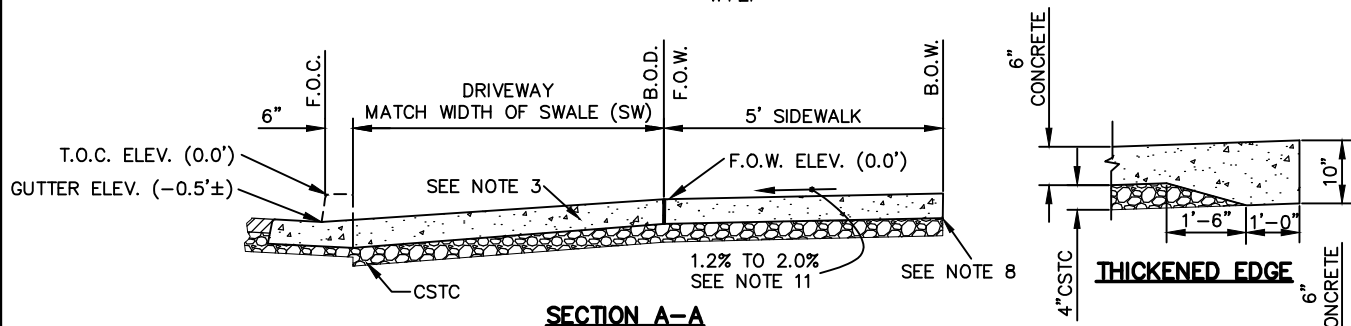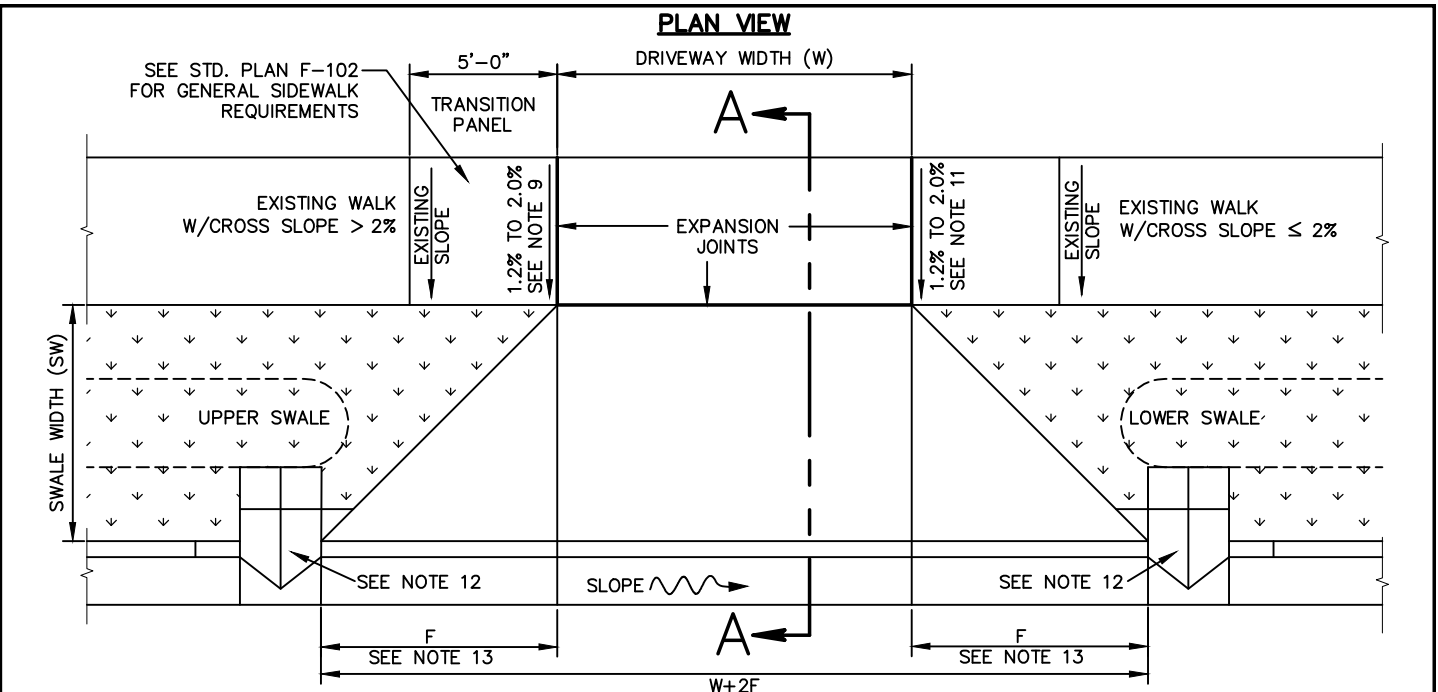

**NOTES:**

- NON-STANDARD DRIVEWAY DESIGNS SHALL REQUIRE THE APPROVAL OF THE CITY ENGINEERING SERVICES DEPT.
- THE TOP OF DRIVEWAY DROP SHALL NOT BE PLACED WITHIN 5 FEET OF THE R.O.W. LINE AT ANY INTERSECTING STREET NOR WITHIN THE RADIUS OF A CURB RETURN.
- THE SHADED AREA REQUIRES 6 INCH MIN. DEPTH OF AIR ENTRAINED, 6 SACK COMMERCIAL CONCRETE OVER 4 INCHES OF COMPACTED CSTC.
- EXPANSION JOINTS SHALL BE 3/8 INCH PREMOLDED JOINT FILLER EXTENDING THROUGH THE FULL CONCRETE CROSS SECTION. AT SHARED DRIVEWAYS AN ADDITIONAL EXPANSION JOINT SHALL BE PLACED ALONG THE COMMON PROPERTY LINE.
- THE BACK OF DRIVEWAY (B.O.D.) AND SIDEWALK MAY BE LOWERED UP TO 0.25 FEET TO MATCH EXISTING CONDITIONS AT THE BACK OF SIDEWALK.
- IN THE SHADED AREA CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4 INCH WIDE BY 2 INCH MIN. DEPTH.
- BROOM FINISH ON SIDEWALK SHALL BE APPLIED PERPENDICULAR TO THE PEDESTRIAN DIRECTION OF TRAVEL. BROOM FINISH ON DRIVEWAY SHALL BE APPLIED PERPENDICULAR TO THE VEHICULAR DIRECTION OF TRAVEL.
- A THICKENED EDGE IS REQUIRED AT B.O.W. WHEN DRIVEWAY DOES NOT ABUT AN EXISTING PAVED OR CONCRETE SURFACE.
- TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING WALK EXCEEDS 2%.
- SEE STD. PLAN B-102F FOR SWALE REQUIREMENTS.
- 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
- CURB DROP INLET, SEE STD. PLAN F-109.
- FLARE WIDTH (F)=3'. EXCEPTION: WHEN TRAVEL IS ADJACENT TO CURB (I.E., NO PARKING LANE OR BIKE LANE), FLARE WIDTH SHALL EQUAL SWALE WIDTH (SW) BUT NOT TO EXCEED 6'.

APPROVED BY

ENGINEERING SERVICES DIRECTOR

KYLE TWOHIG

CITY ENGINEER

DAN BULLER, P.E.

ADOPTED: \_\_\_\_\_

REVISED: 04/2022

SUPERSEDES: 10/2020

CHECKED BY: JTG

SCALE: NTS

REVISED BY: LWK/MLD


**CONCRETE DRIVEWAY  
WITH INTEGRATED SWALE INLET**




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
**F-104B**

### PLAN VIEW

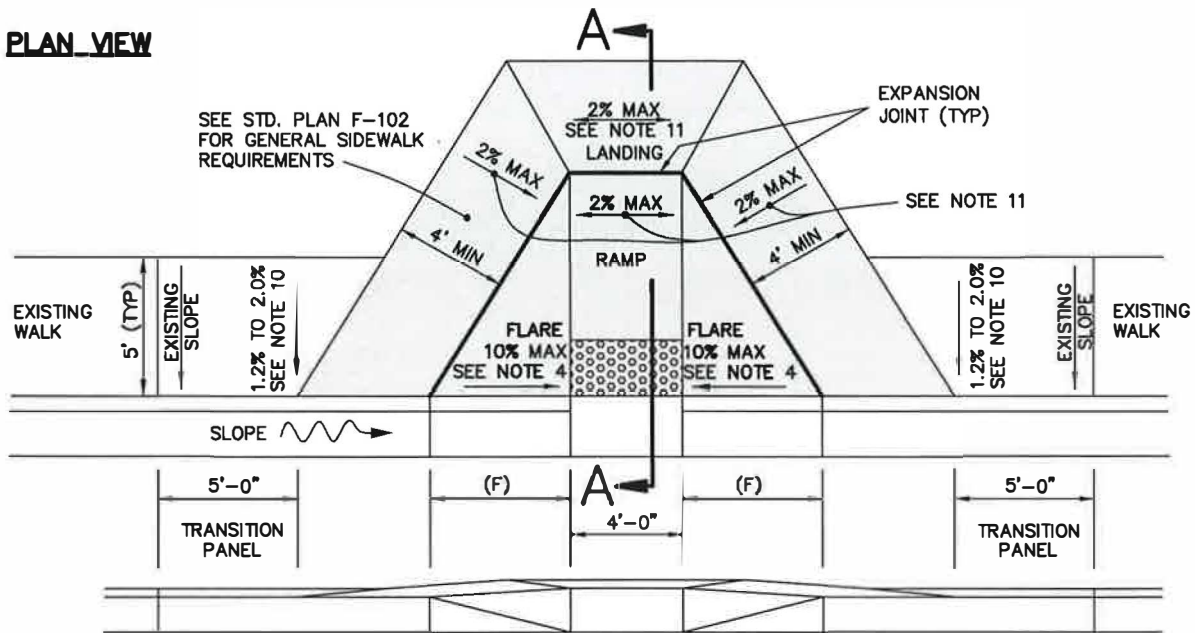


### PROFILE VIEW

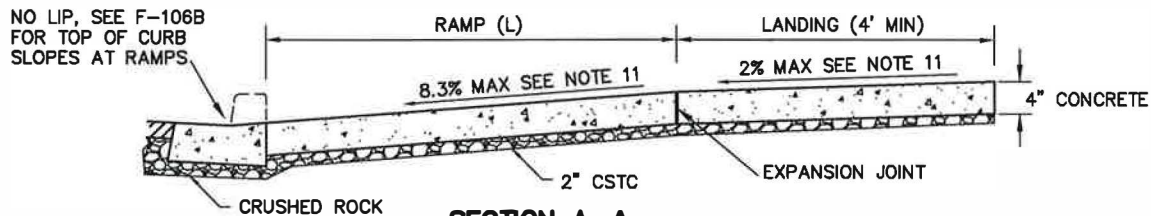

### SECTION A-A

### PLAN VIEW

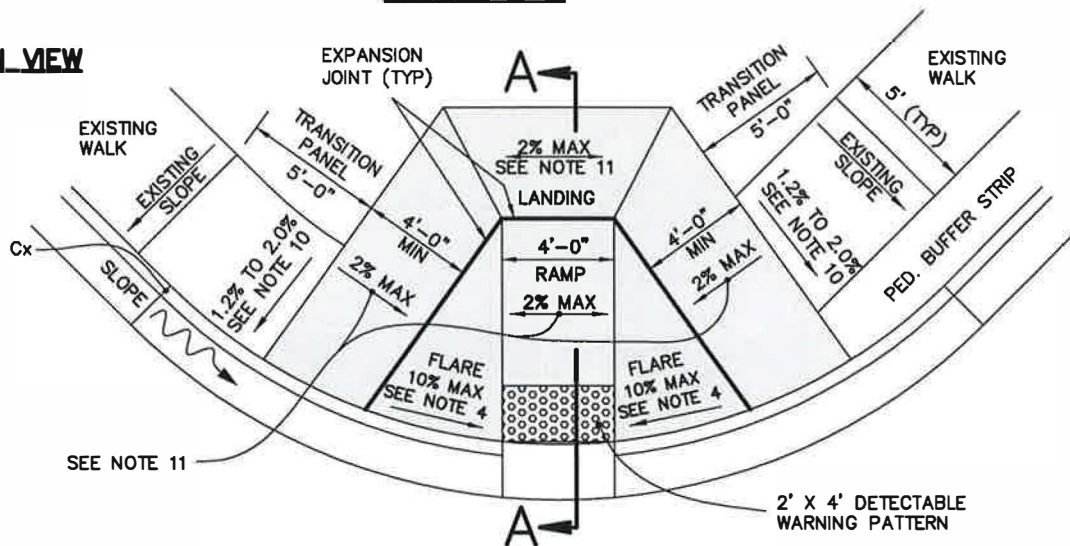

L = $\frac{Cx}{.063}$	F = $\frac{Cx}{.1-S}$	Cx	L	Fmin	S	Fmax	S
L = RAMP LENGTH (FT)		.3'	4.8'	3.0'	0	4.8'	.037
F = FLARE LENGTH (FT)		.4'	6.4'	4.0'	0	6.4'	.037
Cx = CURB EXPOSURE (FT)		.5'	8.0'	5.0'	0	8.0'	.037
S = GUTTER SLOPE							

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991

REVISED: 04/2013

SUPERSEDES: 04/2012

CHECKED BY: JTG

SCALE: NTS

REVISED BY: LWK

CURB RAMP TYPE-1



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-105

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MAXIMUM RAMP RUNNING SLOPE SHALL BE 8.3%.
3. MAXIMUM CROSS SLOPE AND RUNNING SLOPE ON LANDING SHALL BE 2%.
4. MAXIMUM FLARE SLOPE SHALL BE 10% MEASURED PARALLEL TO THE CURB, HOWEVER FLARE LENGTH (F) IS NOT REQUIRED TO EXCEED RAMP LENGTH (L).
5. BOTH FLARES SHALL BE THE SAME LENGTH FOR RAMP SYMMETRY.
6. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
7. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
8. TRANSITION PANELS REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
9. SEE STANDARD PLANS F-102, F-102A, F-106, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
10. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
11. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  
  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK




## F-105 NOTES

ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON


STANDARD  
PLAN No.  
F-105

# PLAN VIEW

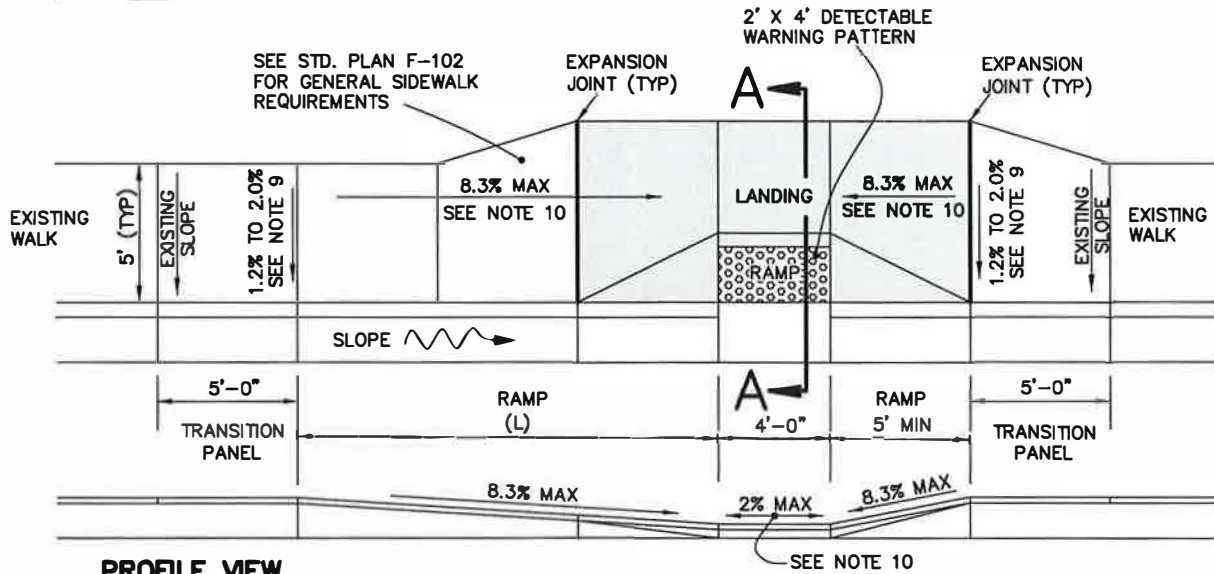


## PROFILE VIEW

NO LIP, SEE F-106B FOR TOP OF CURB SLOPES AT RAMPS

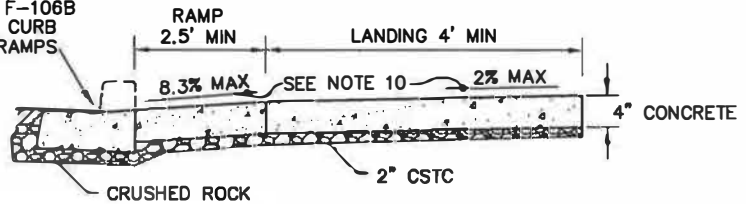

## SECTION A-A

# PLAN VIEW

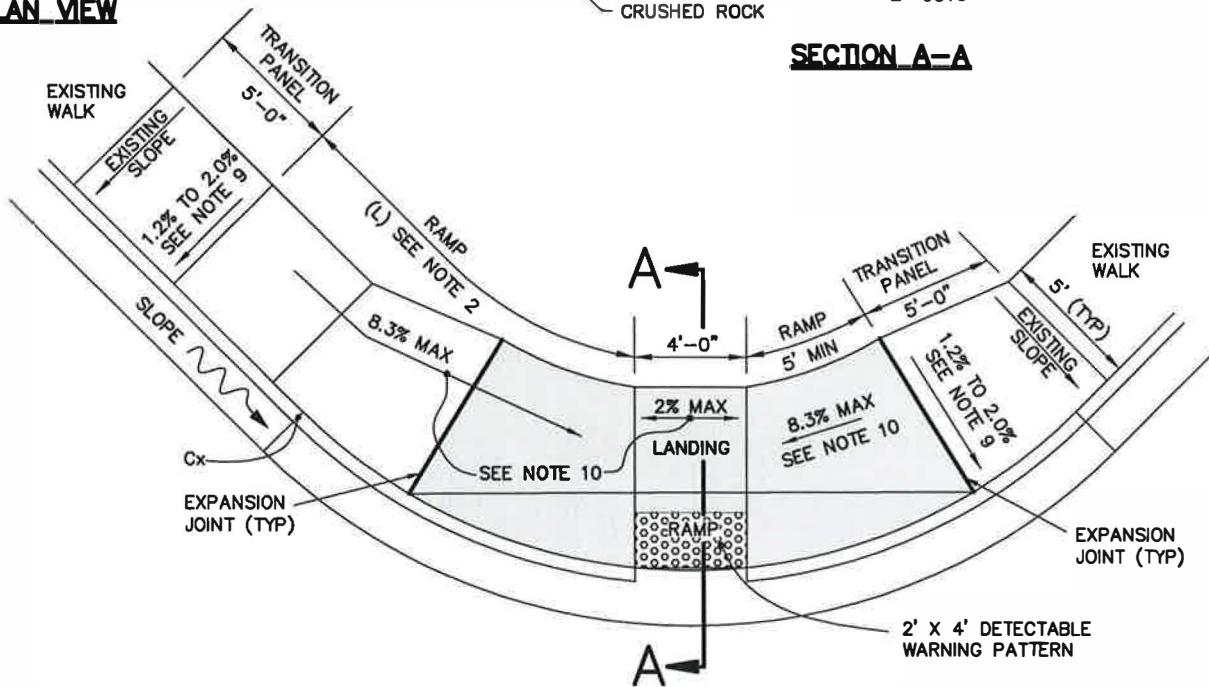

$$L = \frac{Cx - 0.2}{.083 - S}$$

L = RAMP LENGTH (FT)  
Cx = CURB EXPOSURE (FT)  
S = GUTTER SLOPE

W/ .5' EXISTING CURB EXPOSURE

L = 5' UP TO .023 SLOPE  
L = 10' UP TO .053 SLOPE  
L = 15' ABOVE .053 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

*[Signature]*  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
*[Signature]*  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK

CURB RAMP TYPE-2 PREFERRED



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-105A

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 5 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 5 FT. TO 10 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM CROSS SLOPE AND RUNNING SLOPE ON LANDING SHALL BE 2%.
4. JOINTS FOR RAMPS AND LANDINGS SHALL FORM RECTANGLES. ALL OTHER JOINTS LOCATED BETWEEN CURB RETURNS SHALL BE ORIENTED RADIALLY.
5. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
6. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
7. TRANSITION PANELS REQUIRED WHEN EXISTING CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2% OR WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE WIDTH OF THE IMPROVEMENTS.
8. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
10. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

APPROVED BY  
  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK




## F-105A NOTES

ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON


STANDARD  
PLAN No.  
F-105A

# PLAN VIEW

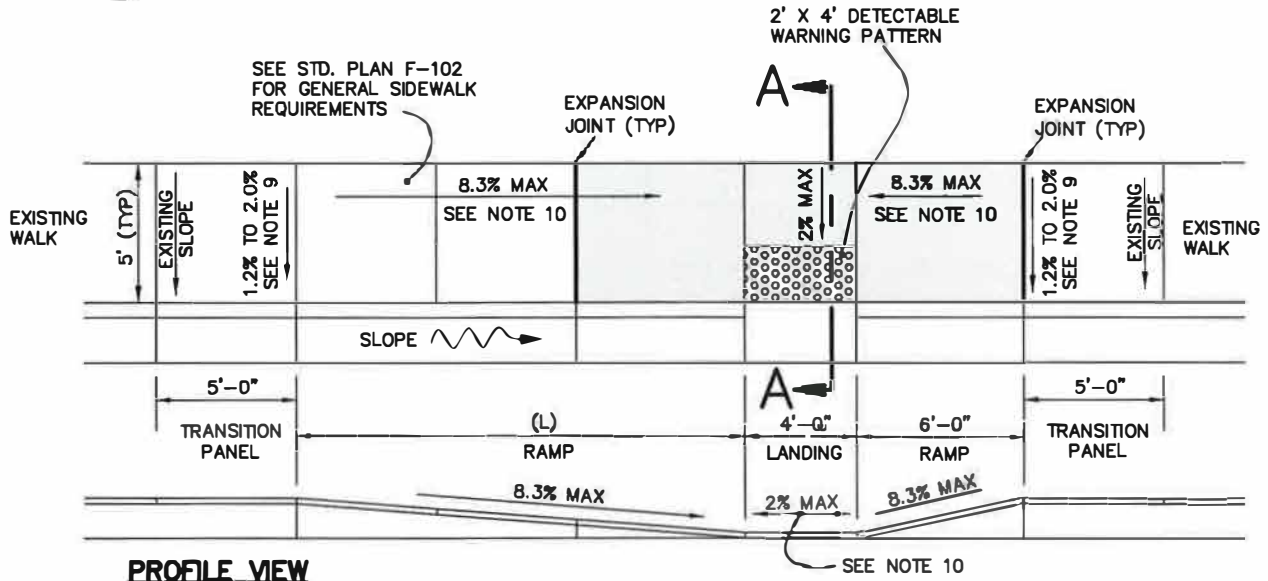


## PROFILE VIEW

NO LIP, SEE F-106B FOR TOP OF CURB SLOPES AT RAMPS

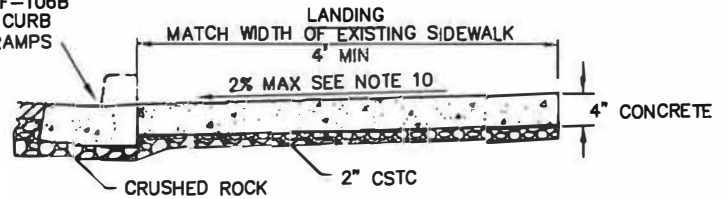

## SECTION A-A

# PLAN VIEW

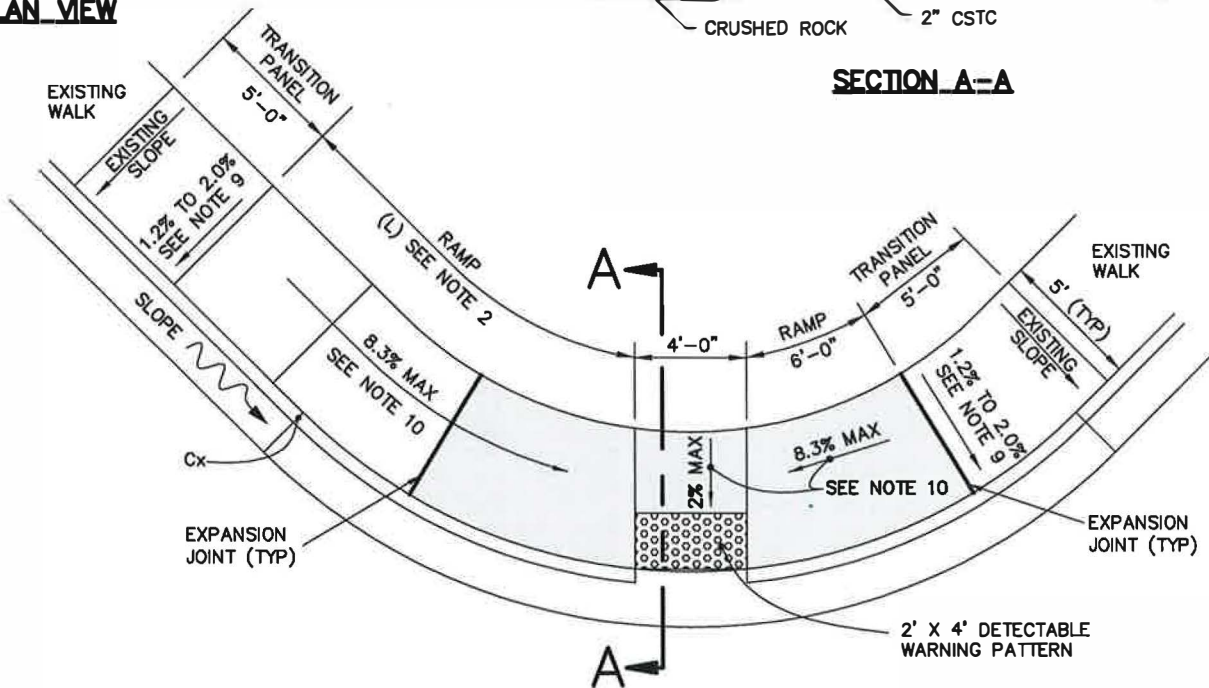

$$L = \frac{Cx}{.083 - S}$$

L = RAMP LENGTH (FT)  
Cx = CURB EXPOSURE (FT)  
S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE  
L = 11' UP TO .037 SLOPE  
L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.




ADOPTED: 08/1991  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK

CURB RAMP TYPE-2  
RESTRICTED R.O.W.


ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-105B

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE ON LANDING SHALL BE 2% IN ANY DIRECTION.
4. JOINTS FOR RAMPS AND LANDINGS SHALL FORM RECTANGLES. ALL OTHER JOINTS LOCATED BETWEEN CURB RETURNS SHALL BE ORIENTED RADially.
5. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
6. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
7. TRANSITION PANELS REQUIRED WHEN EXISTING CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2% OR WHEN THE WIDTH OF A EXISTING SIDEWALK DOES NOT MATCH THE WIDTH OF THE IMPROVEMENTS.
8. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
9. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
10. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

<b>APPROVED BY</b>  DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		<b>ADOPTED:</b> 08/1991 <b>REVISED:</b> 04/2013 <b>SUPERSEDES:</b> 04/2012 <b>CHECKED BY:</b> JTG <b>SCALE:</b> NTS <b>REVISED BY:</b> LWK		<b>F-105B NOTES</b>	
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.				ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON	
				STANDARD PLAN No. F-105B	

# **PLAN VIEW**

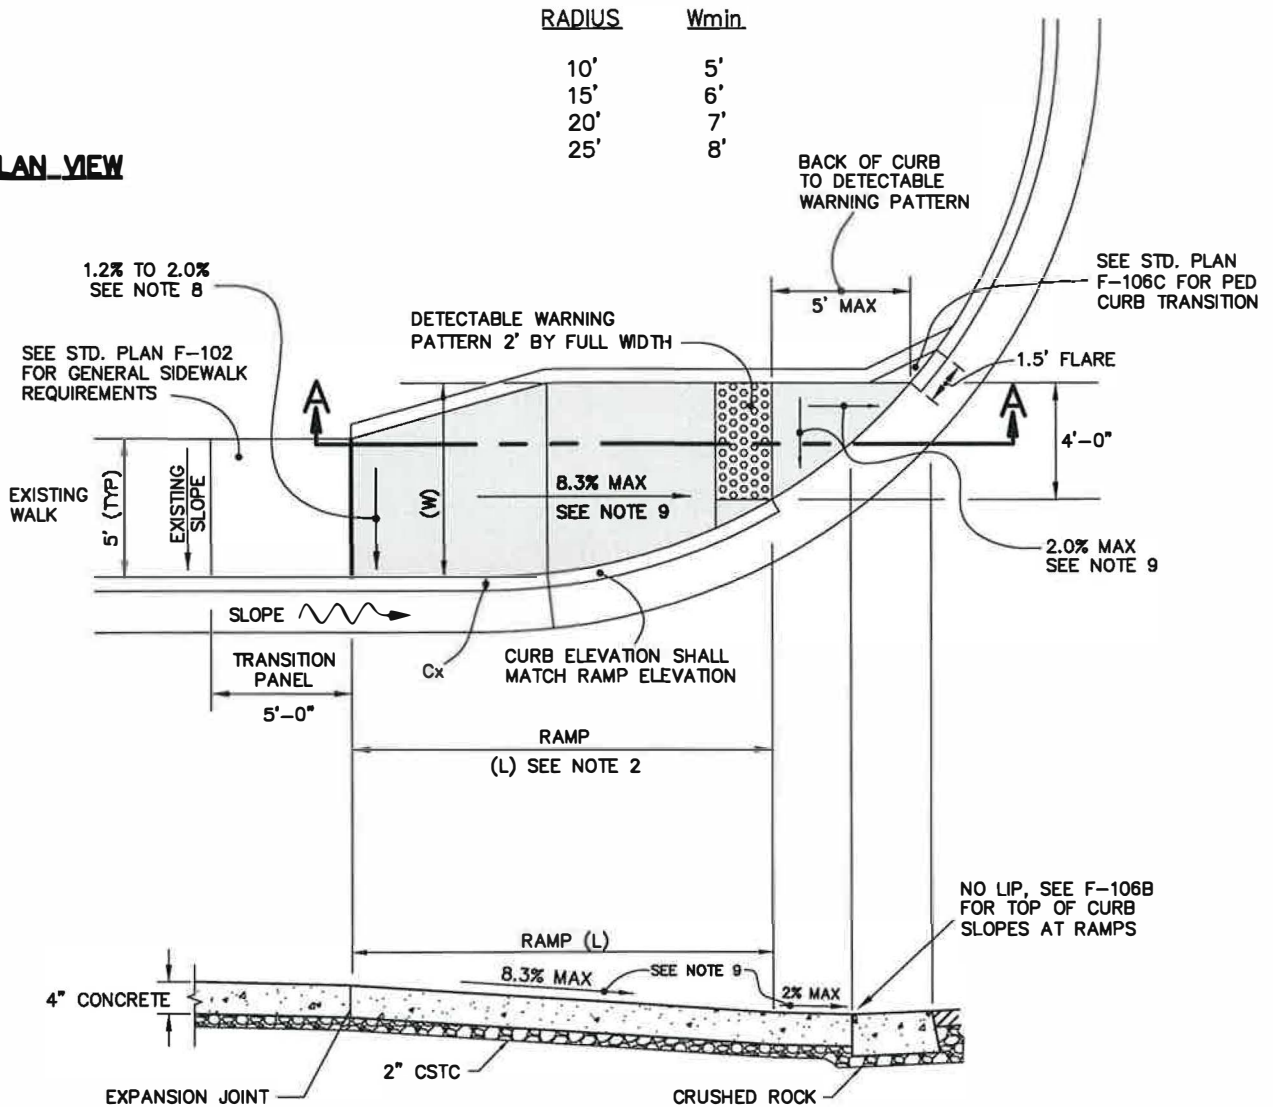

## **SECTION A-A**

$$L = \frac{Cx}{.083 - S}$$

L = RAMP LENGTH (FT)  
Cx = CURB EXPOSURE (FT)  
S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE  
L = 11' UP TO .037 SLOPE  
L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
REVISED: 04/2013  
SUPERSEDES: 04/2012  
CHECKED BY: JTG  
SCALE: NTS  
REVISED BY: LWK




**CURB RAMP TYPE-3  
ADJACENT SIDEWALK**




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-105C

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE AT BASE OF RAMP SHALL BE 2% IN ANY DIRECTION.
4. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
5. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
6. TRANSITION PANELS ARE REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
7. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
8. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
9. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

 APPROVED BY DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 08/1991 REVISED: 04/2013 SUPERSEDES: 04/2012		F-105C NOTES		
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		CHECKED BY: JTG SCALE: NTS REVISED BY: LWK		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON		STANDARD PLAN No. F-105C

# **PLAN VIEW**

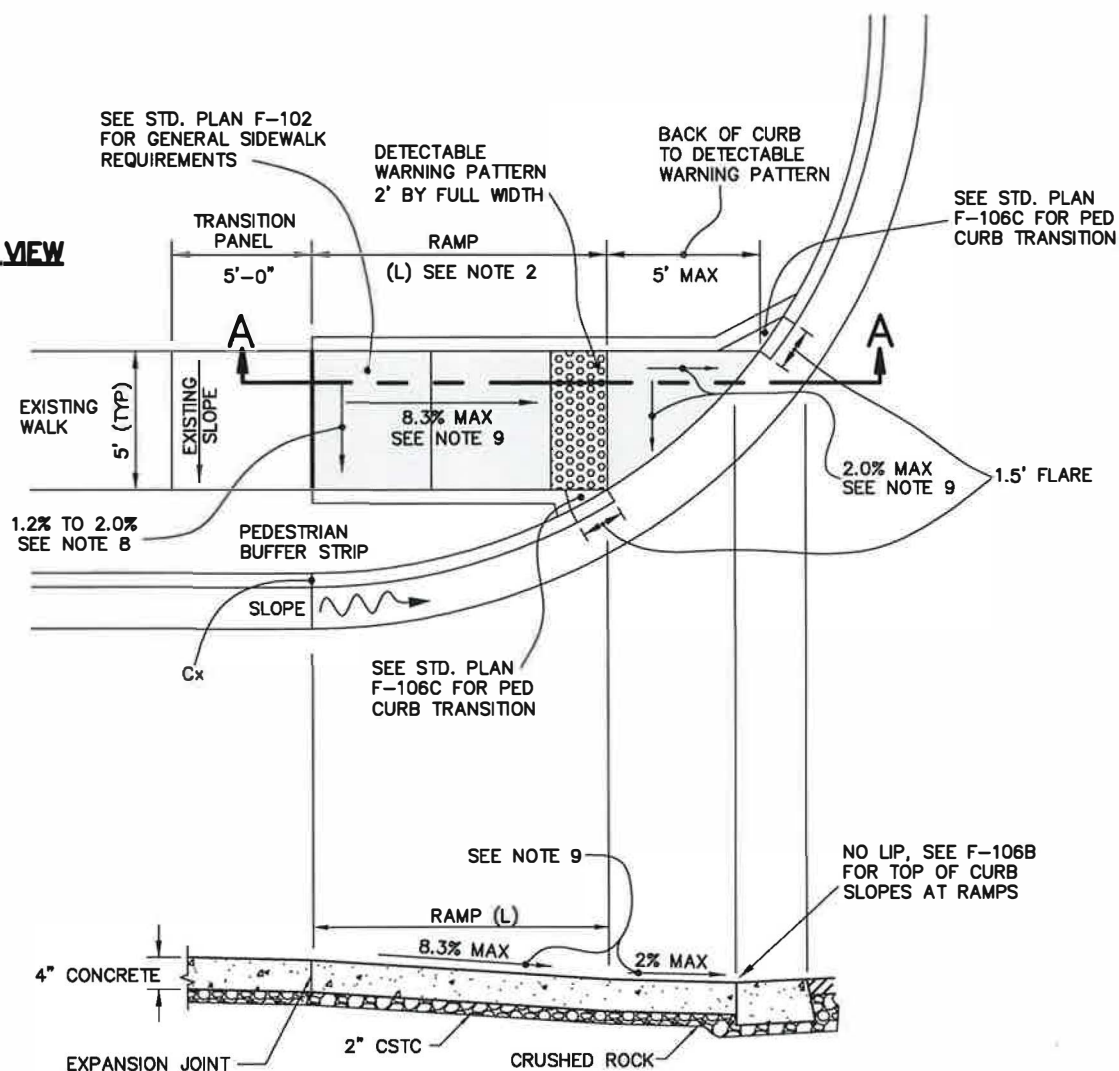

## **SECTION A-A**

L = Cx  
 $.083 - S$

L = RAMP LENGTH (FT)  
 Cx = CURB EXPOSURE (FT)  
 S = GUTTER SLOPE

W/ .5' CURB EXPOSURE

L = 6' UP TO .000 SLOPE  
 L = 11' UP TO .037 SLOPE  
 L = 15' ABOVE .037 SLOPE

THIS TABLE PROVIDES APPROXIMATE DIMENSIONS NECESSARY TO MEET ADA SLOPE REQUIREMENTS. ADJUSTMENTS TO FIT EACH LOCATION WILL BE NECESSARY. FIELD LAYOUT AND SLOPE VERIFICATION IS REQUIRED.

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.

PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
 REVISED: 04/2013  
 SUPERSEDES: 04/2012

CHECKED BY: JTG  
 SCALE: NTS  
 REVISED BY: LWK




**CURB RAMP TYPE-3  
 SEPARATED SIDEWALK**




ENGINEERING SERVICES  
 CITY OF SPOKANE, WASHINGTON


STANDARD  
 PLAN No.  
**F-105D**

1. CURB RAMPS SHALL BE CONSTRUCTED USING AIR-ENTRAINED 6-SACK COMMERCIAL CONCRETE.
2. MINIMUM RAMP LENGTH (L) IS 6 FEET. MAXIMUM RUNNING SLOPE IS 8.3%. THE RAMP LENGTH SHALL BE INCREASED INCREMENTALLY FROM 6 FT. TO 11 FT. TO 15 FT. AS NEEDED TO ACHIEVE A SLOPE OF 8.3% OR LESS. IF THE ADJACENT ROADWAY GRADE IS SUCH THAT THE CURB RAMP SLOPE CANNOT BE ACHIEVED IN 15 FEET, THE CURB RAMP LENGTH MAY BE LIMITED TO 15 FT.; HOWEVER, THIS REQUIRES A DESIGN DEVIATION APPROVAL BY THE CITY ENGINEER.
3. MAXIMUM SLOPE AT BASE OF RAMP SHALL BE 2% IN ANY DIRECTION.
4. DO NOT PLACE DRAINAGE STRUCTURES, JUNCTION BOXES, OR OTHER OBSTRUCTIONS IN FRONT OF RAMP ACCESS OR ON ANY PART OF LANDING.
5. SEE CITY OF SPOKANE SPECIFICATIONS FOR DETECTABLE WARNING SURFACE PRODUCT & COLOR REQUIREMENTS.
6. TRANSITION PANELS ARE REQUIRED WHEN CROSS SLOPE OF EXISTING SIDEWALK EXCEEDS 2%.
7. SEE STANDARD PLANS F-102, F-102A, F-106, F-106B, F-106C, & G-107 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
8. 1.2% MINIMUM CROSS SLOPE AND 2.0% MAXIMUM CROSS SLOPE. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.
9. NO ADDITIONAL CONSTRUCTION TOLERANCE IS ALLOWED.

 APPROVED BY DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.		ADOPTED: 08/1991 REVISED: 04/2013 SUPERSEDES: 04/2012		F-105D NOTES		
 PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.		CHECKED BY: JTG SCALE: NTS REVISED BY: LWK		 ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON		STANDARD PLAN No. F-105D

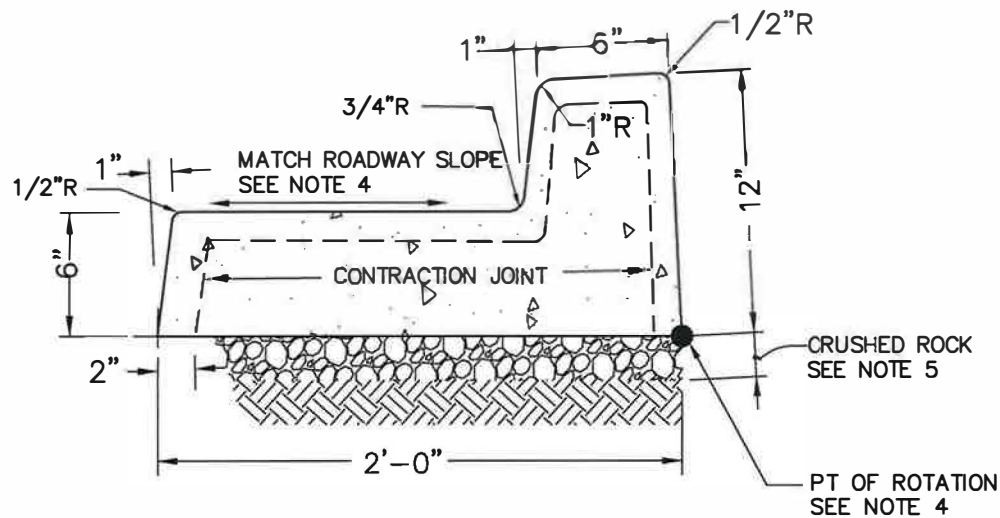

**CONCRETE CURB/GUTTER**

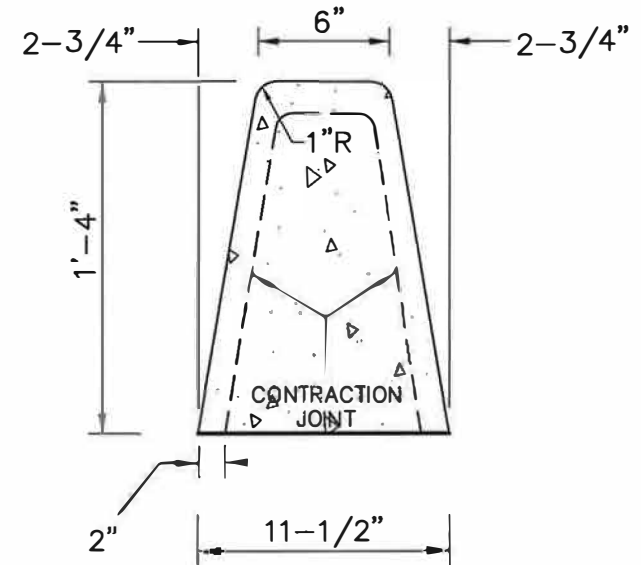


**CONCRETE CURB**


**NOTES:**

1. CONCRETE CURB & CURB/GUTTER SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.
2. EXPANSION JOINTS SHALL USE A 3/8" PREMOLDED JOINT FILLER. EXPANSION JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE CURB OR CURB/GUTTER & PLACED BETWEEN EXISTING & NEW CONCRETE WHERE SIDEWALKS, DRIVEWAYS, CURB, & CURB/GUTTER ARE REMOVED FOR NEW CONSTRUCTION.
3. CONTRACTION JOINTS SHALL BE HAND TOOLED 1/4" WIDE BY 2" MINIMUM DEPTH SPACED AT MAX. 15'-0" O.C.
4. THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ROADWAY. THEREFORE, THE CURB/GUTTER SHALL BE ROTATED ACCORDINGLY.
5. PROVIDE COMPACTED CRUSHED ROCK UNDERNEATH CURB/GUTTER TO THE LIMITS SHOWN ON STD PLAN W-102.
6. SEE STD PLAN F-106B FOR CURB AND CURB/GUTTER DETAILS AT CURB RAMPS AND DRIVEWAYS.


APPROVED BY	
	
DIRECTOR, ENGINEERING SERVICES	PERRY M. TAYLOR, P.E.
	
PRINCIPAL ENGINEER, CONST.	KENNETH M. BROWN, P.E.

ADOPTED: 2/1990
REVISED: 04/2012
SUPERSEDES: 01/2009
CHECKED BY: SJS
SCALE: NTS
REVISED BY: DSH

CONCRETE CURB AND CURB / GUTTER	
	ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON
STANDARD PLAN No. F-106	

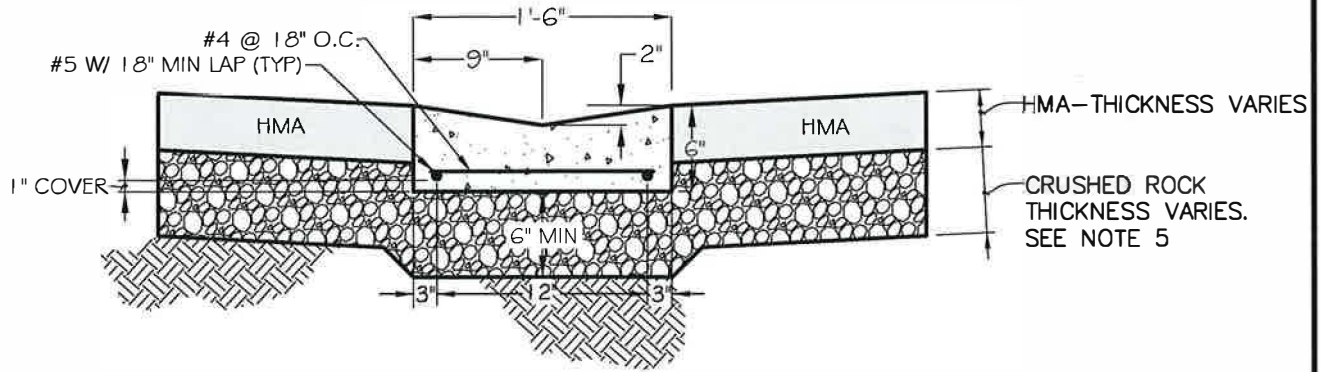

**CONCRETE "V" GUTTER**  
RECOMMENDED FOR USE IN A PARALLEL  
ORIENTATION W/CURB & GUTTER

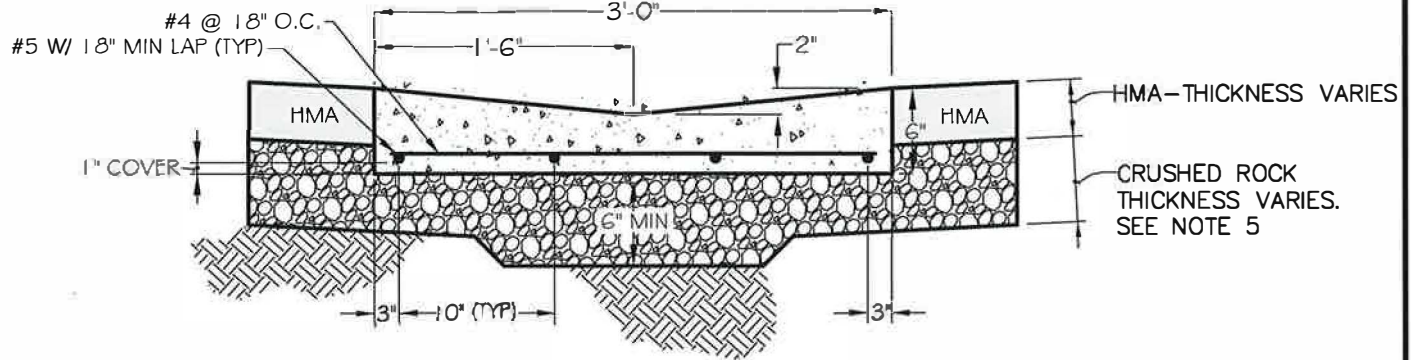

**CONCRETE "V" GUTTER**  
RECOMMENDED FOR USE ACROSS A  
STREET HEADER

**NOTES:**

1. CONCRETE GUTTER SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE IN ACCORDANCE W/ 6-02.3(2)B.
2. SEE SEC 8-04 FOR CONC GUTTER.
3. SEE STD PLANS F-103 THROUGH F-104B FOR CONC DRIVEWAYS
4. EXPANSION (ISOLATION) JOINTS SHALL USE A 3/8" MIN PREMOLDED JOINT FILLER PER SEC 9-04.1(2). JOINTS SHALL EXTEND THROUGH THE FULL CROSS-SECTION OF THE CURB OR CURB/GUTTER & PLACED BETWEEN EXISTING & NEW CONCRETE WHERE SIDEWALKS, DRIVEWAYS, CURB, & CURB/GUTTER ARE REMOVED FOR NEW CONSTRUCTION. A TOOLED CONTRACTION (CONTROL) JOINT SHALL BE PLACED ACROSS THE CURB OR CURB/GUTTER AND SPACED AT A MAX. 15'-0" O.C.
5. PROVIDE COMPACTED CRUSHED ROCK UNDERNEATH GUTTER TO THE PAYMENT LIMITS & REQ'MTS PER STD PLAN W-102. CRUSHED ROCK THICKNESS IS DEPENDENT UPON THE STREET SECTION THICKNESS.

APPROVED BY  
  
DIRECTOR, ENGINEERING SERVICES P. MIKE TAYLOR, P.E.  
  
PRINCIPAL ENGINEER, DESIGN GARY S. NELSON, P.E.


ADOPTED: 09/2010  
REVISED: 04/2012  
SUPERSEDES: -  
CHECKED BY: JAG  
SCALE: NTS  
DWG/REV. BY: MBM/SRM




**CONCRETE "V" GUTTERS**

ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON


STANDARD  
PLAN No.  
F-106A

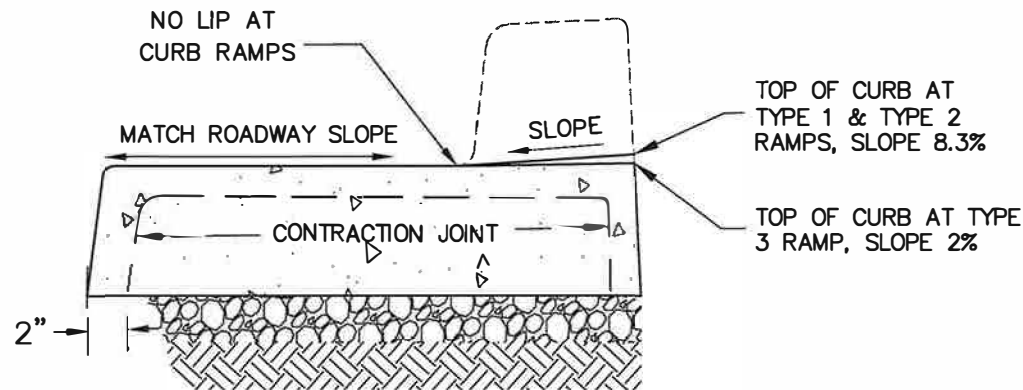


**CONCRETE CURB/GUTTER @ CURB RAMP**

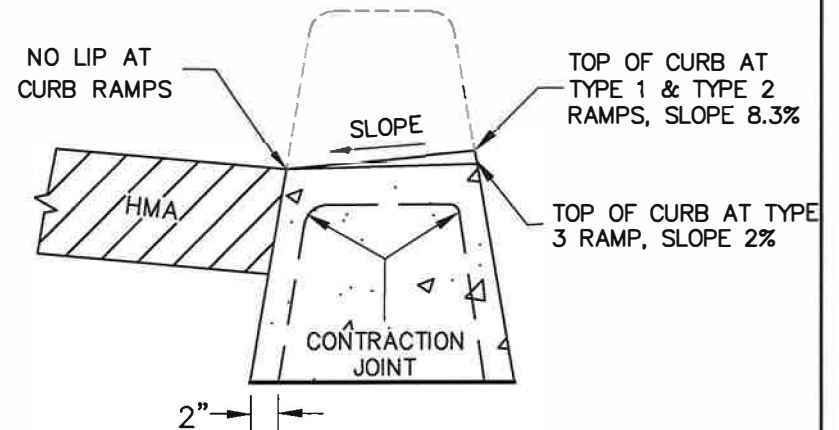

**CONCRETE CURB @ CURB RAMP**

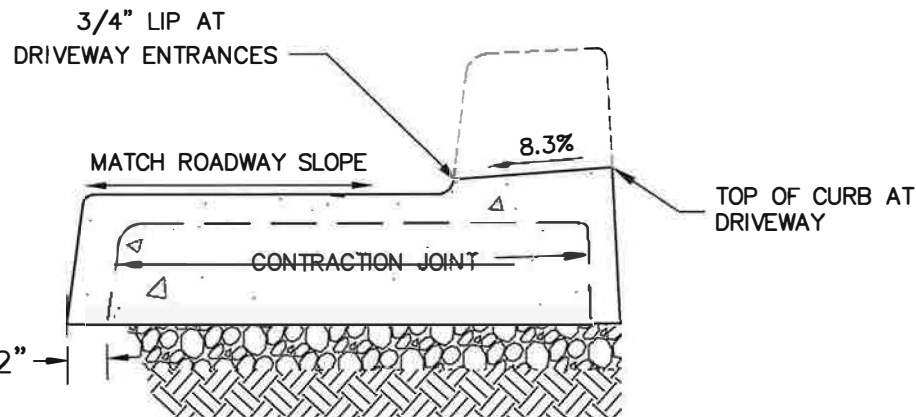

**CONCRETE CURB/GUTTER @ DRIVEWAY**

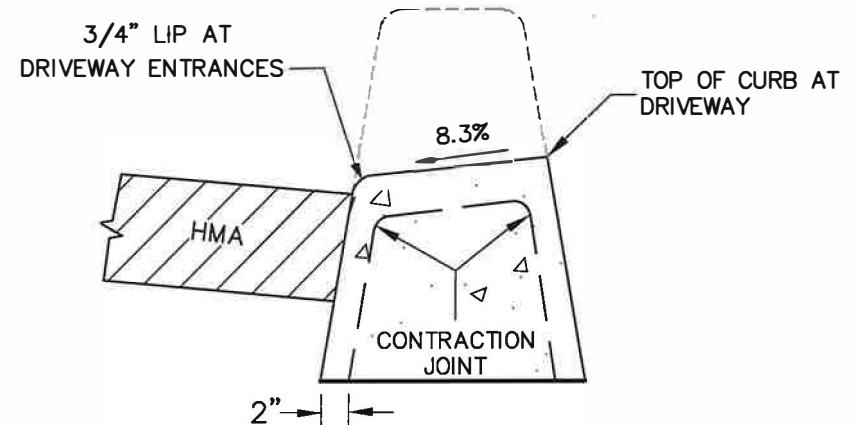

**CONCRETE CURB @ DRIVEWAY**

**NOTES:**

1. CONCRETE CURB & CURB/GUTTER SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE.


APPROVED BY	
	PERRY M. TAYLOR, P.E.
DIRECTOR, ENGINEERING SERVICES	
	KENNETH M. BROWN, P.E.
PRINCIPAL ENGINEER, CONST.	

ADOPTED: 04/2012
REVISED:
SUPERSEDES:
CHECKED BY: SJS
SCALE: NTS
REVISED BY: DSH


**CURB AND CURB/GUTTER @  
CURB RAMPS AND DRIVEWAYS**

**ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON**

**STANDARD  
PLAN No.  
F-106B**

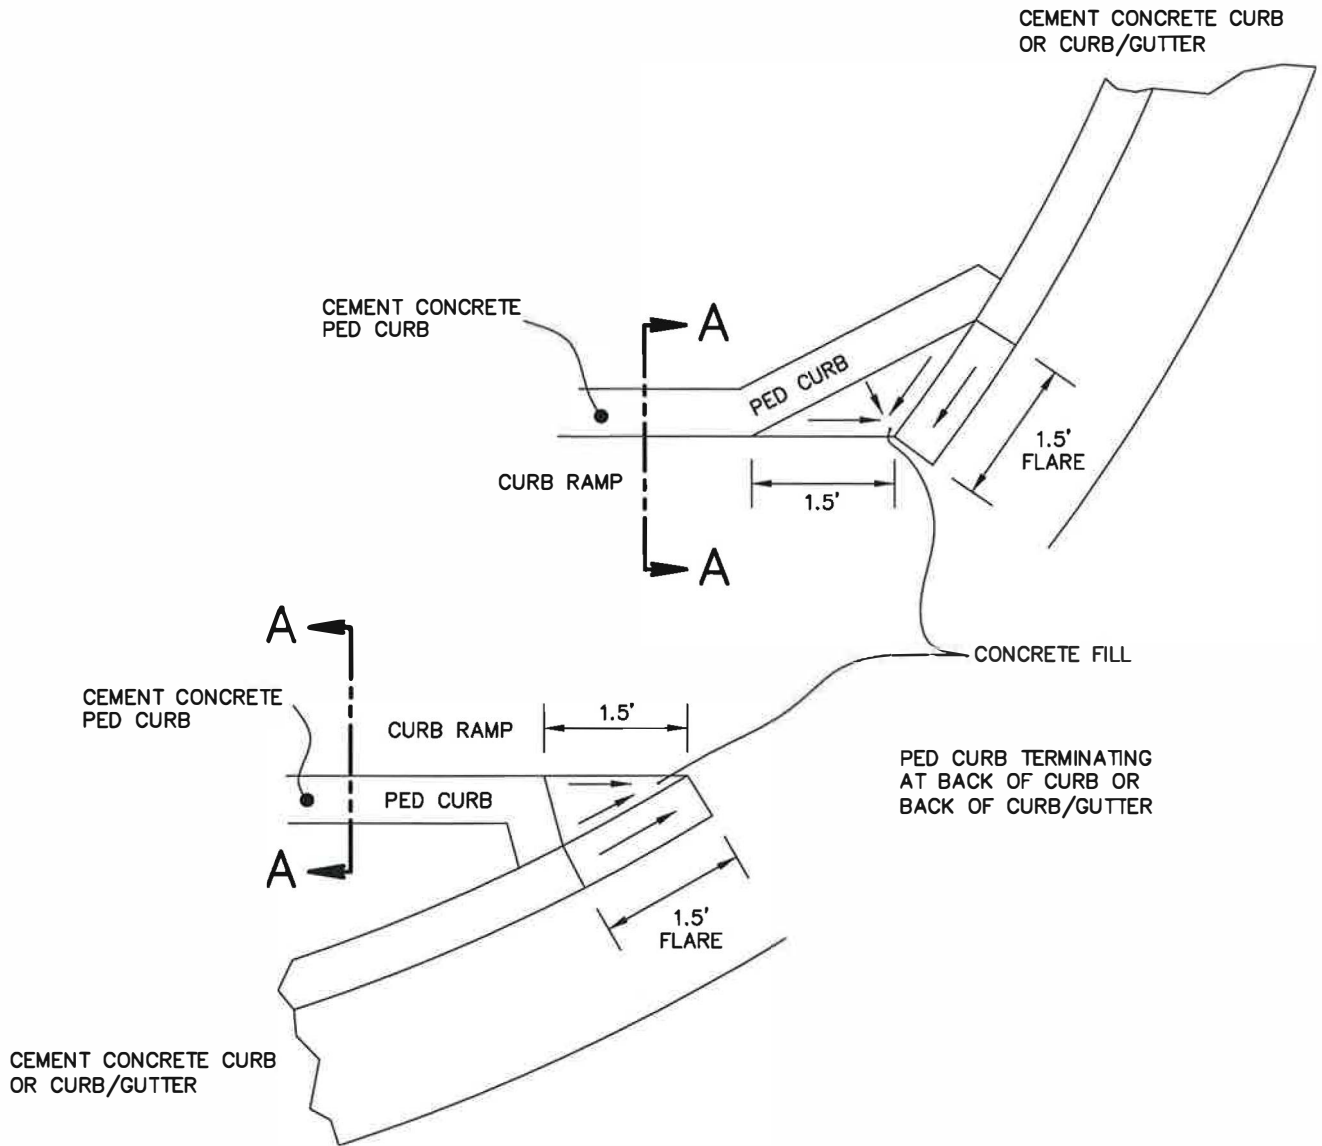

**SECTION VIEW**

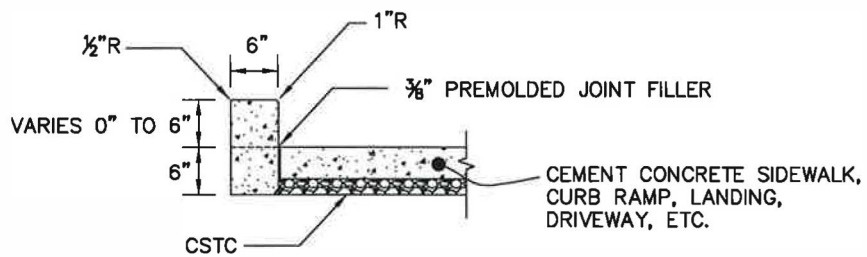

**SECTION A-A**

**CEMENT CONCRETE PED CURB**

APPROVED BY

DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.


PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 08/1991  
 REVISED: 04/2013  
 SUPERSEDES: 04/2012  
 CHECKED BY: JTG  
 SCALE: NTS  
 REVISED BY: LWK





ENGINEERING SERVICES  
 CITY OF SPOKANE, WASHINGTON

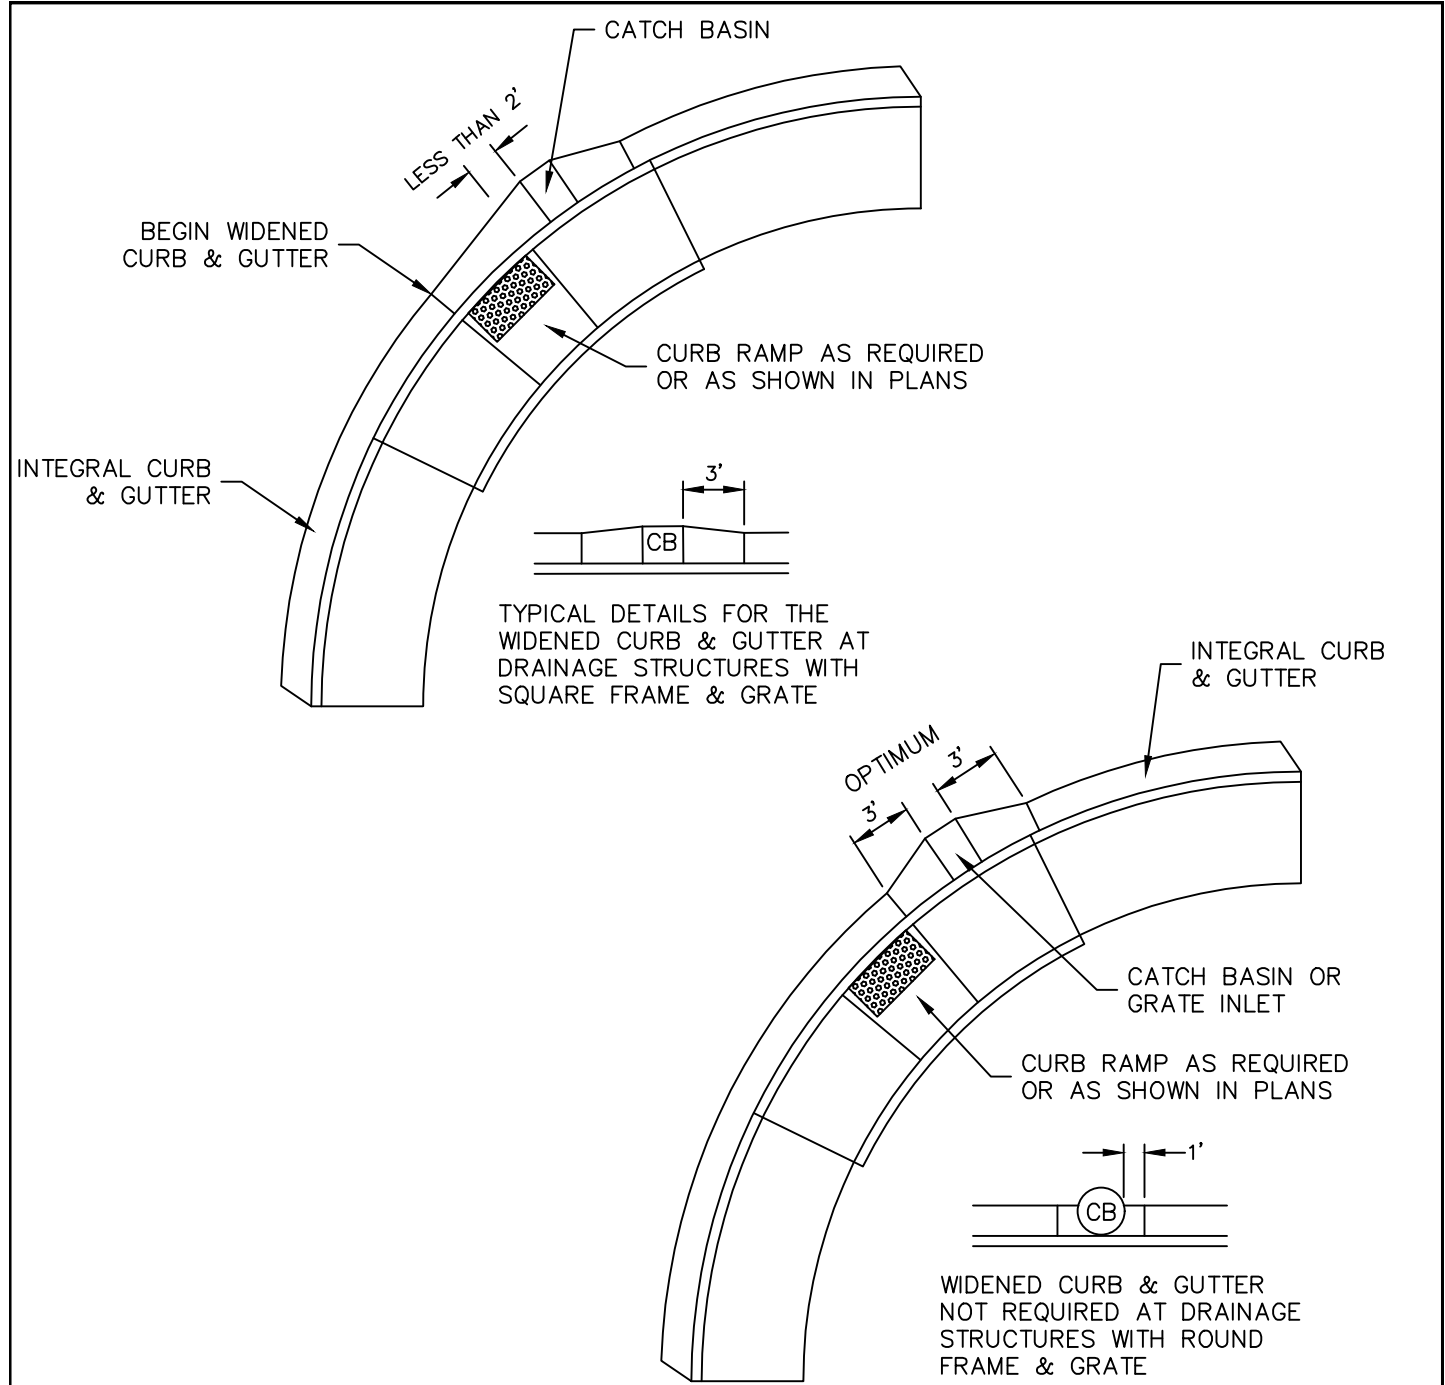
STANDARD  
 PLAN No.  
 F-106C



NOTES


1. DRAINAGE STRUCTURES SHALL NOT BE INSTALLED WITHIN THE LANDING AREA OF CURB RAMPS. ROTATION OF RAMP MAY BE REQUIRED.
2. WIDENED CURB & GUTTER SHALL TERMINATE AT CONTROL JOINTS.
3. WHERE CURB REMOVED FOR RAMP INSTALLATION, REPLACEMENT CURB SHALL BE CURB/GUTTER, MATCHING ADJACENT CURB EXPOSURE MAY REQUIRE MANUAL FORMING OF CURB/GUTTER.
4. 45° ALL ENDS OF GUTTER.

<p>APPROVED BY</p>  <p>DIRECTOR OF ENGINEERING SERVICES DAN BULLER, P.E.</p>	<p>ADOPTED: _____</p> <p>REVISED: 04/2025</p> <p>SUPERSEDES: 03/2018</p> <p>CHECKED BY: JAG</p> <p>SCALE: NTS</p> <p>REVISED BY: MLD</p>	<p><b>CURB/GUTTER</b> <b>AT DRAINAGE STRUCTURE</b></p>	
		<p>ENGINEERING SERVICES CITY OF SPOKANE, WASHINGTON</p>	<p>STANDARD PLAN No. <b>F-106D</b></p>

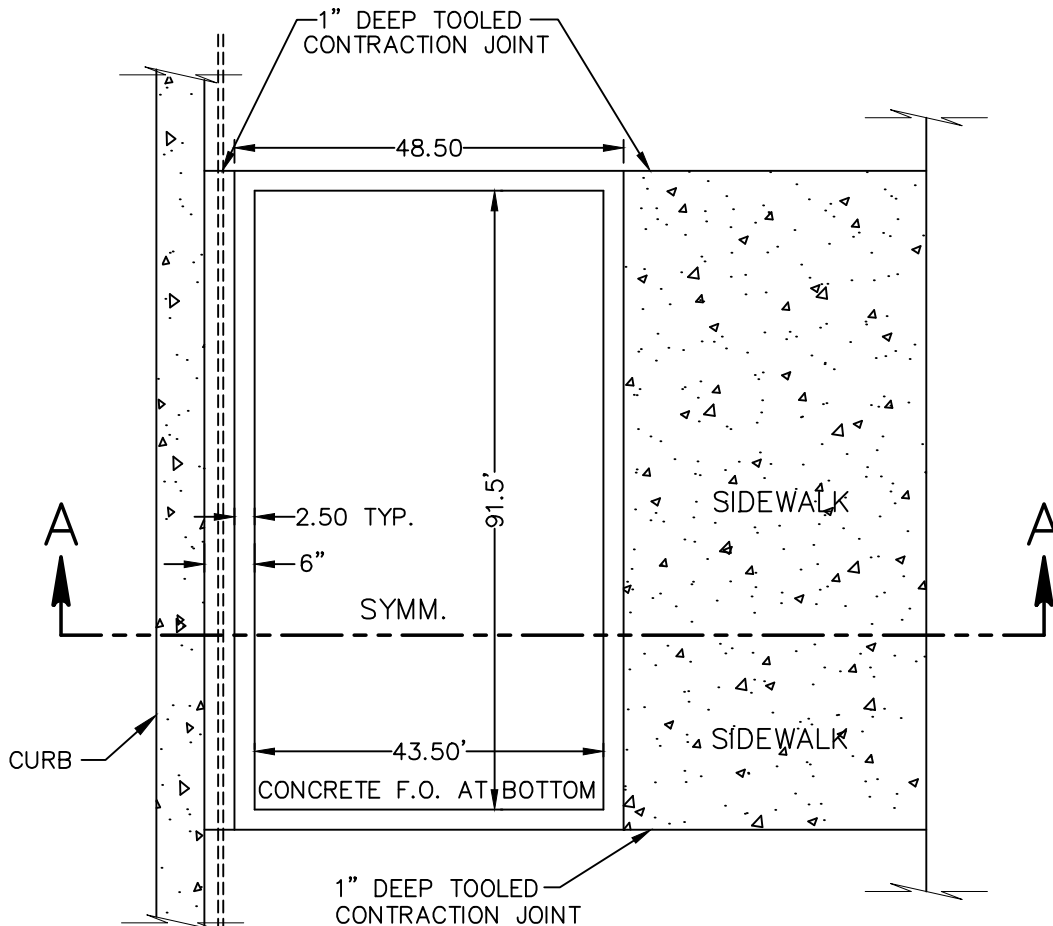


PLAN

2 - #4 REBAR  
LENGTH= TREE WELL + 4  
FEET, PLACE IN SIDEWALK  
STRIP CENTERED ON TREE  
WELL

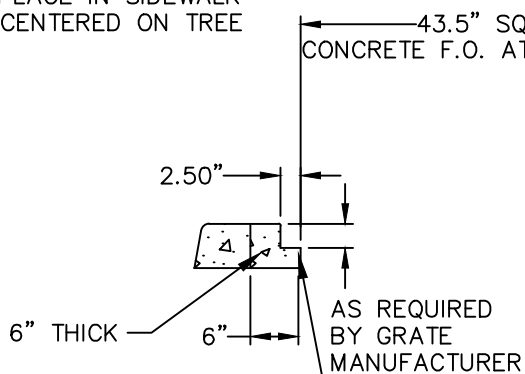

SECTION A-A

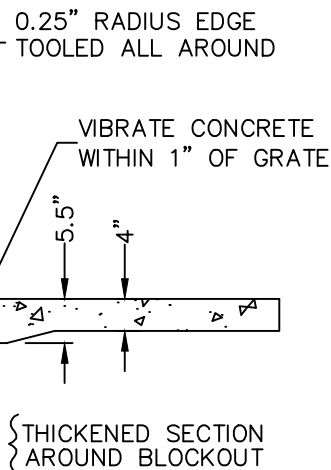


**IMPORTANT !**  
APPLY PARTING  
COMPOUND TO ALL  
SURFACES OF OPENING  
PRIOR TO POURING THE  
CONCRETE FILL.

**NOTE:**

THE GRATE UNIT FOR THE TREE WELL SHALL CONSIST OF 4-GRATE SECTIONS. EACH GRATE SECTION SHALL MEASURE 24"X48"X1-1/4" AND BE CONSTRUCTED OF GRAY CAST IRON, CLASS 30 W/ A MINIMUM WEIGHT OF 150 LBS/SECTION OR 300 LBS/UNIT. EQUAL OR BETTER CORROSION RESISTANCE MATERIAL MAY BE SUBSTITUTED UPON PRIOR APPROVAL OF THE ENGINEER.

APPROVED BY

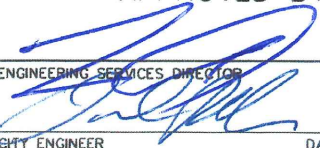  
ENGINEERING SERVICES DIRECTOR  
KYLE TWOHIG  
CITY ENGINEER  
DAN BULLER, P.E.


ADOPTED: \_\_\_\_\_  
REVISED: 10/2019  
SUPERSEDES: 04/2018  
CHECKED BY: JAG  
SCALE: NTS  
REVISED BY: DCB/MLD

**TREE WELL BLOCKOUT  
FOR 4' X 8' METAL GRATE**



ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
**F-107**

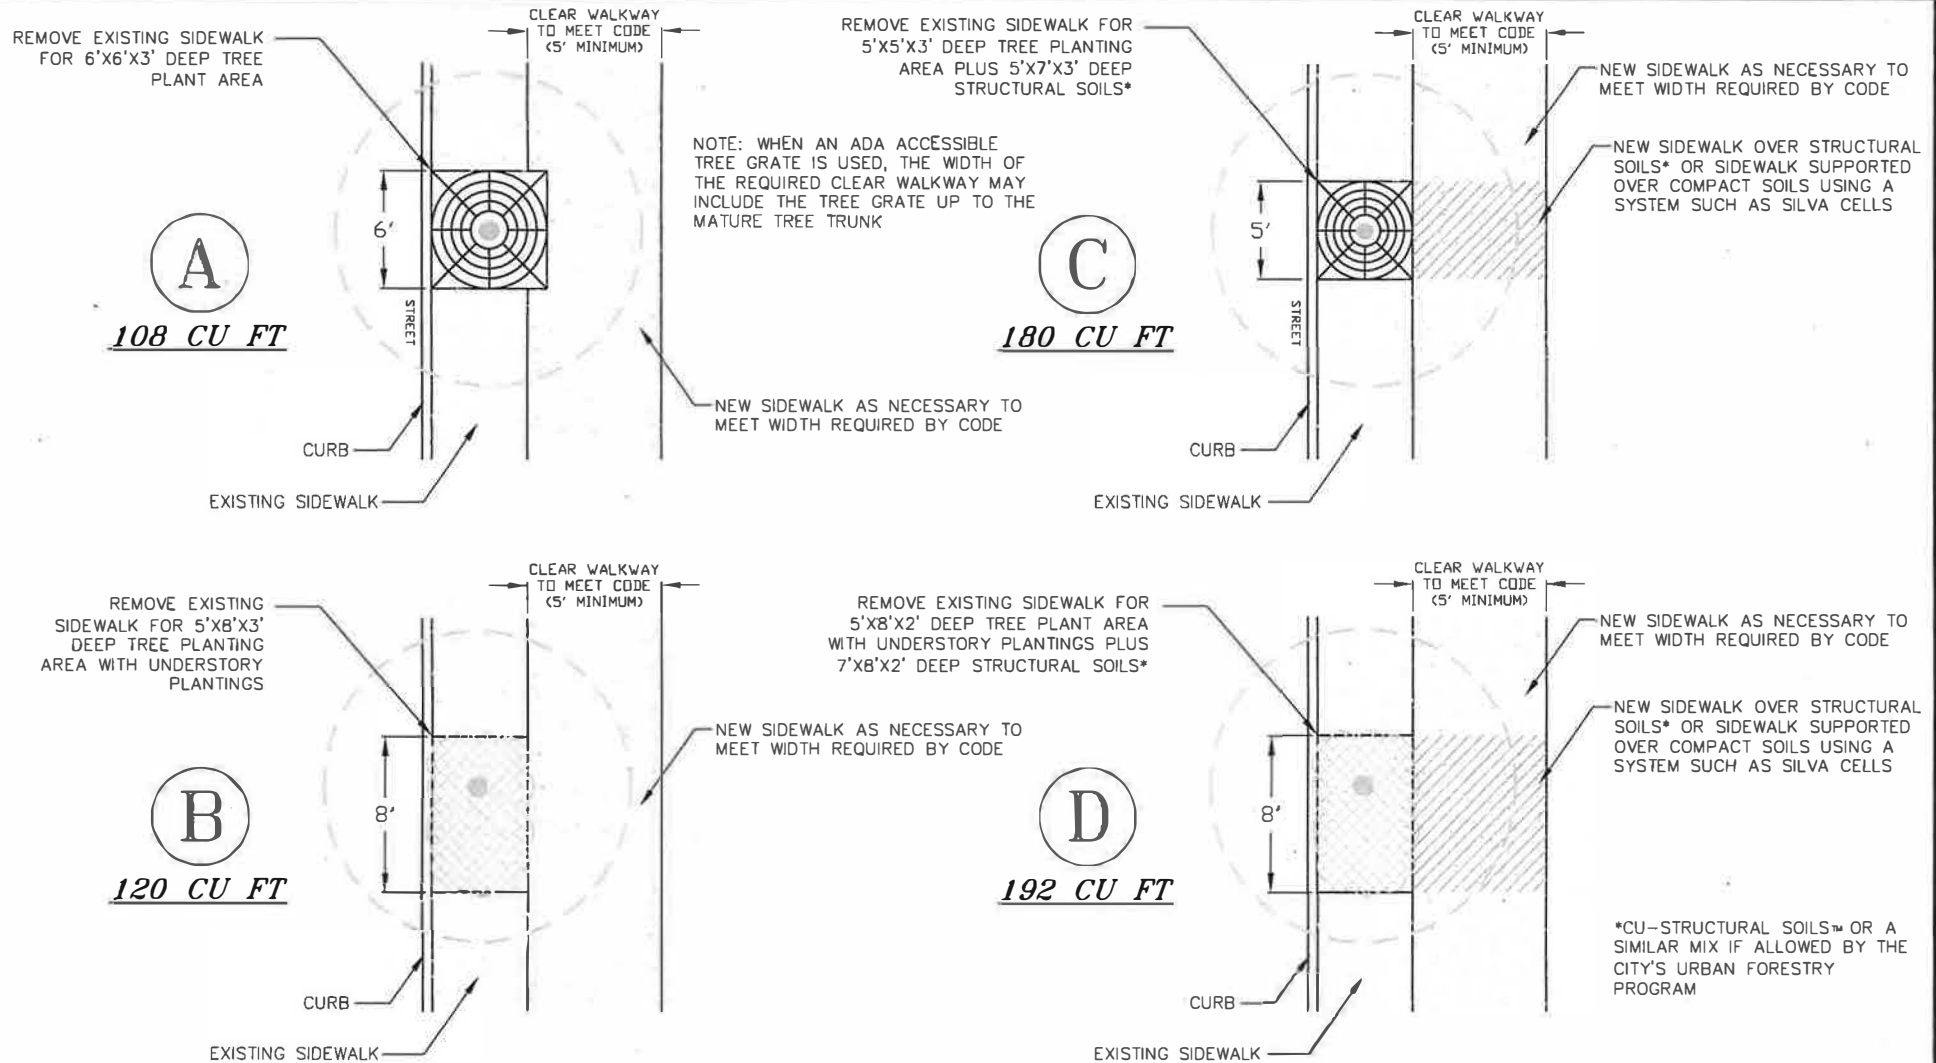

\*CU-STRUCTURAL SOILS™ OR A SIMILAR MIX IF ALLOWED BY THE CITY'S URBAN FORESTRY PROGRAM

**EXISTING SIDEWALK RETROFIT - POSSIBLE OPTIONS TO PROVIDE 100 CU FT OF UNCOMPACTED SOIL FOR STREET TREES.**

SOIL IS THE KEY FACTOR FOR TREE HEALTH, BUT IN AN URBAN SETTING IT'S ALMOST IMPOSSIBLE TO PROVIDE IDEAL SOIL VOLUMES. THE CITY OF SPOKANE HIGHLY ENCOURAGES BUILDING PERMIT APPLICANTS TO CONSIDER PROVIDING AS MUCH UNCOMPACTED SOIL AS POSSIBLE FOR TREES, AND REQUIRES AT LEAST 100 CU FT (MAX 3' DEPTH MAY BE FACTORED INTO VOLUME). A PERMIT IS NECESSARY TO PLANT A TREE IN PUBLIC RIGHT OF WAY; PLEASE CONTACT THE URBAN FORESTRY PROGRAM AT (509) 363-5470. COURTESY OF THE URBAN DESIGN SECTION OF THE PLANNING SERVICES DEPARTMENT.

APPROVED BY  
  
DIRECTOR, ENGINEERING SERVICES P. MIKE TAYLOR, P.E.  
  
PRINCIPAL ENGINEER, DESIGN GARY S. NELSON, P.E.

ADOPTED: 09/2010  
REVISED: \_\_\_\_\_  
SUPERSEDES: \_\_\_\_\_  
CHECKED BY: JAG  
SCALE: NTS  
DWG/REV. BY: MBM

**EXISTING SIDEWALK RETROFIT  
OPTIONS FOR STREET TREE INSTALLATION**




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-107A

2" TRIANGLE, 1/4" DEPTH  
STAMPED INTO TROWELED  
EDGE OF WALK, BOTH  
SIDES OF SIDEWALK

2" MIN PVC SLEEVE EXTENDED  
6" OUTSIDE SIDEWALK  
NOTE: SLEEVES CAN BE  
LOCATED AS REQUIRED


PLACE PVC CAP  
OVER EACH END  
OF SLEEVE (TYP)

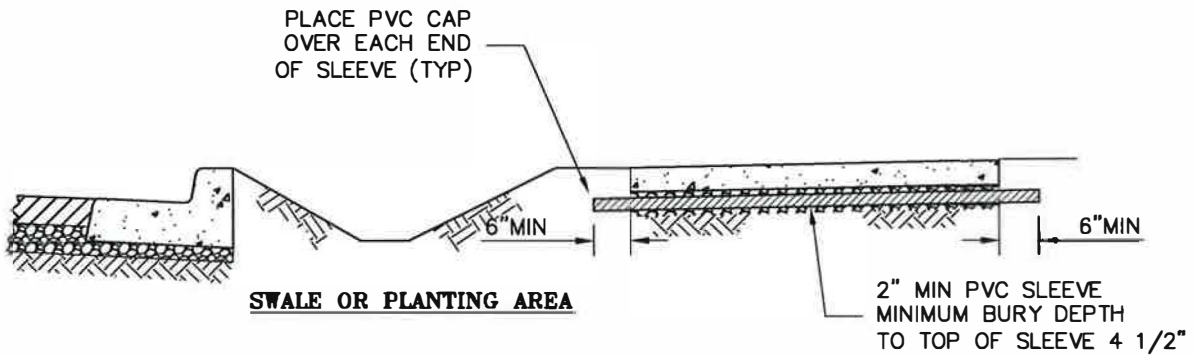

**NOTES:**

1. SEE STD PLAN F-102 FOR GENERAL SIDEWALK REQUIREMENTS.
2. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR SIDEWALK WIDTH REQUIREMENTS.
3. SEE CITY OF SPOKANE DESIGN STANDARDS SECTION 3 FOR PEDESTRIAN BUFFER STRIP WIDTH REQUIREMENTS
4. SEE STD PLAN B-102F FOR BIO-INFILTRATION SWALE REQUIREMENTS.

APPROVED BY

  
KYLE TWOHIG  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.

ADOPTED: 07/2014

REVISED:

SUPERSEDES:

CHECKED BY: DAB

SCALE: NTS




REVISED BY: RJS/LWK

**MARKING IRRIGATION SLEEVES**




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-107B

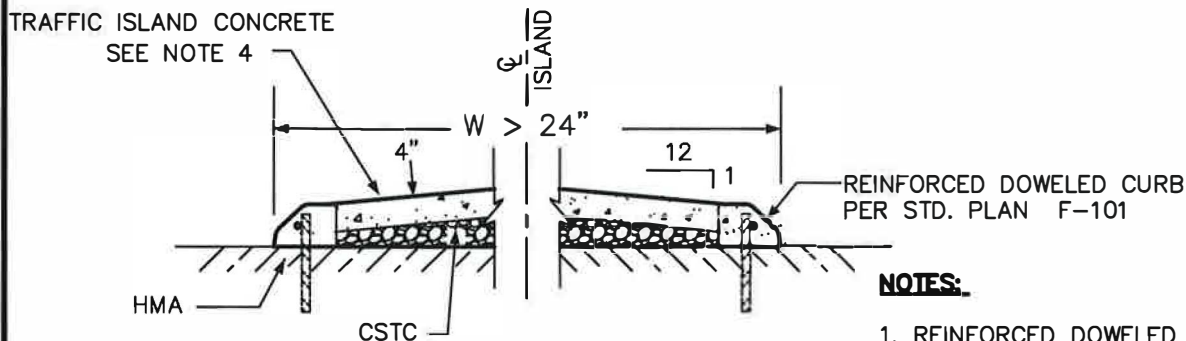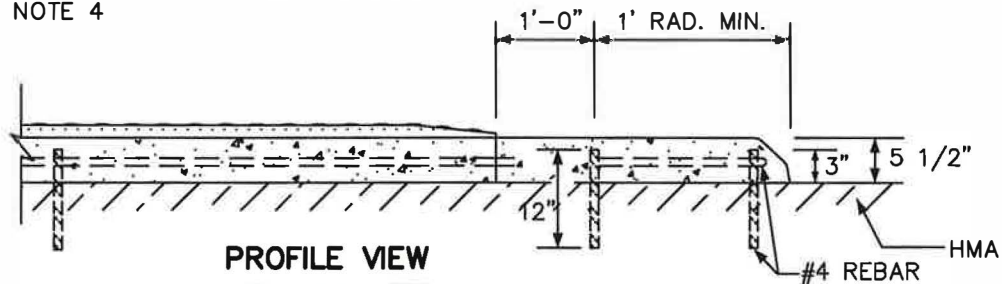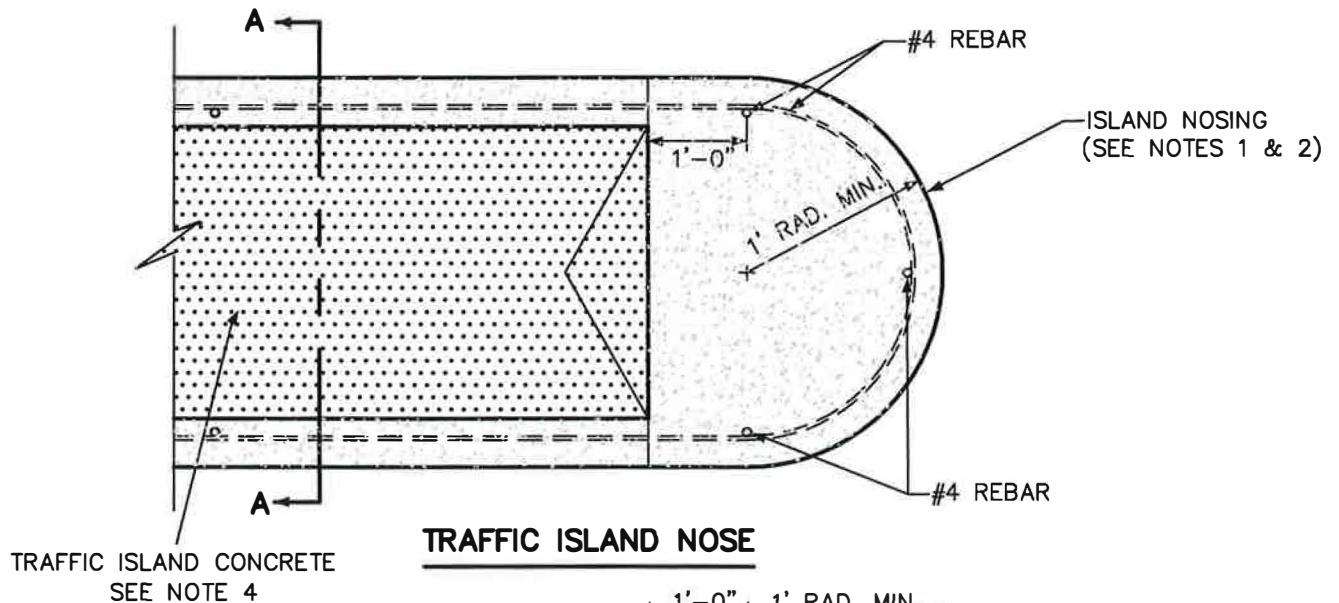

**SECTION A - A**

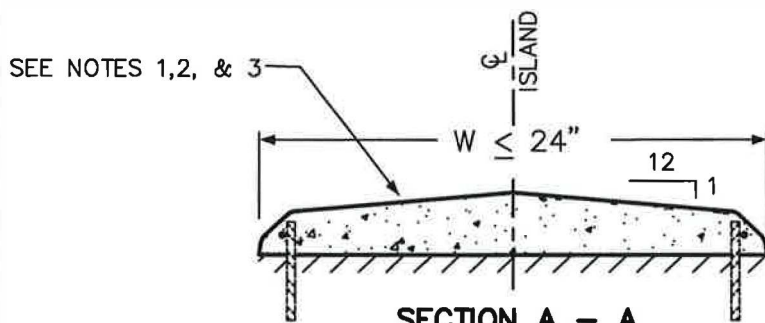

**SECTION A - A**

**NOTES:**

1. REINFORCED DOWELED CURB & ISLAND NOSINGS SHALL BE CONSTRUCTED W/ AIR ENTRAINED CONCRETE, CLASS 4000 W/ A BROOM FINISH.
2. TRAFFIC ISLANDS WITH WIDTHS < 24" REQUIRE APPROVAL BY THE CITY ENGINEER
3. TRAFFIC ISLANDS WITH WIDTHS ≤ 24" SHALL BE CONSTRUCTED AS A SOLID UNIT USING AIR-ENTRAINED CLASS 4000 CONCRETE W/ A BROOM FINISH.
4. TRAFFIC ISLAND CONCRETE SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE W/ A BROOM FINISH

APPROVED BY  
  
DIRECTOR, ENGINEERING SERVICES PERRY M. TAYLOR, P.E.  
  
PRINCIPAL ENGINEER, CONST. KENNETH M. BROWN, P.E.



ADOPTED: 6/1992  
REVISED: 04/2012  
SUPERSEDES: 05/2007  
CHECKED BY: SJS  
SCALE: NTS  
REVISED BY: DSH

**TRAFFIC ISLAND**




ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
F-108

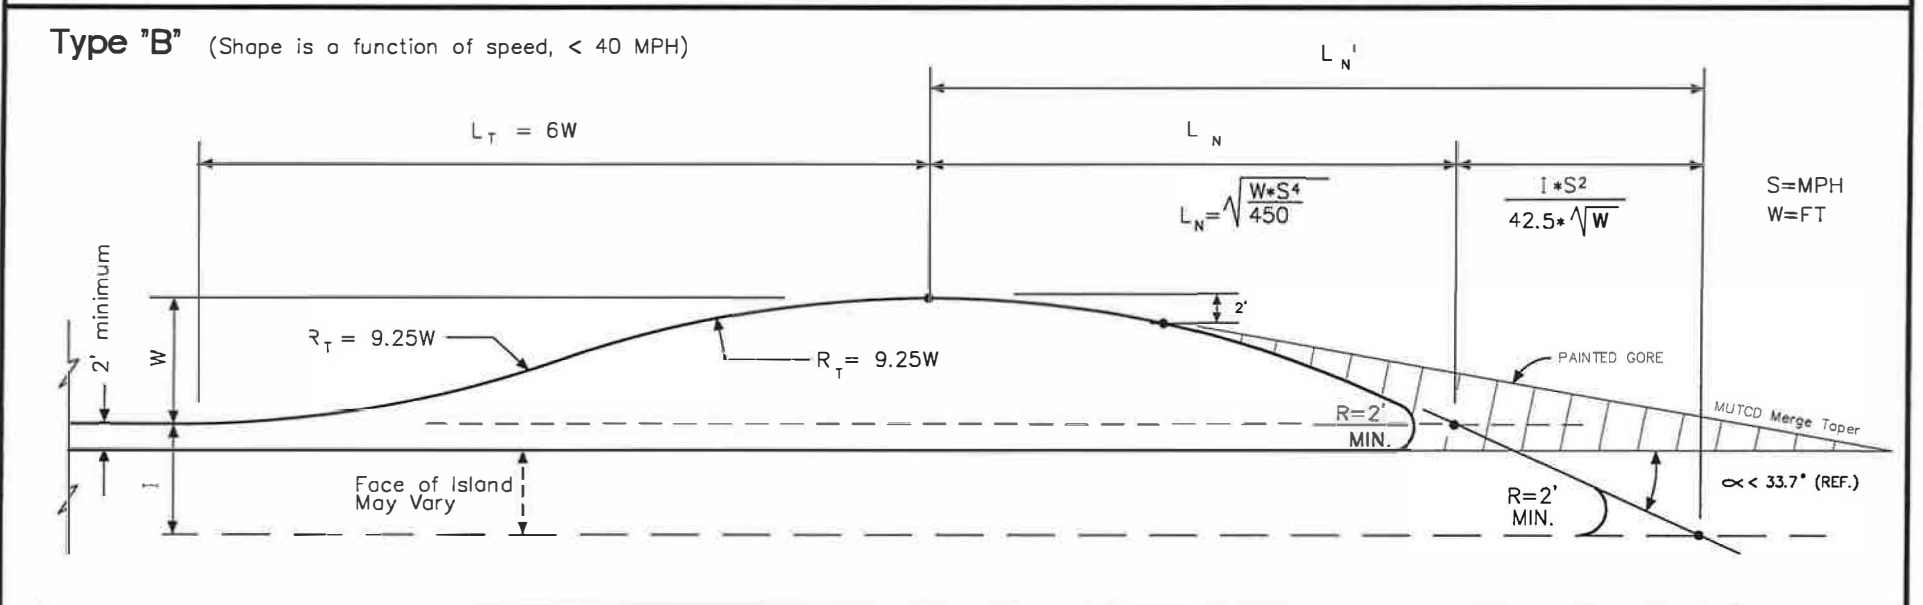
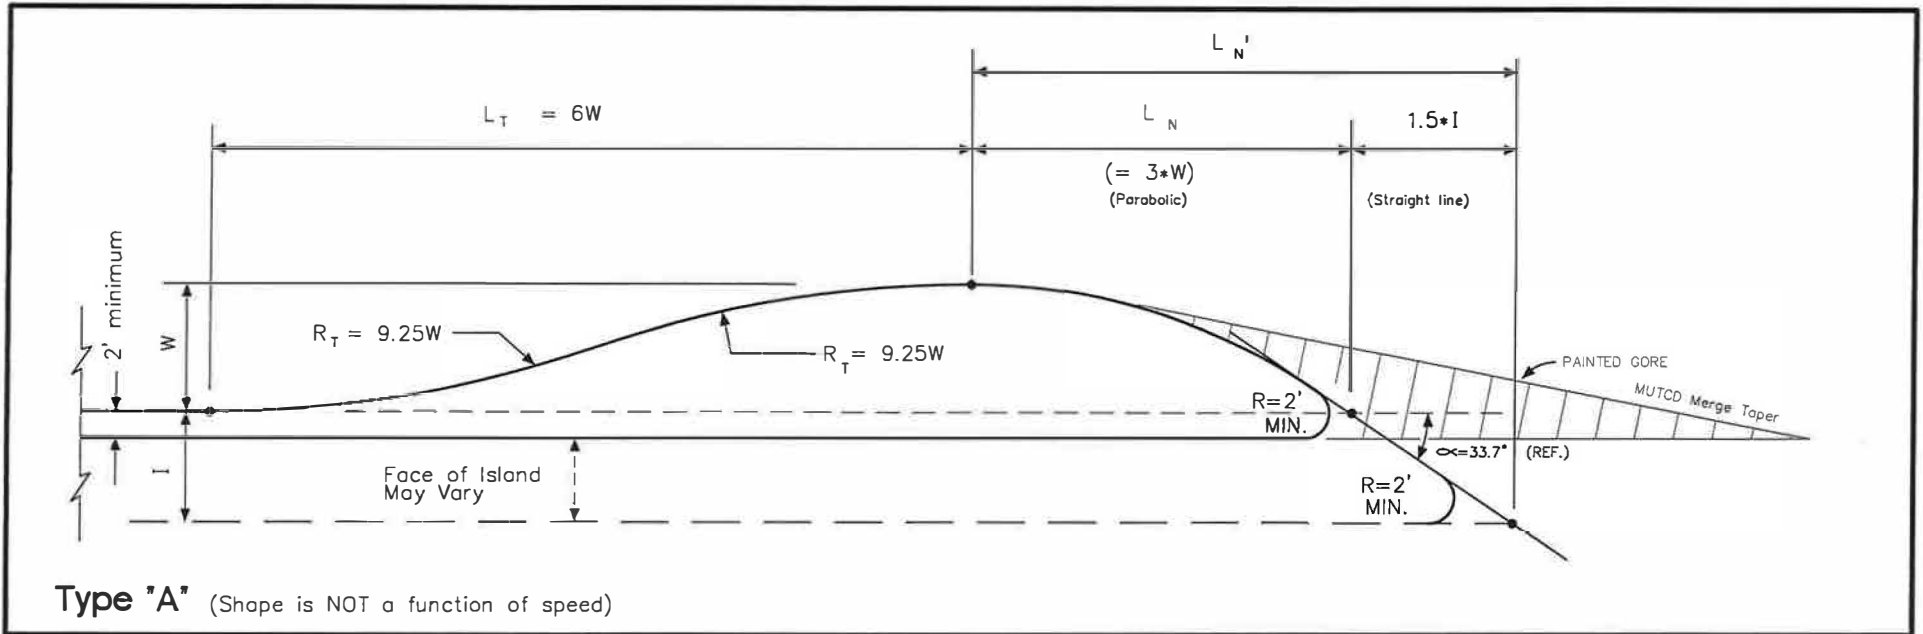


<p><b>APPROVED BY</b></p> <p><i>Brad Blegen</i> CITY ENGINEER</p> <p><i>Larry Neil</i> SUPERVISORY ENGINEER, DESIGN</p> <p>BRAD BLEGEN, P.E.</p> <p>LARRY NEIL, P.E.</p>	<p>SCALE <u>NONE</u></p> <p>ADOPTED <u>3/94</u></p> <p>REVISED <u>    </u></p> <p>SUPERSEDES <u>    </u></p>	<p><b>TRAFFIC ISLAND POCKET AND NOSING PARAMETERS</b></p> <p>DEPT. OF PUBLIC WORKS ENGR. DIVISION SPOKANE, WA</p> <p>STANDARD PLAN No. F-108A</p>	

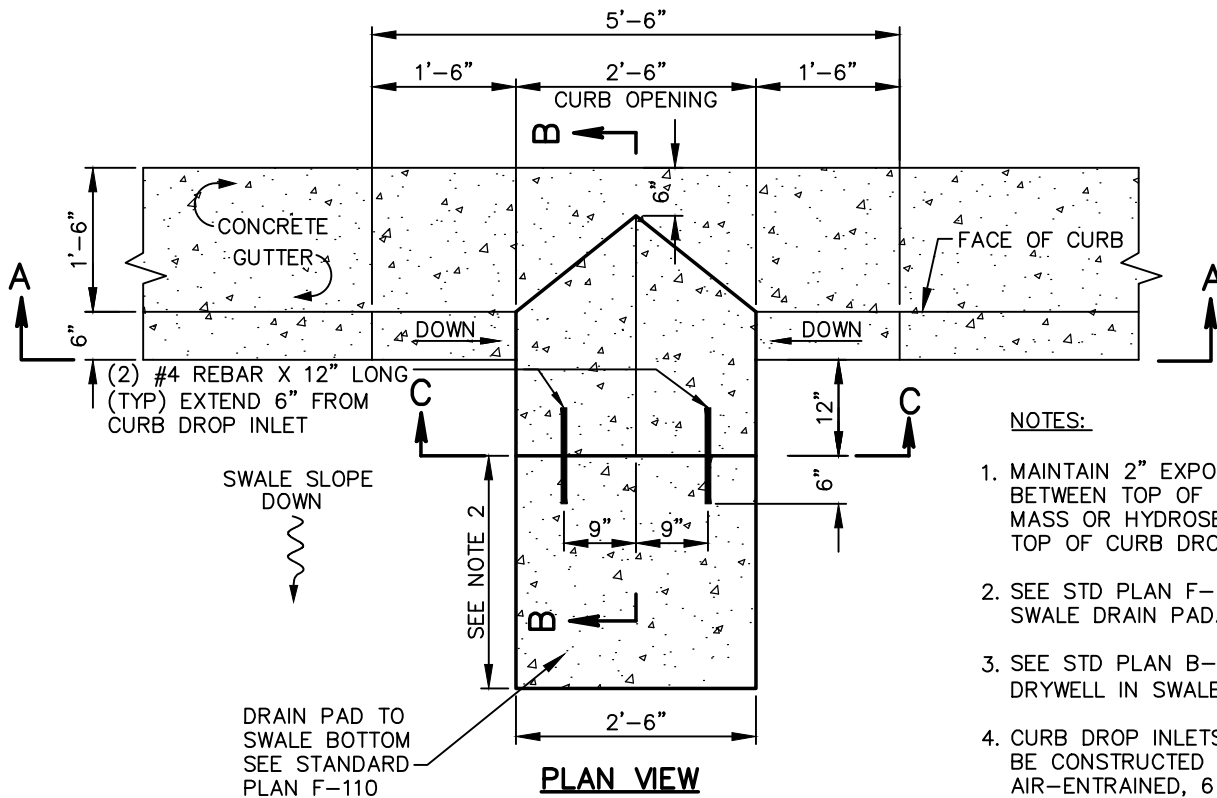

**NOTES:**

1. MAINTAIN 2" EXPOSURE BETWEEN TOP OF SOD ROOT MASS OR HYDROSEED & TOP OF CURB DROP INLET.
2. SEE STD PLAN F-110 FOR SWALE DRAIN PAD.
3. SEE STD PLAN B-102F FOR DRYWELL IN SWALE REQ'MTS.
4. CURB DROP INLETS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE IN ACCORDANCE W/ SEC 6-02.3(2)B

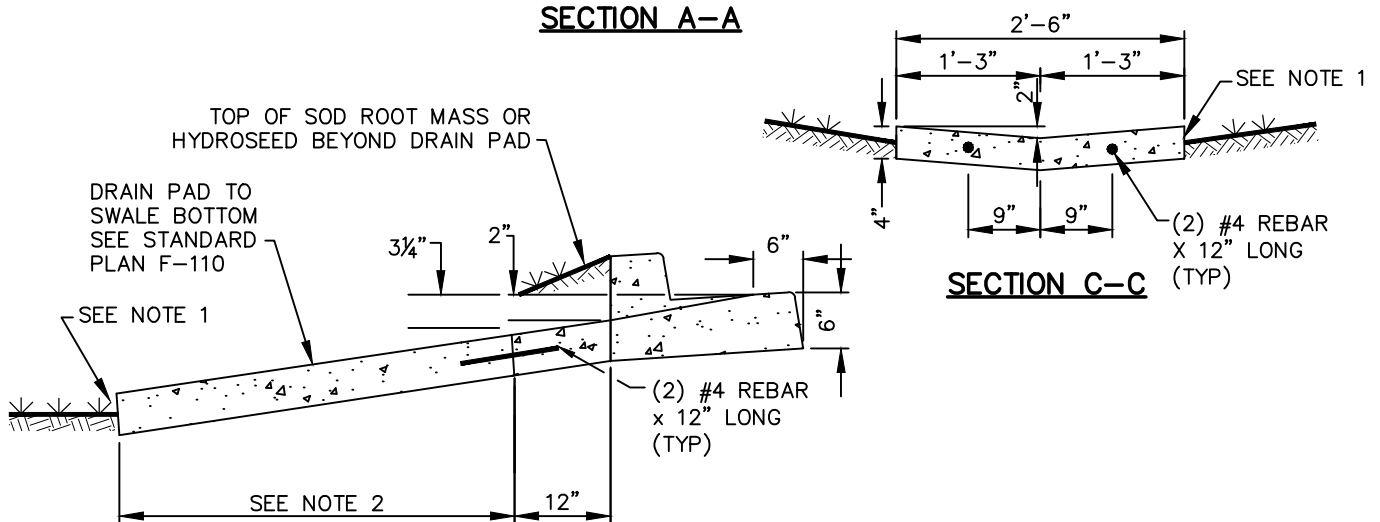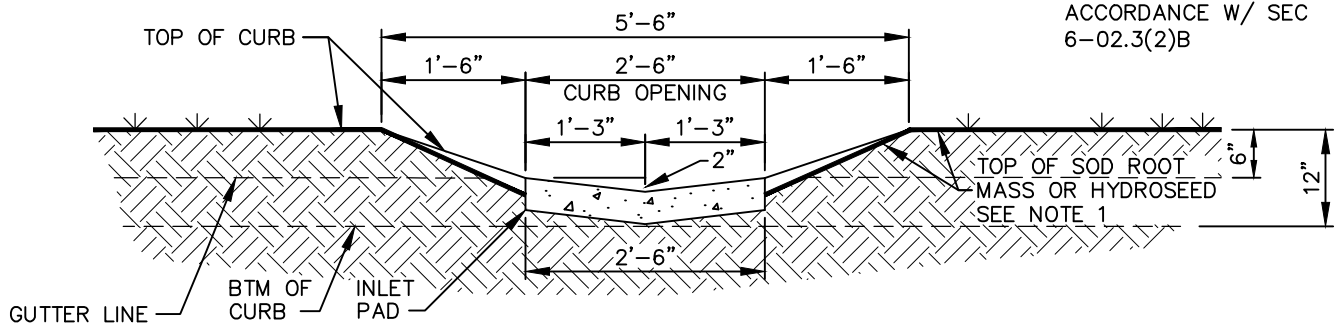

**SECTION B-B**

APPROVED BY

*[Signature]*  
DIRECTOR OF ENGINEERING SERVICES KYLE TWOHIG

*[Signature]*  
CITY ENGINEER DAN BULLER, P.E.


ADOPTED: \_\_\_\_\_  
REVISED: 04/2022  
SUPERSEDES: 04/2012  
CHECKED BY: SJS  
SCALE: NTS  
REVISED BY: DSH/MLD

**CURB DROP INLET**





ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
**F-109**

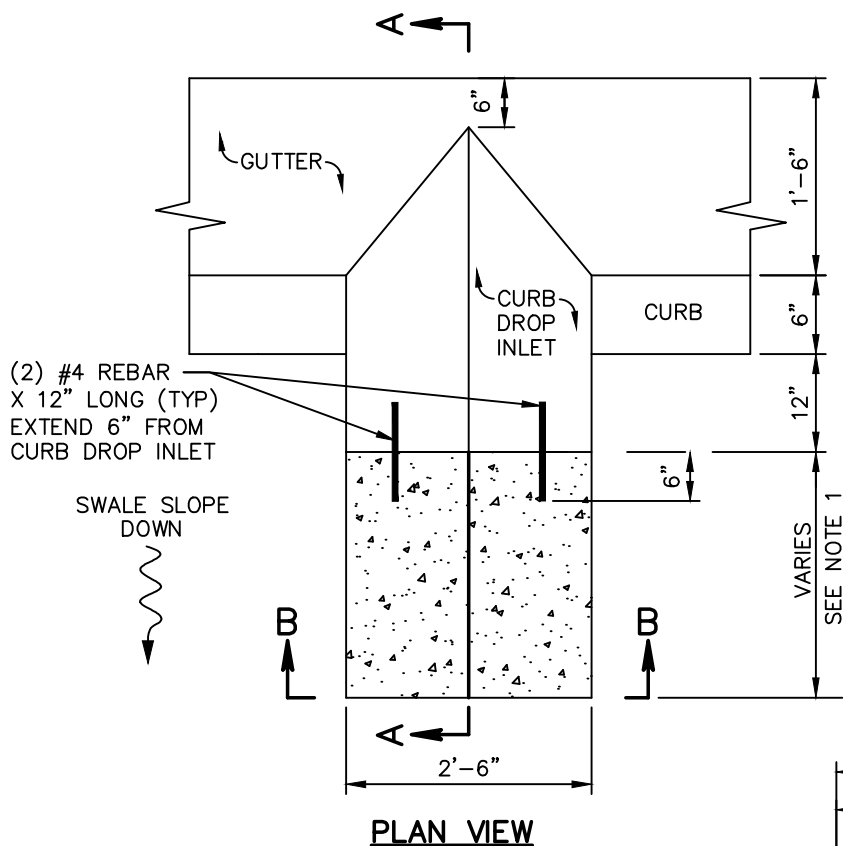

**NOTES:**

1. SWALE DRAIN PAD TO EXTEND TO BOTTOM OF SWALE.
2. MAINTAIN 2" EXPOSURE BETWEEN TOP OF SOD ROOT MASS OR HYDROSEED & TOP OF SWALE DRAIN PAD.
3. SEE STD PLAN F-109 FOR CURB DROP INLET.
4. SEE STD PLAN B-102F FOR SWALE REQUIREMENTS.
5. SWALE DRAIN PADS SHALL BE CONSTRUCTED USING AIR-ENTRAINED, 6 SACK, COMMERCIAL CONCRETE IN ACCORDANCE W/ SEC 6-02.3(2)B

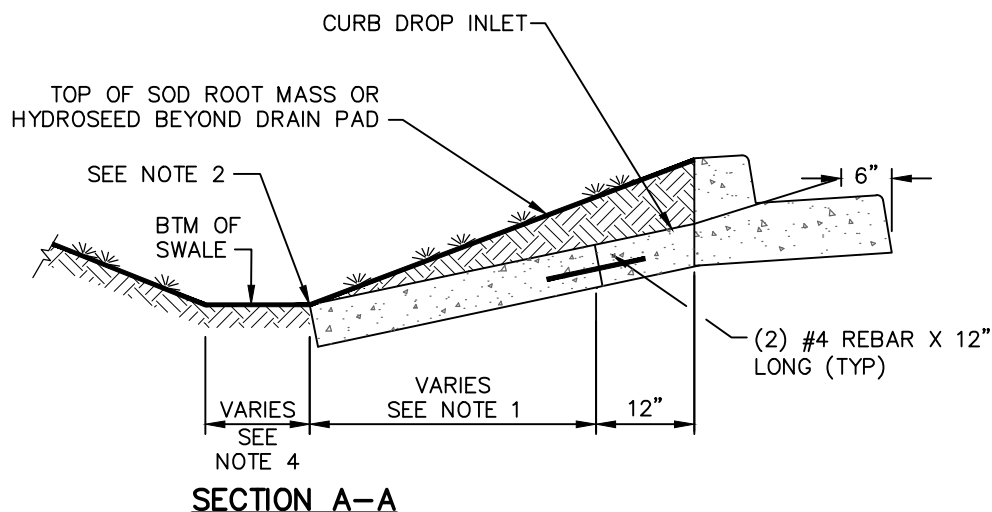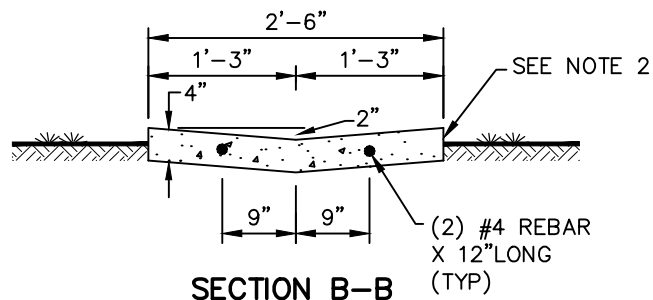

APPROVED BY

*[Signature]*  
DIRECTOR OF ENGINEERING SERVICES KYLE TWOHIG


*[Signature]*  
CITY ENGINEER DAN BULLER, P.E.

ADOPTED: \_\_\_\_\_  
REVISED: 04/2022  
SUPERSEDES: 04/2012  
CHECKED BY: SJS  
SCALE: NTS  
REVISED BY: DSH/MLD

**SWALE DRAIN PAD**

ENGINEERING SERVICES  
CITY OF SPOKANE, WASHINGTON

STANDARD  
PLAN No.  
**F-110**

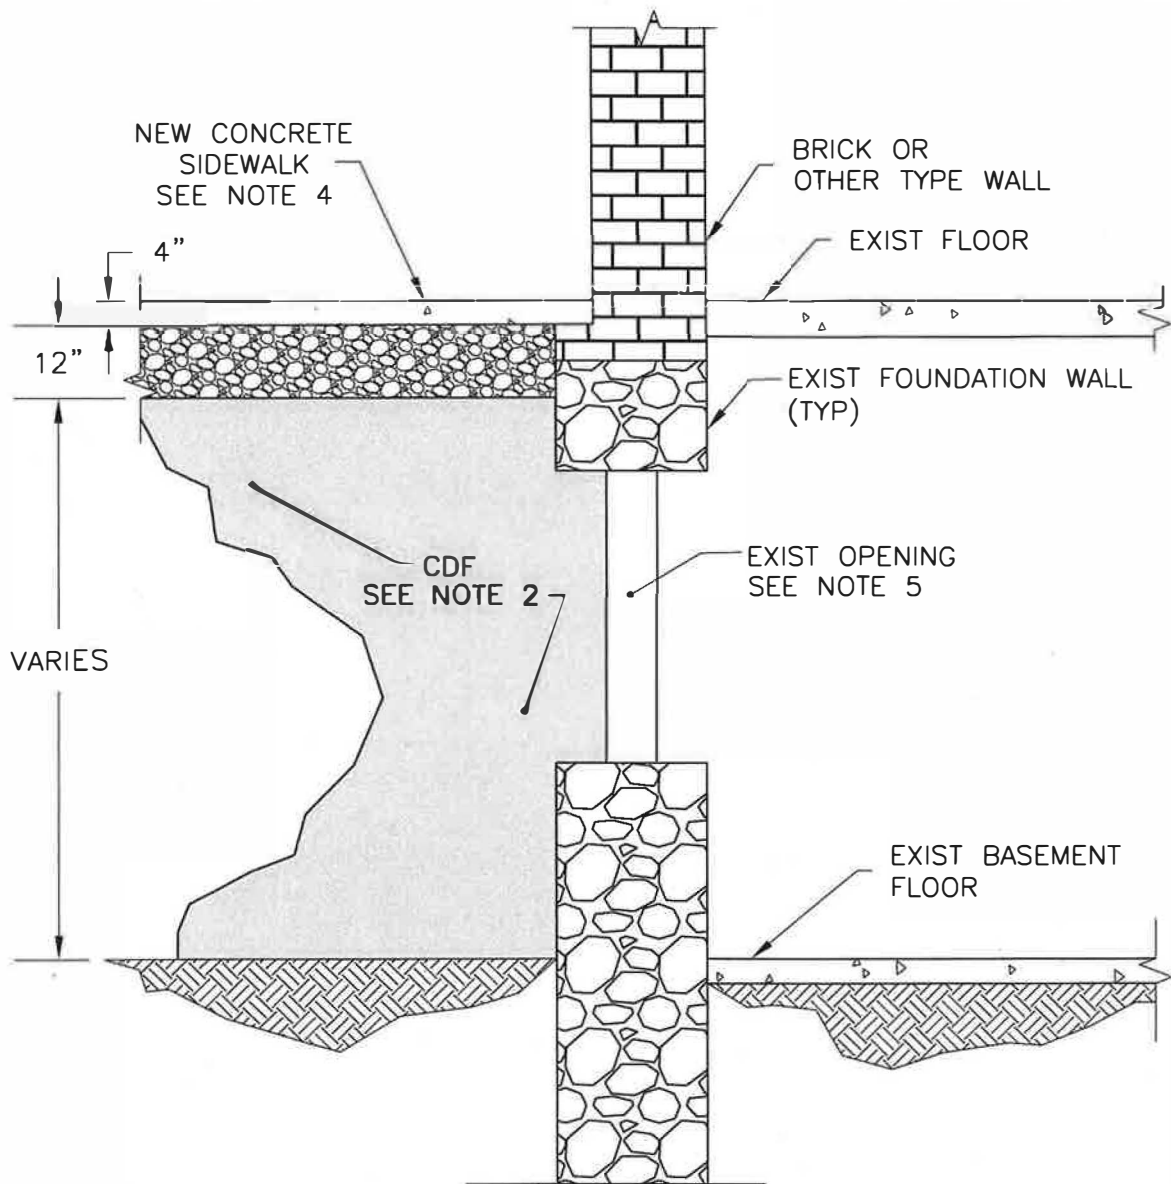

**NOTES:**

1. ALL UNDERGROUND UTILITIES SHALL BE LOCATED, VERIFIED FOR BEING ACTIVE OR INACTIVE, & DETERMINED FOR EITHER REMOVAL, RELOCATION, OR REROUTING PRIOR TO VAULT RECONSTRUCTION.
2. FILL VOID BENEATH VAULTED SIDEWALK TO UNDERSIDE OF CSTC W/ MACHINE EXCAVATABLE CDF PER SECTION 2-09.3(1)E, 150-200 PSI. ALTERNATIVE FILLS IN LIEU OF CDF SHALL BE PRE-APPROVED BY THE ENGINEER PRIOR TO PLACEMENT. STANDARD PLAN DEPICTS THE ENTIRE SIDEWALK VOID TO BE FILLED.
3. PLACE 12-INCHES OF CSTC IN TWO 6-INCH LIFTS, COMPACTED TO 95% MAX DENSITY. CSTC PER SECTION 4-04.2 & 9-03.9(3).
4. CONSTRUCT NEW CONCRETE SIDEWALK PER COS STD PLANS F102A & F-102B. USE 6-SACK, AIR-ENTRAINED COMMERCIAL CONCRETE PER SECTION 6-02.3(2)B.
5. ANY STRUCTURAL RE-INFORCEMENT OR MODIFICATIONS TO EXISTING FOUNDATION WALLS OR OPENINGS SHALL BE DESIGNED BY OTHERS AND APPROVED BY THE CITY OF SPOKANE

<p>APPROVED BY</p> <p>DIRECTOR, ENGINEERING SERVICES      P. MIKE TAYLOR, P.E.</p> <p>PRINCIPAL ENGINEER, DESIGN      GARY S. NELSON, P.E.</p>	<p>ADOPTED: 09/2010</p> <p>REVISED: _____</p> <p>SUPERSEDES: _____</p> <p>CHECKED BY: JAG</p> <p>SCALE: NTS</p> <p>DWG/REV. BY: RLB/SRM</p>	<p><b>VAULTED SIDEWALK ELIMINATION W/ CDF BACKFIL L</b></p> <div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;"> <p><b>ENGINEERING SERVICES</b></p> <p>CITY OF SPOKANE, WASHINGTON</p> </div> <div style="text-align: center;"> <p><b>STANDARD PLAN No. F-111</b></p> </div> </div>
--	---	---