


Proposed Hamblen Water Reservoir

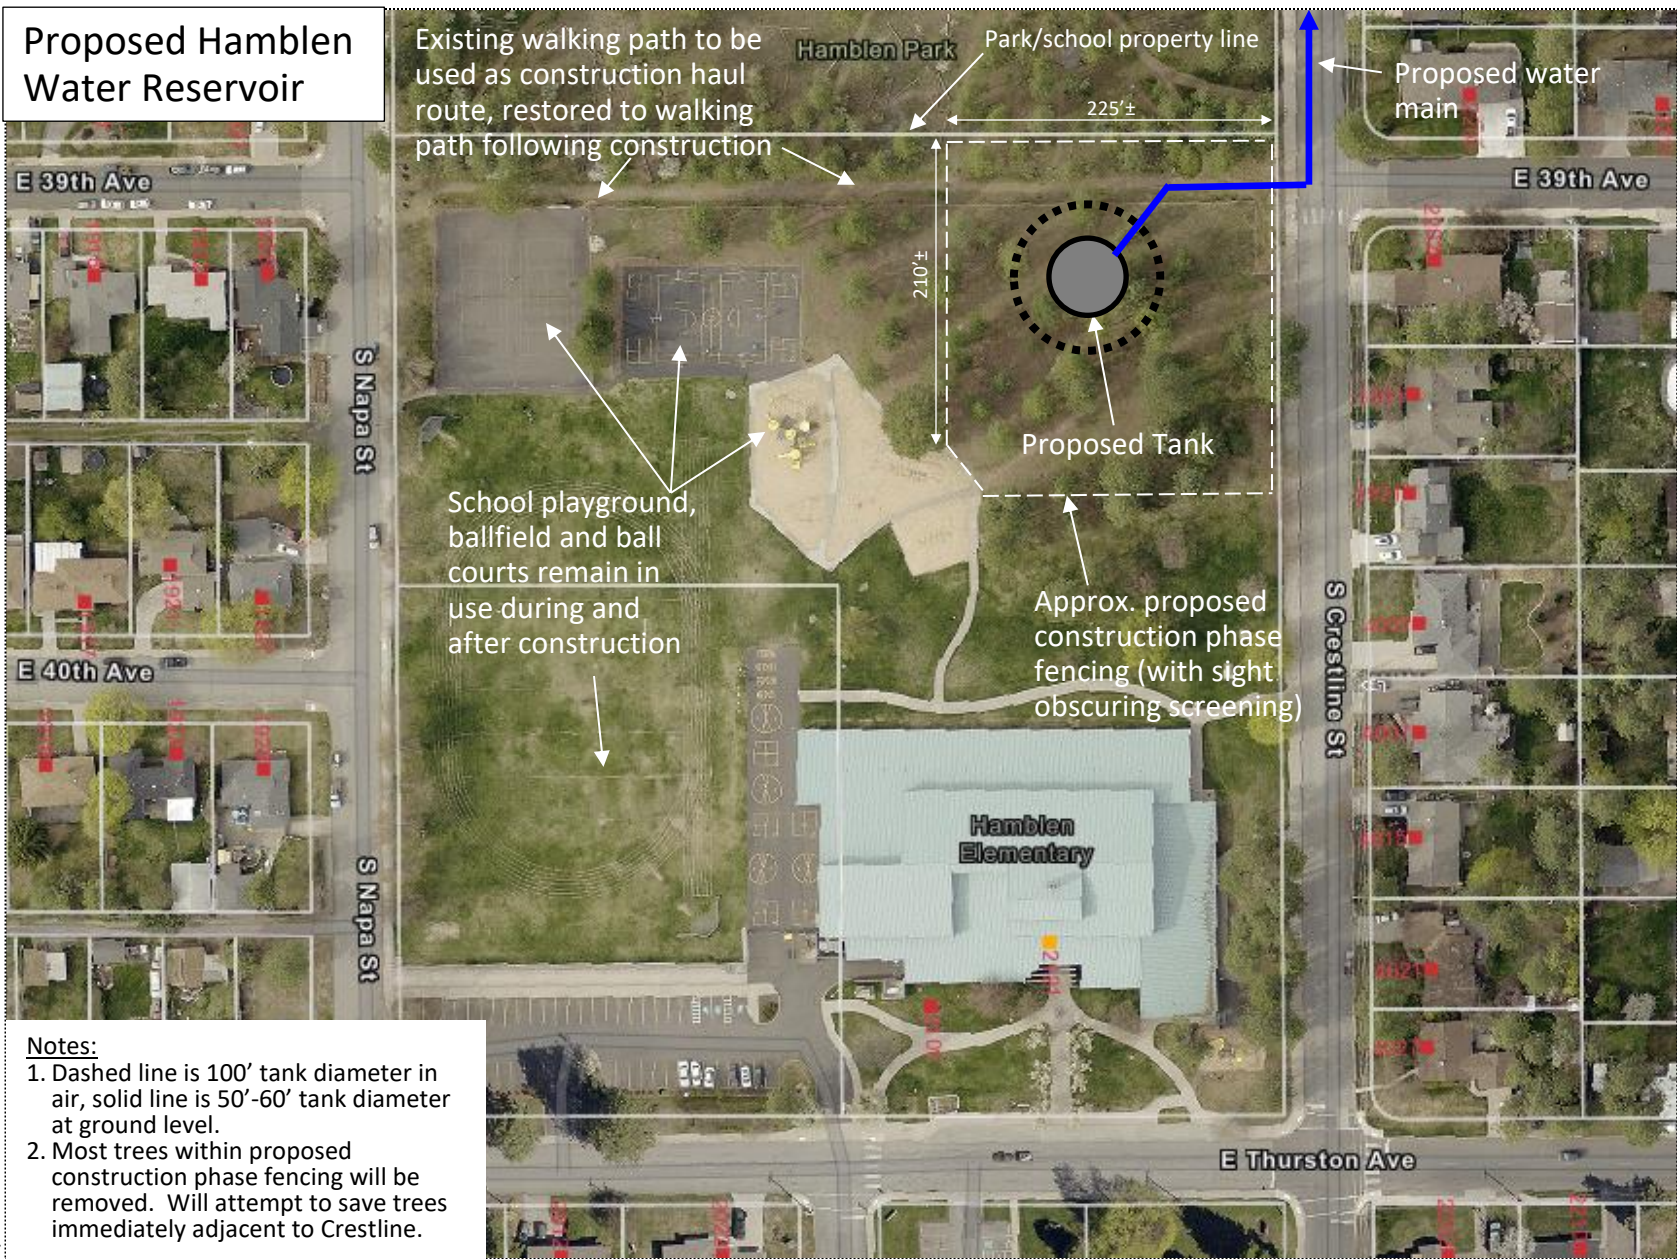

Notes:

1. Dashed line is 100' tank diameter in air, solid line is 50'-60' tank diameter at ground level.
2. Most trees within proposed construction phase fencing will be removed. Will attempt to save trees immediately adjacent to Crestline.