



City of Spokane Environmental Programs

2016

Technical Drinking Water Report

CITY OF SPOKANE - ENVIRONMENTAL PROGRAMS
2nd Floor City Hall; 808 W. Spokane Falls Blvd.; Spokane, WA 99201-3334; (509) 625-6533

Printed on Recycled Paper 

REPORT ON CITY OF SPOKANE DRINKING WATER FOR 2016

TABLE OF CONTENTS

LIST OF FIGURES	1
LIST OF TABLES.....	1
EXECUTIVE SUMMARY.....	2
INTRODUCTION AND SOURCE WATER INFORMATION.....	3
QUALITY Drinking Water.....	4
INORGANICS	4
<i>ARSENIC</i>	4
<i>LEAD - COPPER</i>	4
<i>NITRATE - NITROGEN</i>	5
RADIONUCLIDES & RADON	6
<i>RADIONUCLIDES</i>	6
<i>RADON</i>	7
<i>DISINFECTION BY-PRODUCTS – DISTRIBUTION SYSTEM</i>	8
<i>VOLATILE ORGANICS</i>	9
<i>SYNTHETIC ORGANICS</i>	9
MICROBIOLOGICAL CONTAMINANTS	9
<i>COLIFORM BACTERIA - SOURCE</i>	9
<i>HETEROTROPHIC PLATE COUNT BACTERIA – SOURCE</i>	9
<i>COLIFORM BACTERIA - DISTRIBUTION SYSTEM</i>	9
<i>PROTOZOA</i>	10
GENERAL INFORMATION	11

LIST OF FIGURES

Figure 1 Aquifer Nitrate level.....	6
Figure 2 Disinfection Byproduct Monitoring Sites.....	8
Figure 3 Colliform Monitoring Sites	10

LIST OF TABLES

Table 1 List of Resources	3
Table 2 Ray Street Well Nitrate levels.....	5
Table 3 City Source Well Nitrate levels	5
Table 4 Radionuclide Results	7

APPENDICES

Appendix I - <i>Tests Run on City of Spokane Water</i>	13
Appendix II - <i>Summary of Completed Quarterly Monitoring 2016</i>	14
Appendix III - <i>Drinking Water Inorganics Summary (Certified Laboratory)</i>	15
Appendix IV - <i>Distribution System Disinfection Byproducts</i>	16-17
Appendix V - <i>Contaminants found in Drinking Water Testing in 2016</i>	18



Executive Summary

Spokane's drinking water meets or exceeds all State and Federal drinking water quality standards. This report prepared by Environmental Programs supports and informs our Water Departments annual Consumer Confidence Report, distributed as the City of Spokane Water Quality Report. This report provides wholesale water customers, businesses and the public with a more detailed discussion, with additional references, a complete list of the year's testing, and through consideration on the reasons for testing.

The City tested for 35 different inorganic parameters. There were detections of arsenic and nitrate.

The drinking water was tested for 55 organic compounds and none were detected.

Radionuclide testing revealed levels of gross alpha emitters, Radium 228, and radon in the drinking water.

The City disinfects the drinking water with chlorine gas, resulting in the generation of disinfection byproducts. The city tests for nine of these compounds quarterly.

The City tests both the source water and the distribution system for microbiological contaminants. In 2016 there were no detections of total coliform in the source water or the distribution system.

The following narrative and attachments summarize and explain recent results in more detail. Appendix V and the last two pages of this narrative (General Information) contain information relevant to the annual Consumer Confidence Report. As such, the information may be redundant, relative to the main text of this report.

In previous years this report included information on the City of Spokane water conservation goals and the distribution system loss. These topics are covered in a separate report issued by the Water Department.

Introduction and Source Water Information

All of the City of Spokane’s drinking water comes from the Spokane Valley-Rathdrum Prairie Aquifer - designated a sole source aquifer in 1978. The Spokane Valley-Rathdrum Prairie Aquifer slowly flows through two different states and a number of different counties and is the source water for a large number of water purveyors, including the City of Spokane. This water and any contaminants freely move across political boundaries. Many groups and/or private individuals may claim this water to be used for diverse purposes. Some of these competing interests include (but are not limited to) drinking water rights, irrigation, fisheries, hydroelectric power, and industrial processes. The Spokane Aquifer (that portion of the larger aquifer lying within Washington State) and the Spokane River exchange water. While the aquifer contains a large volume of water, many factors play into the volume of water in the Spokane River, complicating the management of these resources. Some of these factors include pumping for irrigation and potable water, hydroelectric dam operations, and the variations of weather and precipitation.

Due to the porous nature of the ground surface and the number of potential contaminant sources, the possibility of contaminating the aquifer exists if good housekeeping measures are not followed for all activity over and adjacent to the aquifer. The physical and economic health of our area depends on the quality of our drinking water. In order to safeguard water quality, the City continues its efforts to make available to the community information about, and appropriate disposal mechanisms for, dangerous wastes that are generated in the Aquifer Sensitive Area. The City, in cooperation with other local governments and the Spokane Aquifer Joint Board, continues to work toward strengthening regulations for the storage and use of critical materials to safeguard the local water supply.

For additional information regarding the City of Spokane’s drinking water or related issues:

City of Spokane Water Department	(509) 625-7800	www.spokanewater.org/
City of Spokane-Environmental Programs	(509) 625-6533	www.greenspokane.org/
Spokane County - Water Resources	(509) 477-3604	www.spokanecounty.org/1192/Water-Resources
Spokane Regional Health District – Environmental Health Div.	(509) 324-1560	www.srhd.org/services/environment.asp
Washington State Department of Health - Eastern Regional Office (Drinking Water)	(509) 329-2100	www.doh.wa.gov/YouandYourFamily/HealthyHome/DrinkingWater
Washington State Department of Ecology – Eastern Regional Office	(509) 329-3400	www.ecy.wa.gov/
U.S. EPA Safe Drinking Water Hotline	1-800-426-4791	www.epa.gov/your-drinking-water

Table 1 List of Resources



QUALITY Drinking Water An Invaluable Community Resource

INORGANICS

The City typically has a Washington State Department of Ecology accredited laboratory run a full drinking water inorganics analysis once every three years on each of our source wells. In addition, nitrates are tested annually, as required. The most recent inorganic results from accredited laboratories are in Appendix III. **All sources are in compliance with existing National Primary Drinking Water Regulations for Inorganic Maximum Contaminant Levels (MCL).**

ARSENIC

The arsenic readings in 2016 at the Central, and Well electric wells were 3.49 µg/L, and 5.07 µg/L respectively. The MCL for arsenic is 10 µg/L, or parts per billion (ppb). For City drinking water, 5.13 µg/L of arsenic in 2009 from Ray Street Well represents the highest result to date.

City drinking water currently meets EPA's drinking water standard for arsenic. However, it does contain low levels of arsenic. EPA's standard balances the current understanding of arsenic's health effects against the cost of removing arsenic from drinking water. EPA continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

Further information concerning health impact issues, regulatory requirements, and compliance costs for water utilities/water customers can be found at safewater.zendesk.com/hc/en-us/sections/202366558Arsenic and www.doh.wa.gov/Portals/1/Documents/Pubs/331-167.pdf.

LEAD - COPPER

Lead and copper testing of sources and at-risk residences were conducted in 2015. The highest reading of lead in a home was 13.5 µg/L (ppb). The maximum reading for copper was 124 µg/L. These results for lead and copper continue to be less than the 15 µg/L Action Level for lead and the 1300 µg/L Action Level for copper. The lead results, based on City in-home sampling, also continue to qualify our water system as having "Optimized Corrosion Control." The next in home testing for lead and copper is scheduled for 2018.

City drinking water currently meets EP's drinking water standards for lead and copper. The EPA standard for lead balances the current understanding of lead health effects against the effectiveness and cost of corrosion control processes. The EPA is currently reassessing standards for lead.

City records indicate that some 981 homes built during World War II originally were connected to the City's distribution system with lead alloy pipes. In addition, before lead solder was banned in 1988, it was commonly used to connect copper piping in homes. The Spokane Water Dept., in 2000, offered the option to replace lead service lines (LSL). 156 homeowners requested their water service line be replaced. The City has completed work at all 156 sites, replacing the service pipe up to the property line. It was not anticipated, but no lead pipe was found on any homeowner's side of the water service. Additionally, the Water Dept. has been replacing the City lead-alloy services when in-home testing results exceeded Action Limits and when water line work was already being conducted. Early in 2016 the City of Spokane initiated a project to eliminate the remaining 486 lead service lines over the next 2 to 3 years. 113 lead service lines were removed during the remainder of 2016

Citizens can check what their service line is made of on line. Go to maps.spokanecity.org/. Search for an address, turn on the “water” layer under utilities; click on the blue line that leads to the property; it will say it’s copper or galvanized or lead. Some service lines are listed as unknown. Those residents can get more information by calling the Water Department at (509) 625-7800.

Sampling methods require testing water left sitting in lead-containing pipes for at least 6 hours. This results in a worst-case scenario for lead to move into the water. The City encourages anyone with this kind of plumbing, drawing water for cooking or drinking purposes, to let water run from the tap until cold before filling their container, especially if the water is to be given to infants or children.

For further information concerning lead in drinking water, you can find further information at www.doh.wa.gov/CommunityandEnvironment/DrinkingWater/Contaminants/Lead and www.epa.gov/your-drinking-water/basic-information-about-lead-drinking-water .

Further information about copper in drinking water can be found at www.doh.wa.gov/CommunityandEnvironment/DrinkingWater/Contaminants/Copper and safewater.zendesk.com/hc/en-us/sections/202346427.

Drinking water is only one of many potential sources of exposure to lead. An EPA publication titled “Protect Your Family From Lead In Your Home” can be downloaded from <https://www.epa.gov/lead/protect-your-family-lead-your-home>.

NITRATE - NITROGEN

The Ray Street Well continues to be monitored quarterly for Nitrate-N. **In 2016, the highest accredited lab quarterly result for the Ray Street Well was 3.19 mg/L**, or parts per million (ppm). The federal MCL for Nitrate –N is 10 mg/L. The result from a duplicate sample analyzed by the Riverside Park Water Reclamation Facility (RPWRF) Laboratory was 3.27 mg/L. The quarterly results for Ray Street Well for 2016 are as follows:

<i>Sample Date</i>	<i>Accredited Laboratory Result - Nitrate-N, mg/L</i>	<i>RPWRF Laboratory Result – Nitrate+Nitrite-N, mg/L</i>
26-January-2016	3.19	3.27
26-April-2016	2.76	2.61
26-July-2016	2.58	2.23
25-October-2016	2.68	2.99

Table 2 Ray Street Well Nitrate levels

All other City sources average 1.08 mg/L for 2016, less than a fifth of the MCL for nitrate-nitrogen. The 2016 results for the other City source wells are as follows:

<i>Source Well</i>	<i>Accredited Laboratory Result - Nitrate-N, mg/L</i>	<i>RPWRF Laboratory Result – Nitrate+Nitrite-N, mg/L</i>
Well Electric	1.33	1.01
Parkwater	1.33	1.12
Hoffman	1.38	1.01
Grace	0.76	0.59
Nevada	0.82	0.62
Central	0.87	0.57

Table 3 City Source Well Nitrate levels

The following map depicts the results of monitoring wells sampled during 2016 by the Spokane County Water Resources Program. The results are for nitrate+nitrite as nitrogen from monitoring wells and springs along the Spokane River and purveyor wells over the Spokane Aquifer. Where multiple sampling events occurred at the same location, the highest result is depicted on the map. There are a number of wells that had results between 2.51 and 6.21 mg/L. These wells, including the City of Spokane Ray Street Well, are typically located along the edge of the aquifer and appear to be subject to nitrate loading to the aquifer that originates at higher elevations.

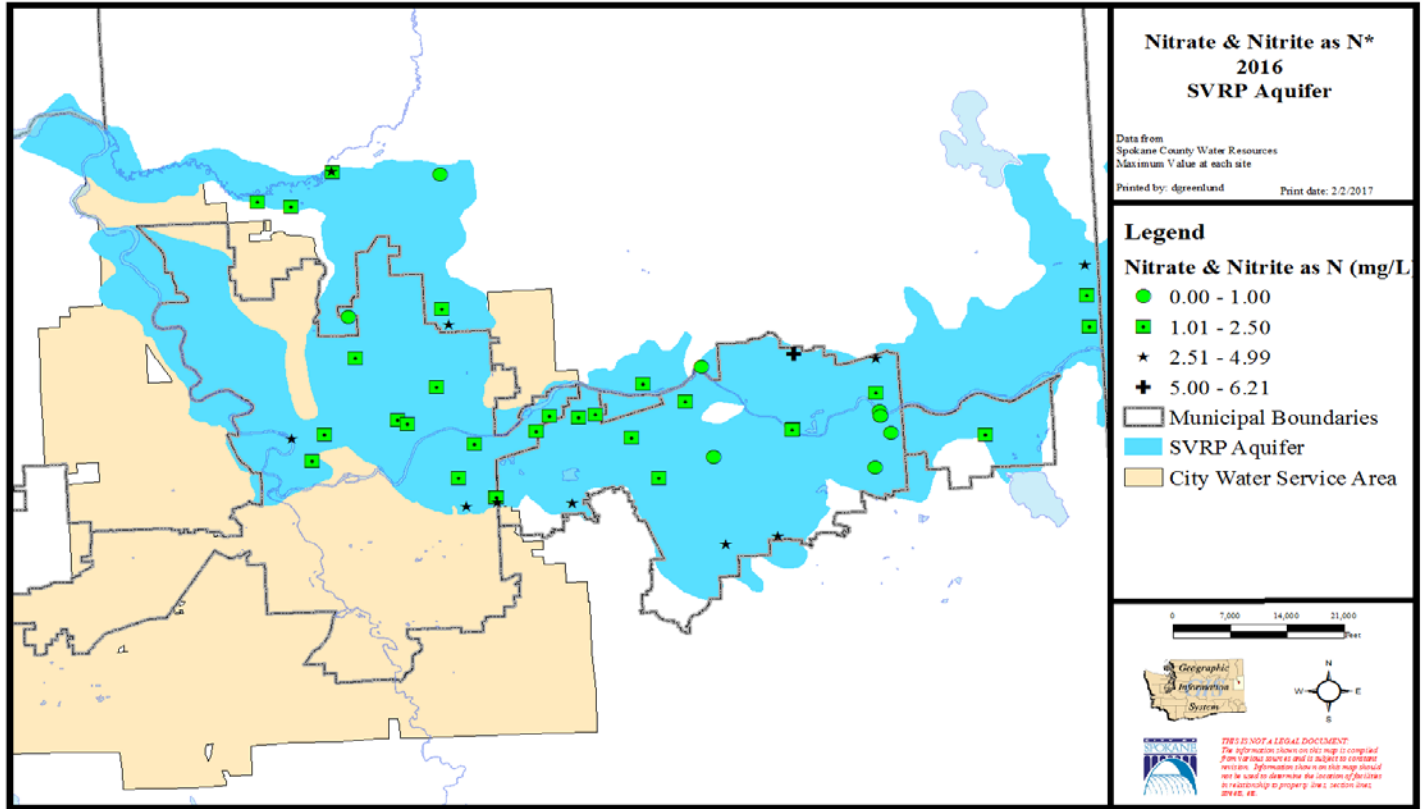


Figure 1 Aquifer Nitrate level

For further information concerning nitrate in drinking water and potential health issues, you can access the EPA website at safewater.zendesk.com/hc/en-us/sections/202346267-Nitrate or the Washington State Dept. of Health website at www.doh.wa.gov/Portals/1/Documents/Pubs/331-214.pdf.
(Para ver información adicional, visite al: www.doh.wa.gov/Portals/1/Documents/Pubs/331-214s.pdf)

RADIONUCLIDES & RADON

RADIONUCLIDES

In 2016, the City of Spokane tested the Central, Hoffman, and Nevada source wells for Radium 228 and Gross Alpha. The table below has the results.

	Gross Alpha Particle Activity	Radium 228	Combined Radium 226/228 *
Central	1.23	.68	1.23
Hoffman	1.57	.55	1.57
Nevada	< 1	.74	0.5

Table 4 Radionuclide Results

All results in picocuries per liter (pCi/L)

Gross Alpha particle activity has an MCL of 15 pCi/L. The federal MCL for Radium 226 and Radium 228 (combined) is 5 pCi/L. The City of Spokane results were below the MCL.

The radionuclide rule allows Gross Alpha results to be used in lieu of Radium 226 if the Gross Alpha particle activity is below 5 pCi/L. If the gross alpha particle activity result is below the detection limit, one-half of the detection limit is used to determine compliance¹. The radionuclide rule also allows a Gross Alpha particle activity measurement to be substituted for the required uranium measurement provided that the measured gross alpha particle activity does not exceed 15 pCi/l. The Gross Alpha activity was below 15 pCi/L so the City did not test for Uranium.

* If the Radium 228 or 226 value is <1.0, a value of zero will be used to calculate the Combined Radium 226/228².

For more information on radionuclides in drinking water, access the EPA website at safewater.zendesk.com/hc/en-us/sections/203280387-Radionuclides

RADON

The Water Department monitored the Central, Hoffman and Nevada wells for radon in 2016, with results of 434 pCi/L, 439 pCi/L, and 445 pCi/L respectively.

The Environmental Protection Agency has published a proposed rule for regulating the concentration of radon-222 in drinking water. The rule proposes a maximum contaminant level goal (MCLG) of zero, a maximum contaminant level (MCL) of 300 pCi/L, and an alternative maximum contaminant level (AMCL) of 4000 pCi/L. The proposed rule would require that community water supply systems (including the City's) generally would have to comply with the MCL of 300 pCi/L, unless there is a multi-media mitigation program (MMM) in place. With a MMM, the AMCL of 4000 pCi/L would apply.

Comments for the proposed rule were accepted until February 4, 2000. The final rule was expected to be published one year from that date. No final rule was promulgated and at the current time, drinking water regulation(s) are not on the EPA agenda list.

Radon gas is one of a number of radioactive elements that result from the radioactive decay of uranium found locally in natural deposits. Exposure to excessive amounts of radon may increase cancer risk. Most of these risks result from exposure to radon in indoor air. The EPA has determined that 1-2% of the radon in indoor air comes from drinking water. General information concerning radon in the environment and the associated health issues, including drinking water, can be found at www.epa.gov/radon or call the Radon Hotline at 1-800-SOS-RADON [1-800-767-7236]. An EPA publication titled "A Citizen's Guide to Radon" can be downloaded from www.epa.gov/radon/citizens-guide-radon-guide-protecting-yourself-and-your-family-radon.


¹ 40 CFR 141.26a (5)

² 40 CFR 141.26c (3) v

ORGANICS

DISINFECTION BY-PRODUCTS – DISTRIBUTION SYSTEM

The maximum value during 2016 compliance monitoring of the distribution system for total trihalomethanes (TTHM) was 4.03 µg/L and for haloacetic acids (HAA5) was no detection. This is well below the federal MCL of 80 µg/L for total trihalomethanes and 60 µg/L for the sum of five haloacetic acids. The by-products are only detected at the extreme end of the distribution system. The Stage 2 Disinfectants and Disinfection By-products Rule requires a Locational Running Annual Average (LRAA) be used for reporting compliance. This is the average of four quarterly samples for each sampling location. The City uses small amounts of chlorine as a drinking water disinfectant. However, the disinfectants themselves can react with materials in the water to form byproducts, which may pose health risks. The maximum value for TTHM was 3.94 ppb. Appendix IV has the results for all 2016 quarterly sampling. There were no detections of haloacetic acids at any sampling site in 2016.

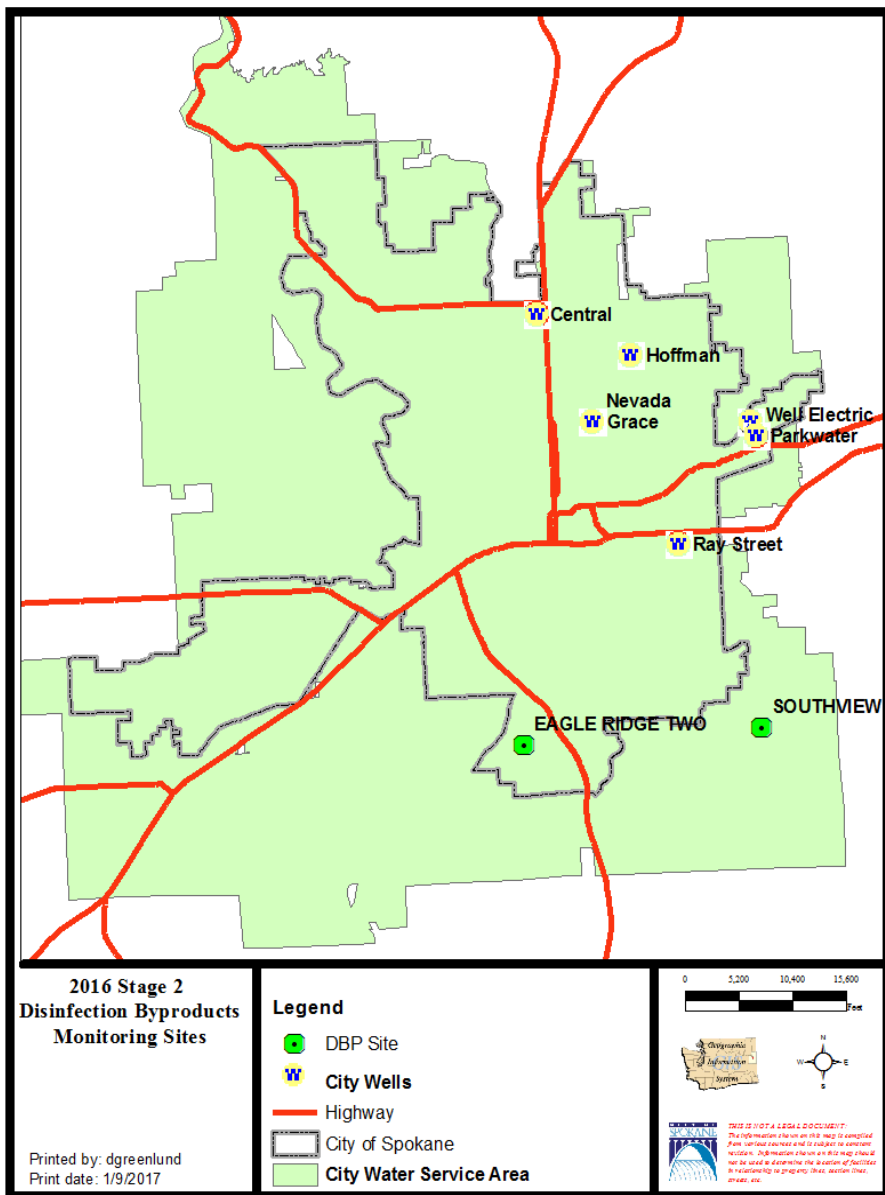

In 2016, two sites were sampled every quarter. They were Eagle Ridge Two, and Southview. For more information on the Stage 2 DBPR, go to the EPA website water.epa.gov/lawsregs/rulesregs/sdwa/stage2/index.cfm

2016 was the fifth year of sampling under the Stage 2 Disinfectants and Disinfection Byproducts Rule. Starting in 2007 and continuing until 2010, the City Water Department performed assessment monitoring at over 20 locations (approximately five each year) to determine the potential for disinfection by-products (DBP) to be formed during the detention period in the distribution system. The DBP assessment sampling sites were selected from the existing coliform sampling sites. Based on this sampling and analysis of the retention time of water in the distribution system, locations were determined for the Stage 2 distribution system sampling program.

Figure 2 Disinfection Byproduct Monitoring Sites

VOLATILE ORGANICS

In 2016, the City of Spokane tested the Grace and Hoffman well stations for Volatile Organic Compounds (VOC). There were no detections. A complete list of the chemicals analyzed is in Appendix I.

Trihalomethanes (THMs, chloroform, bromoform, bromodichloromethane, dibromochloromethane) are one group of volatile organic, disinfection by-products. That is to say, they can originate from chemical interactions between a disinfectant (chlorine gas in the City's system) and any organic matter present in the raw water. **There were no detections of THMs in source water monitoring for 2016.**

SYNTHETIC ORGANICS

The City of Spokane did not sample for Synthetic Organic Chemicals (SOC) in 2016. The City tests all of the wells on a three year cycle. 2017 and 2018 are scheduled for the next sampling cycle.

MICROBIOLOGICAL CONTAMINANTS

COLIFORM BACTERIA - SOURCE

The City of Spokane well station raw source water (the water before disinfectant chlorination) has been tested regularly for coliform bacteria. While historically there has been no requirement to test for coliform bacteria in source water, the City has monitored for this water quality parameter. More recently, testing requirements to determine whether hydraulic continuity exists with the Spokane River have increased the testing frequency. **In 2016, out of 77 tests for coliform bacteria in the City source water wells, there were no detections of total coliform, and no detections of fecal coliform.**

Out of 424 tests over the five-year period from 2012 through 2016, there have been no detections of total coliform. There have been no detections of fecal coliform in the source water during this time frame.

HETEROTROPHIC PLATE COUNT BACTERIA – SOURCE

In 2016, out of 76 Heterotrophic Plate Count (HPC) tests on source water, there were 16 positive results. The greatest concentration was 37 colonies per milliliter of sample at the Hoffman Well. HPC tests were conducted 357 times over the five-year period from 2012 through 2016 on raw source water. There have been 100 positive HPC results. The maximum detection during this five-year period was 681 colonies per milliliter at the Hoffman Well in 2015. Without regard to source water HPC levels, City source water is treated with chlorine to safeguard drinking water quality. This is done based on the historical use of open reservoirs (which no longer exist) and to preserve the sanitary quality when a well or piping is open to the environment during construction, repair or routine maintenance. Some water utilities in this area (drawing from the same aquifer) do not add any disinfectant.

COLIFORM BACTERIA - DISTRIBUTION SYSTEM

Coliform testing is typically done four days a week from various points in the distribution system. The Water Department has more than 220,000 customers. This population tier³ requires taking 150 samples per month, which was adopted as the target for distribution system coliform monitoring by the Water Dept. in 2007. When a coliform positive test result is reported, re-sampling is done in compliance with the Total Coliform Rule and the Groundwater Rule. **During 2016, the City Water Department had 1,973 coliform bacteria samples analyzed. There were no detections of total coliform in the distribution system.** 1,974 samples were analyzed in 2014 and, 1,974 samples were analyzed in 2013.

³ Ref. WAC 246-290-300 (3)(e-Table 2)

The Water Department staff has worked to refine the sampling sites for the distribution system. Concerns about inadvertent contamination of sampling sites and locations that don't adequately represent the distribution of the water system has caused the Water Department staff to establish more dedicated sampling sites at locations more representative of the entire system. Following is a map of the distribution system sampling sites during 2016, overlaid on the City's water service area. It is important to note that the sample sites are evenly placed based on the distribution system, which may not currently reach all parts of the water service area, and population density. Water Department staff state that coliform bacteria have not been confirmed in the distribution system for at least the last 35 years. Sample handling or collection errors are suspected causes of any original detections.

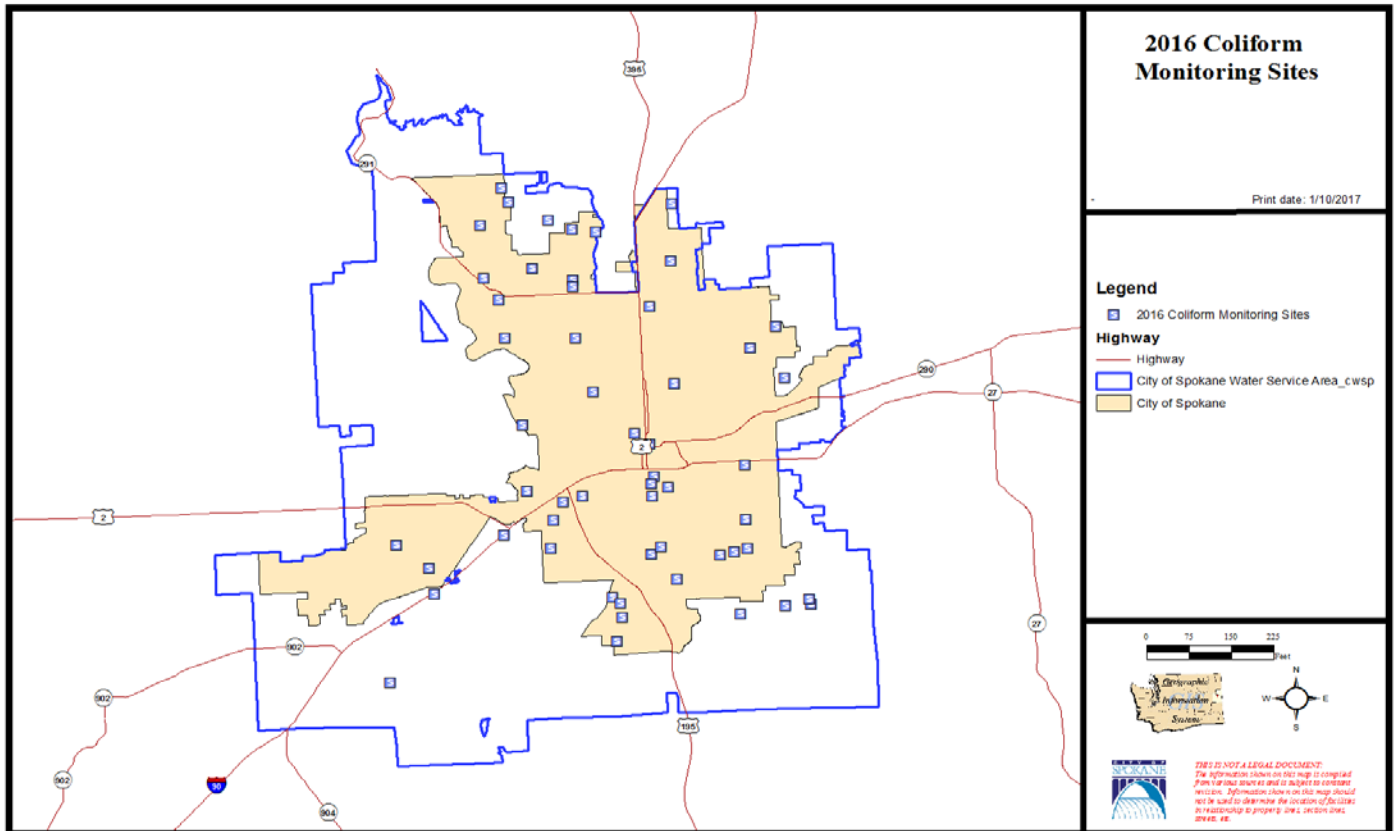


Figure 3 Coliform Monitoring Sites

PROTOZOA

A number of cities and towns throughout the country, in years past, have experienced problems with giardia and/or cryptosporidium getting into the distribution systems. Most times, problems with these parasitic organisms in potable water have been associated with surface water sources. **The City is not aware of, nor has the State Department of Health or Spokane Regional Health District indicated an awareness of, cases where infections with these organisms were traced back to the City's water system.**

Please note that cryptosporidium and other water borne organisms can be spread in many ways. People who become ill as a result of consuming giardia and/or cryptosporidium typically recover after suffering severe bouts of diarrhea. However, small children, people whose immune systems are compromised, or those who are otherwise in poor health can die as a result of these infections. For further information concerning the potential health effects issues, access the websites at the CDC at www.cdc.gov/parasites/crypto/index.html (cryptosporidium) and www.cdc.gov/parasites/giardia/index.html (giardia) and the EPA website at safewater.zendesk.com/hc/en-us/sections/202346417.

GENERAL INFORMATION

English:

This report contains important information about the drinking water supplied by the City of Spokane. Translate it, or speak with someone who understands it well.

Spanish:

Este reporte contiene información importante acerca del agua potable suministrada por la Ciudad de Spokane. Tradúzcalo, o hable con alguien que lo entiende bien. (Para ver información adicional, visite al; <http://espanol.epa.gov/espanol/agua>)

Russian:

В этом отчете содержится важная информация относительно питьевой воды, поставляемой службой города Спокэн. Переведите этот отчет или поговорите с тем, кто его хорошо понимает.

Vietnamese:

Bản phúc trình này chứa đựng những thông tin quan trọng về nước uống được cung cấp bởi City of Spokane. Hãy phiên dịch, hay hỏi thăm người nào hiểu rõ về tài

Across the nation, the sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and radioactive material and can pick up substances resulting from the presence of animals or human activity.

Contaminants that may be present in source water include:

- Biological contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm run-off, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, storm water run-off, and residential uses.
- Organic chemicals, including synthetic and volatile organics, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water run-off and septic systems.
- Radioactive materials, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the Environmental Protection Agency (EPA) prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food & Drug Administration (FDA) regulations establish limits for contaminants in bottled water, which must provide the same protections for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by contacting the Environmental Protection Agency's Safe Drinking Water Hotline (1-800-426-4791), on line at www.epa.gov/your-drinking-water/safe-drinking-water-hotline, or you can access additional information at EPA website: www.epa.gov/your-drinking-water

HEALTH INFORMATION

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Additional information concerning:

Radon: During 2016, the City conducted tests at Central, Hoffman, and Nevada wells for Radon-222. The results were 434 pCi/L, 439 pCi/L, and 445 pCi/L. The EPA has proposed a MCL of 300 pCi/L, which has not been finalized.

Radon is a radioactive gas that you can't see, taste, or smell and is a known carcinogen. Compared to radon entering the home through soil, radon entering the home through tap water will, in most cases, be a small source of radon in indoor air. Breathing air containing radon can lead to lung cancer and/or drinking water containing radon also may cause increased risk of stomach cancer. If

you are concerned about radon in your home, test the air in your home. Testing is inexpensive and easy. Fix your home if the level of radon in your air is 4 picocuries per liter of air (pCi/L) or higher. There are simple ways to fix a radon problem that aren't too costly. For additional information call EPA's Radon Hotline (1-800-577-2366) or, access the EPA website at www.epa.gov/radon/radon-hotlines-and-information-resources

Arsenic: The arsenic readings in 2016 at the Central, and Well Electric wells were 3.49 and 5.07 ppb respectively. The Maximum Contaminant Level (MCL) for Arsenic is 10 ppb.

City of Spokane drinking water currently meets EPA's revised drinking water standard for arsenic. However, it does contain low levels of arsenic. EPA's standard balances the current understanding of arsenic's possible health effects against the cost of removing arsenic from drinking water. EPA continues to research the health effects of low levels of arsenic, which is known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems. Information on arsenic in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at safewater.zendesk.com/hc/en-us/sections/202366558-Arsenic

Lead: The most recent in home testing was 2015. The City tested 58 at-risk residences for lead. The single highest result was 13.5 ppb. This result for lead is below the 15 ppb Action Level for lead. The lead results, based on City in-home sampling, also continue to qualify our water system as having "Optimized Corrosion Control". Source water is analyzed for lead concurrent with the in-home testing. In 2015 the maximum concentration in the source water testing of all the wells for lead was 0.16 ppb.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Spokane is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your drinking water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline, 1-800-426-4791 or at www.epa.gov/your-drinking-water/basic-information-about-lead-drinking-water.

Citizens can check what their service line is made of on line. Go to maps.spokanecity.org/. Search for an address; turn on the "water" layer under utilities; click on the blue line that leads to the property; it will say it's copper or galvanized or lead. Some service lines are listed as unknown. For more information on service line materials and options for lead service line replacement please call the Water Department at (509) 625-7800.

CITY OF SPOKANE'S SYSTEM

All of the City of Spokane's drinking water comes from the Spokane Valley-Rathdrum Prairie (SVRP) Aquifer - designated a "sole source" aquifer in 1978. The Spokane Aquifer (that portion of the SVRP aquifer lying within Washington State) and the Spokane River exchange water. The rates and locations of exchange are the subject of continued study.

Due to the porous nature of the ground surface and the number of potential contaminant sources, the possibility of contaminating the aquifer exists if good "housekeeping" measures are not followed for all activity over and adjacent to the aquifer. In order to safeguard water quality, the City, in coordination with other stakeholders, is currently implementing a Wellhead Protection Program. This program endeavors to inform the public about the Spokane Valley-Rathdrum Prairie Aquifer, and about appropriate disposal mechanisms for dangerous and/or critical materials that are generated in the Aquifer Sensitive Area. The program is advocating land use regulations to help protect drinking water wells from contamination.

For additional information regarding the City of Spokane's Drinking Water or related issues, you can call:

City of Spokane Water & Hydroelectric Services	509-625-7800
City of Spokane Environmental Programs	509-625-6533

The Mayor recommends Water and Hydroelectric Services policy and rates to the Spokane City Council.
The Council meets most Mondays at 6:00 p.m. in the Council Chambers at
Spokane City Hall (808 W. Spokane Falls Blvd., Spokane, WA).

Appendix I - Tests Run on City of Spokane Water

7-Mar-2017

FIELD TESTS

Chlorine, Total Residual
Conductivity
Hardness
pH
Temperature
Turbidity

RADIONUCLIDES

Alpha emitters (gross)
Radon 222
Radium 228

MICROBES

BACTERIA

Total Coliform - Before & After Treatment
Fecal Coliform - Before & After Treatment
Heterotrophic Plate Count - Raw water

DISINFECTION BY-PRODUCTS

TRIHALOMETHANES

Chloroform
Bromoform
methane, Dibromochloro-
methane, Bromodichloro-
Total Trihalomethanes

FIVE HALOACETIC ACIDS (HAA5)

acetic Acid, Monochloro-
acetic Acid, Dichloro-
acetic Acid, Trichloro-
acetic Acid, Monobromo-
acetic Acid, Dibromo-

GENERAL INORGANICS

Color
Conductivity
Hardness, Total
Total Alkalinity
Total Dissolved Solids
Turbidity

INORGANIC IONS

Ammonia Nitrogen
Chloride
Cyanide
Fluoride
Nitrate Nitrogen
Nitrite Nitrogen
1 Phosphorus
Silica
Sulfate

INORGANIC METALS

Aluminum
Antimony
Arsenic
Barium
Beryllium
Cadmium
Calcium
Chromium
Copper
Iron
Lead
Magnesium
Manganese
Mercury
Nickel
Selenium
Silver
Sodium
Thallium
Zinc

VOLATILE ORGANICS

Benzene
benzene, 1,2,3-Trichloro-
benzene, 1,2,4-Trichloro-
benzene, 1,2,4-Trimethyl-
benzene, 1,3,5-Trimethyl-
benzene, Bromo-
benzene, Butyl-
benzene, Chloro-
benzene, Ethyl
benzene, Isopropyl-
benzene, m-Dichloro-
benzene, o-Dichloro-
benzene, p-Dichloro-
benzene, Propyl-
benzene, sec-Butyl-
benzene, tert-Butyl-
Butadiene, Hexachloro-
Chloride, Carbon Tetra-
Chloride, Methylene (aka methane, dichloro)
Chloride, Vinyl
Chloroform (Freon 20)

ethane, 1,1,1,2-Tetrachloro-
ethane, 1,1,1-Trichloro-
ethane, 1,1,2,2-Tetrachloro-
ethane, 1,1,2-Trichloro-
ethane, 1,1-Dichloro-
ethane, 1,2-Dichloro-
ethane, Chloro-
ethene, 1,1-Dichloro-
ethene, cis-1,2-Dichloro-
ethene, Tetrachloro-
ethene, trans-1,2-Dichloro-
ethene, Trichloro-
methane, Bromo-
methane, Bromochloro-
methane, Chloro-
methane, Dibromo-
methane, Dichlorodifluoro-
methane, Trichlorofluoro- (Freon 11)
Naphthalene
propane, 1,2,3-Trichloro-
propane, 1,2-Dichloro-
propane, 1,3-Dichloro-
propane, 2,2-Dichloro-
propene, 1,1-Dichloro-
propene, cis-1,3-Dichloro-
propene, trans-1,3-Dichloro-
Styrene
Toluene
toluene, o-Chloro-
toluene, p-Chloro-
toluene, p-Isopropyl-
Xylene, m&p-
Xylene, o-
Xylene, total

Appendix II - Annual Testing Summary - Tests Run on City of Spokane Water							7-Mar-2017		
2016 DRINKING WATER SOURCE - COMPLETED QUARTERLY MONITORING									
	SOURCE #	8	6	5	1	3	4	2	
	WELL	CENTRAL	GRACE	HOFFMAN	NEVADA	PARKWATER	RAY STREET	WELL ELECTRIC	
BACTERIA									
COLIFORM - RAW SOURCE *									
Total Coliform -number of samples per year / number of positive detections		7 / 0	8 / 0	6 / 0	8 / 0	13 / 0	11 / 0	25 / 0	
E. coli - number of samples per year / number of positive detections		7 / 0	8 / 0	6 / 0	8 / 0	13 / 0	11 / 0	25 / 0	
HETEROTROPHIC PLATE COUNT - RAW SOURCE *									
number of samples per year / greatest result value		6 / 1	8 / 0	6 / 37	8 / 1	12 / 0	11 / 0	24 / 1	
* All operating wells are typically sampled once per month									
INORGANIC									
FULL LIST- ACCREDITED LAB (phase II & V included)		3rd Qtr - Jul	completed-see App. IV						completed-see App. IV
NITRATE		1st Qtr - Jan					3.19		
		2nd Qtr - April					2.76		
		3rd Qtr - Jul	0.87	0.76	1.38	0.82	1.33	2.58	1.33
		4th Qtr - Oct					2.68		
NITRATE + NITRITE - RPWRF LAB		1st Qtr - Jan					3.27		
		2nd Qtr - April					2.61		
		3rd Qtr - Jul	0.57	0.59	1.01	0.62	1.12	2.23	1.01
		4th Qtr - Oct					2.99		
ORGANIC									
VOLATILES		1st Qtr - Jan							
(including TRIHALOMETHANES)		2nd Qtr - April							
		3rd Qtr - Jul				no detections	no detections		
		4th Qtr - Oct							
RADIOACTIVE CONTAMINANTS									
Radium 228 - pCi/L		3rd Qtr - Jul	0.68		0.55	0.74			
Gross Alpha - pCi/L		3rd Qtr - Jul	1.23		1.57	< 1			
Radon - pCi/L		3rd Qtr - Jul	434		439	445			

Appendix III - Drinking Water Inorganics Summary

CITY OF SPOKANE

7-Mar-2017

DRINKING WATER INORGANICS SUMMARY

MOST RECENT WELL STATION MONITORING ANALYTICAL RESULTS

ACCREDITED LABORATORIES

WELL STATION	Maximum Contaminant							CURRENT DATA SUMMARY					
	CENTRAL	ELECTRIC	GRACE	HOFFMAN	NEVADA	PARKWATER	RAY	Levels MCL's**	Goals MCLG's	MEAN	MAX	MIN	COUNT
SAMPLING DATE LABORATORY	26-Jul-2016 (Anatek)	26-Jul-2016 (Anatek)	29-Jul-2014 (Anatek)	29-Jul-2014 (Anatek)	28-Jul-2015 (Anatek)	28-Jul-2015 (Anatek)	28-Jul-2015 (Anatek)						
ALKALINITY	110	121	not tested	not tested	148	145	152	unregulated		225	152	110	3
HARDNESS (as CaCO3) #	122	132	96	136	108	160	168	unregulated		132	168	96	7
CONDUCTIVITY (µmos/cm)	236	278	214	305	234	340	384	700 t		284	384	214	7
TURBIDITY (NTU)	0.112	0.146	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	1 t		0.037	0.146	< 0.1	7
COLOR (color units)	< 5.00	< 5.00	< 5	< 5	< 5.00	< 5.00	< 5.00	15 s			< 5.00	< 5.00	7
CHLORIDE	4.27	4.01	3.66	5.24	3.67	5.59	12.8	250 s		5.61	12.8	3.66	7
TOT. DISSOLVED SOLIDS	118	125	136	167	132	191	204	500 s		153	204	118	7
MAGNESIUM	12.9	13.1	8.3	15.1	9.15	16.4	13.6	unregulated		12.7	16.4	8.3	7
CALCIUM	26.2	31.1	23	29	25.6	34.5	42.7	unregulated		30.3	42.7	23	7
ORTHO-PHOSPHATE	not tested	not tested	< 0.01	0.02	not tested	not tested	not tested	unregulated		0.02	0.02	< 0.010	4
AMMONIA	< 0.02	< 0.02	not tested	not tested	< 0.05	< 0.05	< 0.05	unregulated			< 0.05	< 0.02	7
CYANIDE	< 0.05	< 0.05	< 0.01	< 0.01	< 0.05	< 0.05	< 0.05	0.2	0.2		< 0.05	< 0.01	7
FLUORIDE	< 0.071	0.073	< 0.01	< 0.01	< 0.2	< 0.2	< 0.2	2 s	4		< 0.5	< 0.01	7
NITRATE (NO3-N)	0.87	1.33	0.68	1.24	0.825	1.28	2.15	10	10	1.20	2.15	0.68	7
NITRITE (NO2-N)	< 0.063	< 0.063	< 0.01	< 0.01	< 0.1	< 0.1	< 0.1	1	1		< 0.1	< 0.01	7
SILICA (SI02)	11.4	11.9	not tested	not tested	10.9	11.1	15.9	unregulated		8.7	15.9	10.9	7
SULPHATE	12.8	10.4	6.68	11.5	7.92	14.0	11.5	250 s	400	10.7	14.0	6.7	7
ALUMINUM	< 0.00151	0.0016	< 0.05	< 0.05	< 0.01	< 0.01	< 0.01	0.05 - 0.2 s			< 0.05	< 0.05	7
ANTIMONY	0.00033	0.0006	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.006	0.006		< 0.00300	< 0.001	7
ARSENIC	0.00349	0.00507	0.00255	0.003	0.00249	0.00330	0.0044	0.010	0	0.0035	0.00507	0.00249	7
BARIUM	0.0233	0.0205	0.0164	0.0255	0.0188	0.0262	0.0451	2	2	0.0251	0.0451	0.0164	7
BERYLLIUM	< 0.00011	< 0.00011	< 0.0003	< 0.0003	< 0.0003	< 0.0003	< 0.0003	0.004	0.004		< 0.0008	< 0.00011	7
CADMIUM	< 0.00029	< 0.00029	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.005	0.005		< 0.001	< 0.00029	7
CHROMIUM	< 0.0004	< 0.0004	< 0.001	< 0.001	< 0.001	0.00128	0.00131	0.1	0.1		< 0.0060	< 0.001	7
COPPER	0.00443	0.00098	0.00445	0.00458	0.00591	< 0.001	0.00566	TT	1.3	0.0043	0.00591	0.00098	7
IRON	< 0.0018	< 0.0018	< 0.01	< 0.01	< 0.02	< 0.02	< 0.02	0.3 s			< 0.02	< 0.0018	7
LEAD	< 0.00031	< 0.00031	< 0.00100	< 0.00100	< 0.001	< 0.001	< 0.001	TT	0		< 0.001	< 0.00031	7
MANGANESE	0.00032	0.00035	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.05 s		0.0003	0.00035	< 0.001	7
MERCURY	< 0.00004	0.00006	< 0.0001	< 0.0001	< 0.0001	< 0.0001	< 0.0001	0.002	0.002	0.0000	0.00006	< 0.00004	7
NICKEL	0.00065	0.00081	< 0.001	0.00114	0.00104	0.00111	0.00134	0.1 * * *	0.1 * * *	0.00102	0.00134	< 0.001	7
SELENIUM	0.00066	0.00115	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.05	0.05	0.00091	0.00115	0.00066	7
SILVER	< 0.00034	< 0.00034	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.1 s			< 0.1	< 0.001	7
SODIUM	2.83	3.44	2.48	3.87	2.64	4.05	7.07	unregulated		3.8	7.07	2.48	7
THALLIUM	< 0.00029	< 0.00029	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.002	0.0005		< 0.001	< 0.00029	7
ZINC	0.00993	0.00803	0.0116	0.0156	0.00204	0.00997	0.0143	5 s		0.01021	0.0156	0.00204	7

RESULTS ARE IN mg/L EXCEPT WHERE OTHERWISE NOTED

* TT = Treatment Technique; s = Secondary MCL; t = State only MCL

** Aluminum is a secondary regulated contaminant

*** The MCL and MCLG for Nickel were remanded on February 9, 1995, monitoring requirements still in effect

divide by 17.1 to convert to grains per gallon

Appendix IV - Disinfection Byproducts - Distribution System

Distribution System Sampling for Disinfection Byproducts

	Reported										7-Mar-2017		
Location	Southview	Eagle Ridge II	Southview	Eagle Ridge II	Southview	Eagle Ridge II	Southview	Eagle Ridge II	Southview	Eagle Ridge II			MAXIMUM CONTAMINANT LEVELS (MCL)
Date	16-Apr-2015	16-Apr-2015	4-Aug-2015	4-Aug-2015	12-Nov-2015	12-Nov-2015	11-Feb-2016	11-Feb-2016	12-May-2016	12-May-2016			
Organics Lab	Anatek	Anatek	Anatek	Anatek	Anatek	Anatek	Anatek	Anatek	Anatek	Anatek			
Total Chlorine Residual, mg/L													
TRICHALOMETHANES, results micrograms/L													
Chloroform	0.44	0.37	0.39	< 0.25	1.28	0.8	0.72	0.41	0.42	< 0.5			
Bromodichloromethane	1.04	0.64	0.82	< 0.5	1.74	1.08	1.28	0.71	0.97	< 0.5			
Dibromochloromethane	1.22	0.71	1.29	< 0.5	1.9	1.24	1.42	0.83	1.52	0.51			
Bromoform	0.59	< 0.5	0.71	< 0.5	0.72	0.52	< 0.5	< 0.5	0.91	< 0.5			
TOTAL TRICHALOMETHANES	3.29	1.72	3.24	< 0.5	5.64	3.64	3.42	1.95	3.82	0.51			80
LRAA	3.93	0.97	3.82	0.97	3.98	1.88	3.9	1.83	4.03	1.53			
HALOACETIC ACIDS (HAA5), results micrograms/L													
Chloroacetic acid	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 2	< 2			
Bromoacetic acid	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			
Di-Chloroacetic acid	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			
Tri-Chloroacetic acid\	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			
Di-Bromoacetic acid	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			
TOTAL HAA (5)	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			60
Chloro,bromoacetic acid *	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1	< 1			

Results are in µg/L (ppb) except where otherwise noted

* State Unregulated

Prepared by Environmental Programs

Distribution System Sampling for Disinfection Byproducts

Location	Southview	Eagle Ridge II	Southview	Eagle Ridge II	MAXIMUM CONTAMINANT LEVELS (MCL)
Date	11-Aug-2016	11-Aug-2016	16-Nov-2016	16-Nov-2016	
Organics Lab	Anatek	Anatek	Anatek	Anatek	
Total Chlorine Residual, mg/L					
TRIHALOMETHANES, results micrograms/L					
Chloroform	0.27	< 0.5	0.69	0.45	
Bromodichloromethane	0.68	< 0.5	1.44	0.69	
Dibromochloromethane	1.18	< 0.5	1.81	0.83	
Bromoform	0.77	< 0.5	< 0.5	< 0.5	
TOTAL TRIHALOMETHANES	2.90	< 0.5	3.94	1.97	80
LRAA	3.95	1.53	3.52	1.11	
HALOACETIC ACIDS (HAA5), results micrograms/L					
Chloroacetic acid	< 2	< 2	< 2	< 2	
Bromoacetic acid	< 1	< 1	< 1	< 1	
Di-Chloroacetic acid	< 1	< 1	< 1	< 1	
Tri-Chloroacetic acid\	< 1	< 1	< 1	< 1	
Di-Bromoacetic acid	< 1	< 1	< 1	< 1	
TOTAL HAA (5)	< 1	< 1	< 1	< 1	60
Chloro,bromoacetic acid *	< 1	< 1	< 1	< 1	

Results are in µg/L (ppb) except where otherwise noted

* State Unregulated

Prepared by Environmental Programs

CONTAMINANTS FOUND IN DRINKING WATER TESTING IN 2016
CITY OF SPOKANE, WATER & HYDROELECTRIC SERVICES

Data presented, if not from 2016, is from the most recent testing done in accordance with the regulations.

SOURCE WATER TESTING		Highest Average	Detected Maximum	Detected min.	Number Positive Samples	Number of Samples	MCL	MCLG	MAJOR SOURCES
CONTAMINANT	Units								
Arsenic	µg/L	(a)	5.1	3.5	2	2	10	0	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes
Nitrate	mg/L	(a)	3.19	0.76	10	10	10	10	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Gross Alpha	pCi/L	(a)	1.6	< 1.0	2	3	15	0	Erosion of natural deposits
Combined Radium 226 and 228 (b)	pCi/L	(a)	1.6	<0.5	2	3	5	0	Erosion of natural deposits
DISTRIBUTION SYSTEM TESTING		LRAA	Detected Maximum	Detected min.	Number Positive Samples	Number of Samples	MCL	MCLG	MAJOR SOURCES
CONTAMINANT	Units								
Disinfection Byproducts - TTHMs [Total Trihalomethanes]	µg/L	4.03	3.94	0.51	7	8	80	0	By-product of drinking water chlorination
CONTAMINANT		Highest Percent Detected	Sample Date	Violation	MCL		MCLG		
		date sampled	90th Percentile (d)	Number of Sites exceeding AL	Number Positive Samples	Number of Samples	MCL	MCLG	
Copper (c)	mg/L	Aug-15	0.06	0	58	58	TT, AL= 1.3	1.3	Corrosion of household plumbing systems; Erosion of natural deposits; Leaching from wood preservatives
Lead (c)	µg/L	Aug-15	5.00	0	57	58	TT, AL= 15	0	Corrosion of household plumbing systems; Erosion of natural deposits

Notes

- (a) Compliance with MCL is determined by single sample results, so no average is used.
 (b) Gross Alpha results were used in lieu of Radium 226, one half of the detection limit of 1.0 was used for the ND
 (c) Faucet samples were from 'at risk' homes (those with lead service lines and those with copper pipes with lead solder joints).
 (d) 90% of at-risk homes had this concentration, or less, of lead/copper.

Key to Table

AL = Action Level = The concentration of a contaminant which, if exceeded, triggers treatment or other requirement which a water system must follow.

LRAA = Locational Running Annual Average

MCL = Maximum Contaminant Level = The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG = Maximum Contaminant Level Goal = The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

pCi/L = picocuries per liter (a measure of radioactivity)

µg/L = micrograms per Liter = parts per billion

mg/L = milligrams per Liter = parts per million

TT = Treatment Technique = A required process intended to reduce the level of a contaminant in drinking water.

ND = None Detected

NA = Not Applicable

< less than